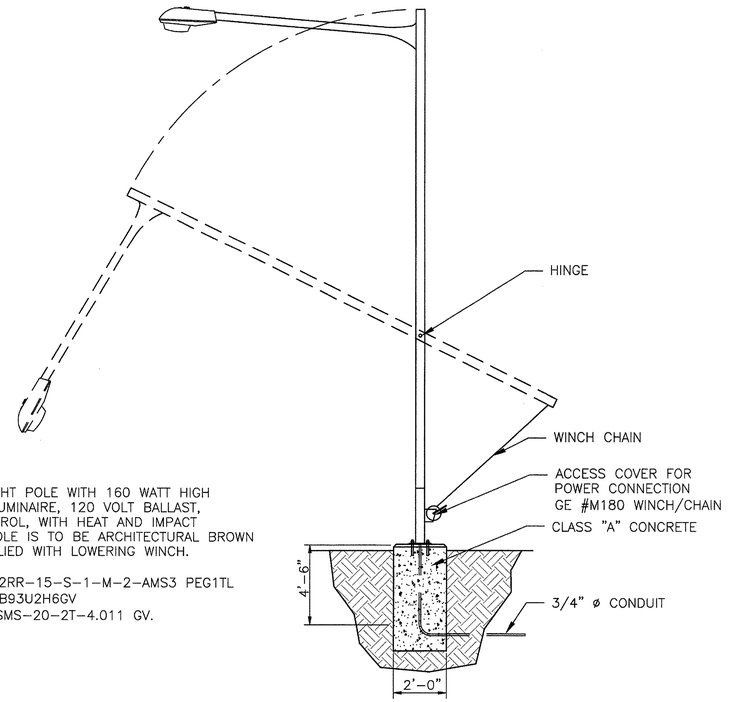

NOTE:
EXTERIOR HINGED LIGHT POLE WITH 160 WATT HIGH PRESSURE SODIUM LUMINAIRE, 120 VOLT BALLAST, PHOTOELECTRIC CONTROL, WITH HEAT AND IMPACT RESISTANT LENS. POLE IS TO BE ARCHITECTURAL BROWN AND IS TO BE SUPPLIED WITH LOWERING WINCH.

LUMINAIRE---GE #M2RR-15-S-1-M-2-AMS3 PEG1TL
BRACKET----GE #RB93U2H6GV
POLE------GE #ASMS-20-2T-4.011 GV.

OUTDOOR LIGHTING POLE
NO SCALE

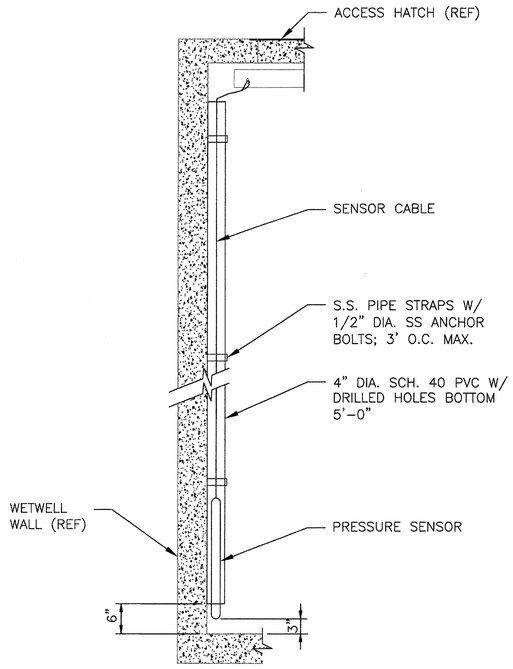

LEVEL TRANSDUCER MOUNTING SYSTEM (TYP.)
NO SCALE

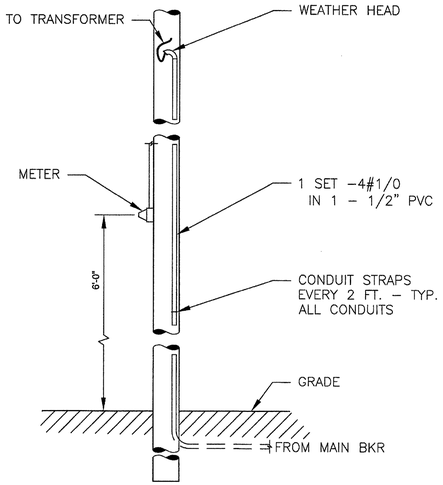

SERVICE POLE
NO SCALE

WILLIAMS CONSULTING ENGINEERING, PC
901 Pinehurst Cove,
Woodstock, Georgia 30188
Phone: (770) 926-1239

GEORGIA REGISTERED No. 20701 PROFESSIONAL ENGINEER PEMBROKE W. WILLIAMS JR.
9-7-13

ATKINS
192 Anderson Street, Suite 150
Marietta, Ga 30060
P: 770-422-1902 F: 770-426-5316

DATE	REVISION	
		△

PROJ. NO.: 10003405
DESIGNED BY: PMW
DRAWN BY: JAL
CHECKED BY: PMW
APPROVED BY: PMW
DATE: AUGUST, 2013
SCALE: AS NOTED

CHEROKEE COUNTY WATER & SEWERAGE AUTHORITY
HOLLY SPRINGS
DOWNTOWN SANITARY SEWER SYSTEM

ELECTRICAL DETAILS

SHEET NO.
E-3