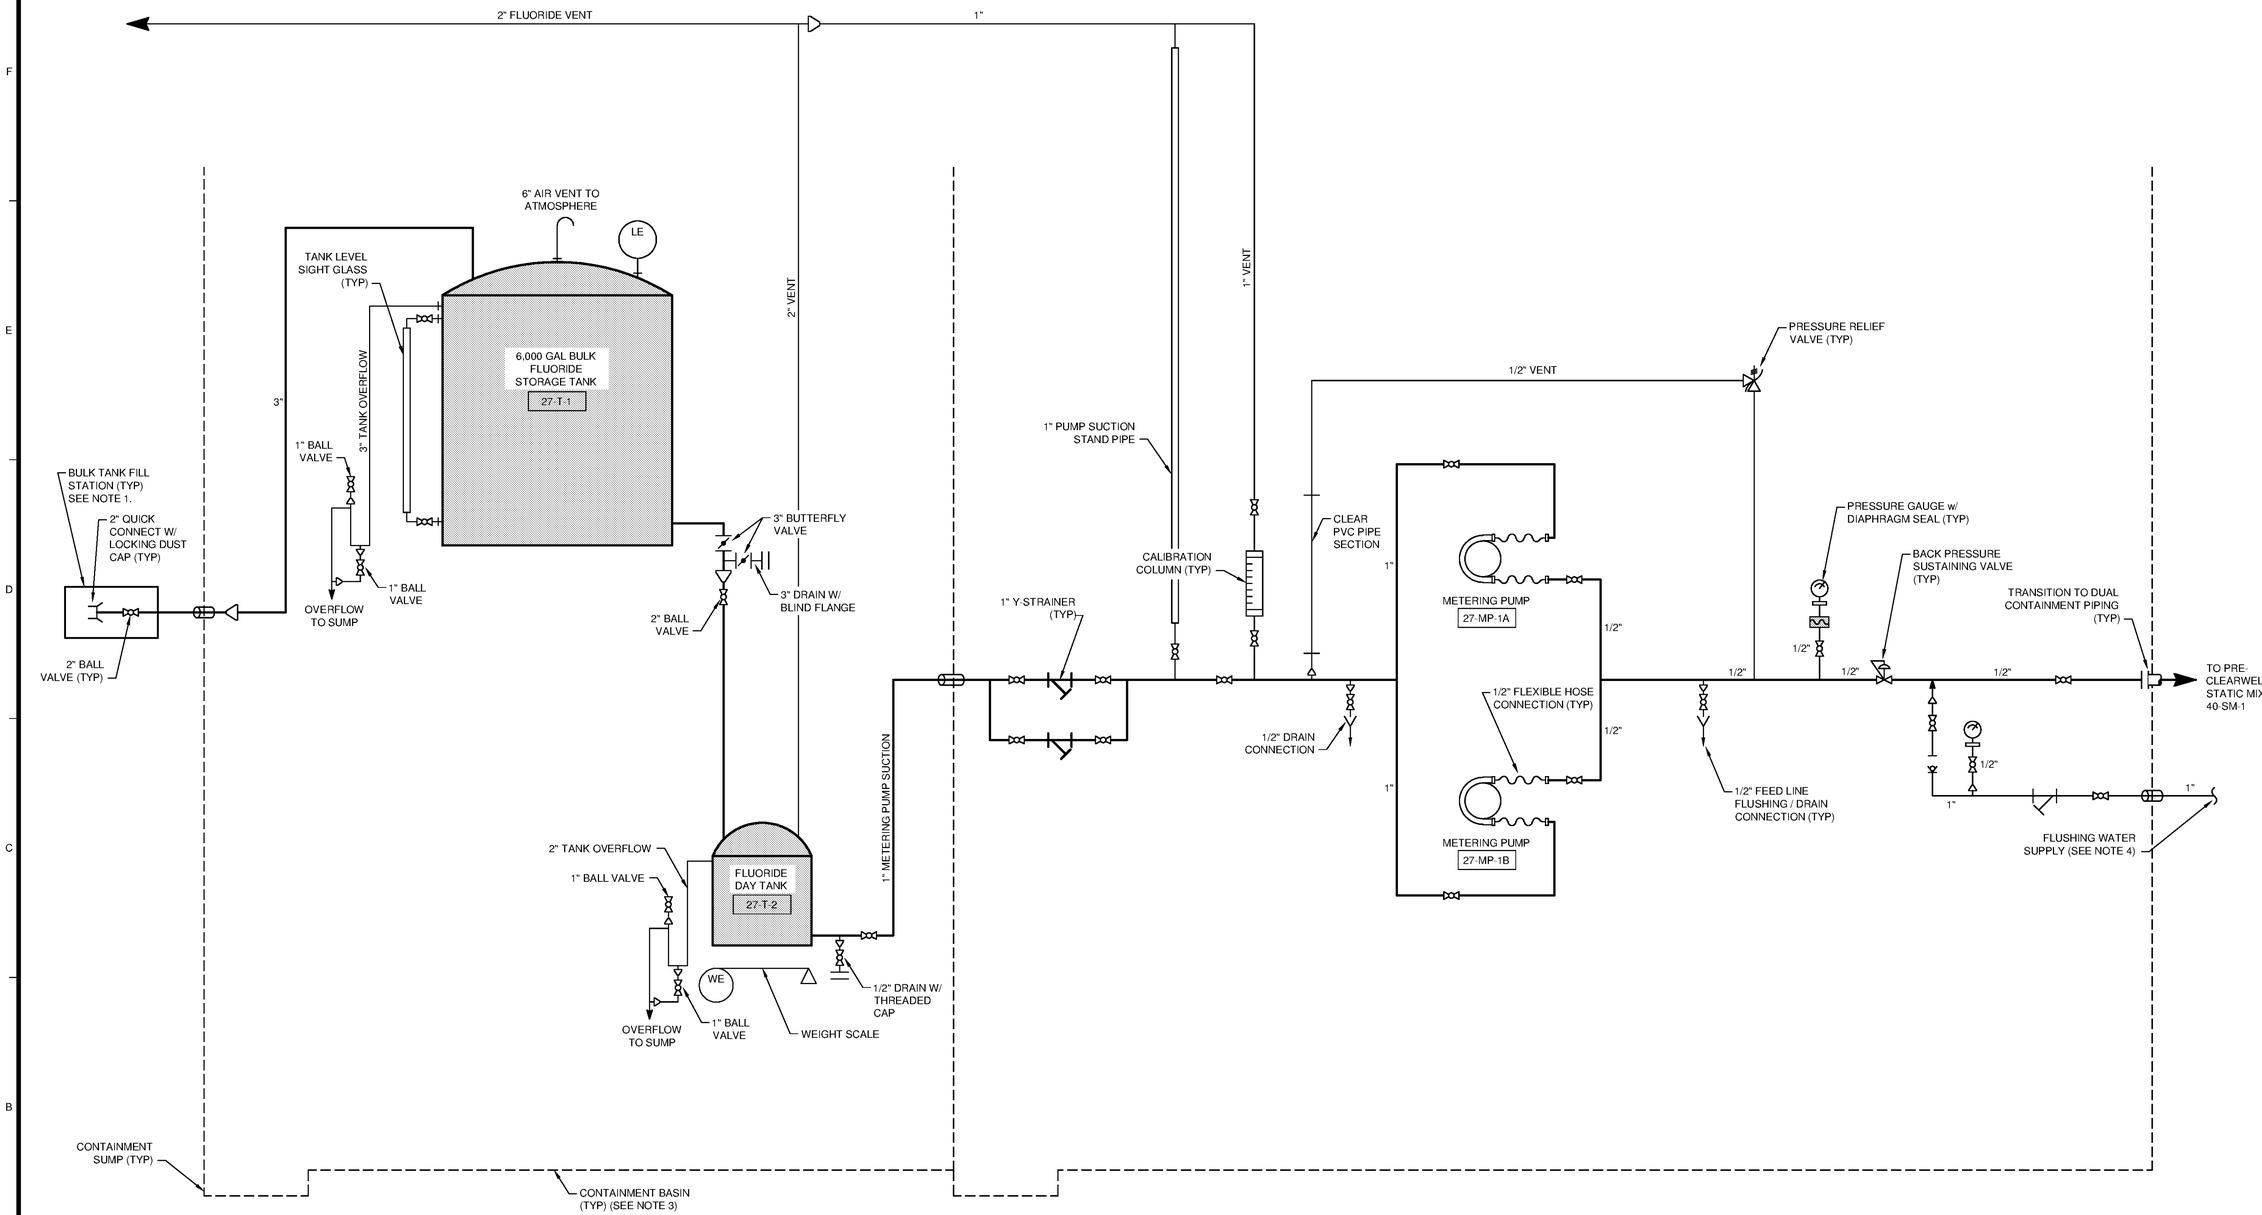

NOTES:

1. BULK TANK FILL STATION SHALL INCLUDE DRIP CONTAINMENT, DIGITAL LEVEL INDICATOR WITH HIGH LEVEL AND HIGH-HIGH LEVEL ALARMS AND A HORN AND SIREN WITH ALARM SILENCE PUSH BUTTON.
2. FLUORIDE FEED PIPING LOCATED OUTSIDE OF CONTAINMENT AREAS SHALL BE INSTALLED WITH DOUBLE CONTAINMENT AND LEAK DETECTION.
3. CONTAINMENT AREA FLOORS SHALL BE SLOPED TO SUMPS.
4. MAKE-UP WATER SUPPLY PROVIDED FOR FLUSHING THE CHEMICAL FEED LINES.

TETRA TECH
www.tetratech.com
101 QUALITY CIRCLE, SUITE 140
HUNTSVILLE, ALABAMA 35806
PHONE: (256) 424-4077 FAX: (256) 424-4097

BID SET

MARK	DATE	DESCRIPTION	BY

HUNTSVILLE UTILITIES
SOUTHEAST WATER TREATMENT PLANT

FLUORIDE FEED SYSTEM PROCESS PIPING SCHEMATIC

Project No.:	200-11740-10003
Designed By:	JCB
Drawn By:	JTE
Checked By:	JEC

D-2118

Copyright: Tetra Tech

Bar Measures 1 inch

10/17/2014 3:46:48 PM - P:\IER\11740\200-11740-10003\CAD\SHEETFILES\TREATMENT PLANT\WTP-D-00XX PROCESS FLOW DIAGRAMS.DWG - EVANS, JON