



1 2 3 4 5 6 7

F
E
D
C
B
A

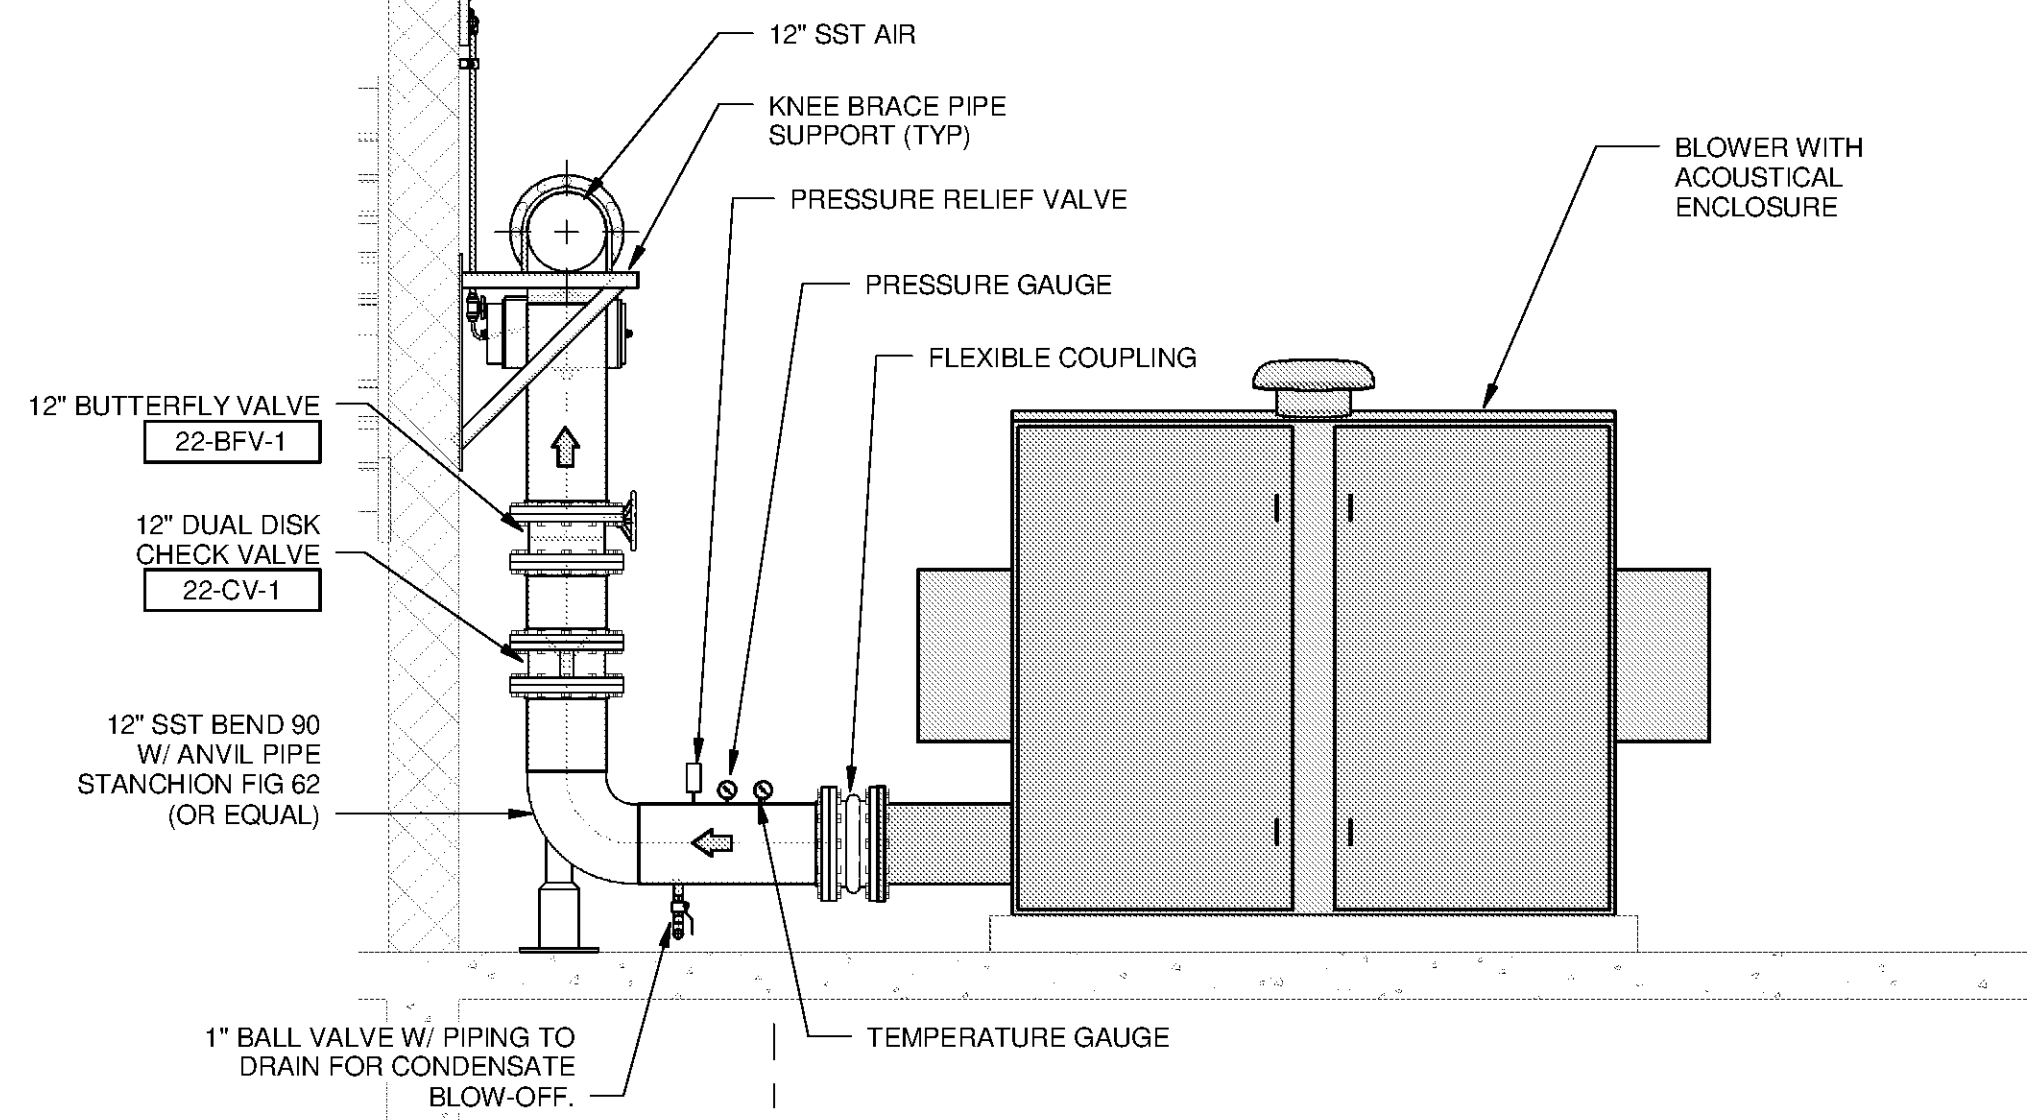


A SECTION
D-2108 SCALE: 3/8" = 1'-0"

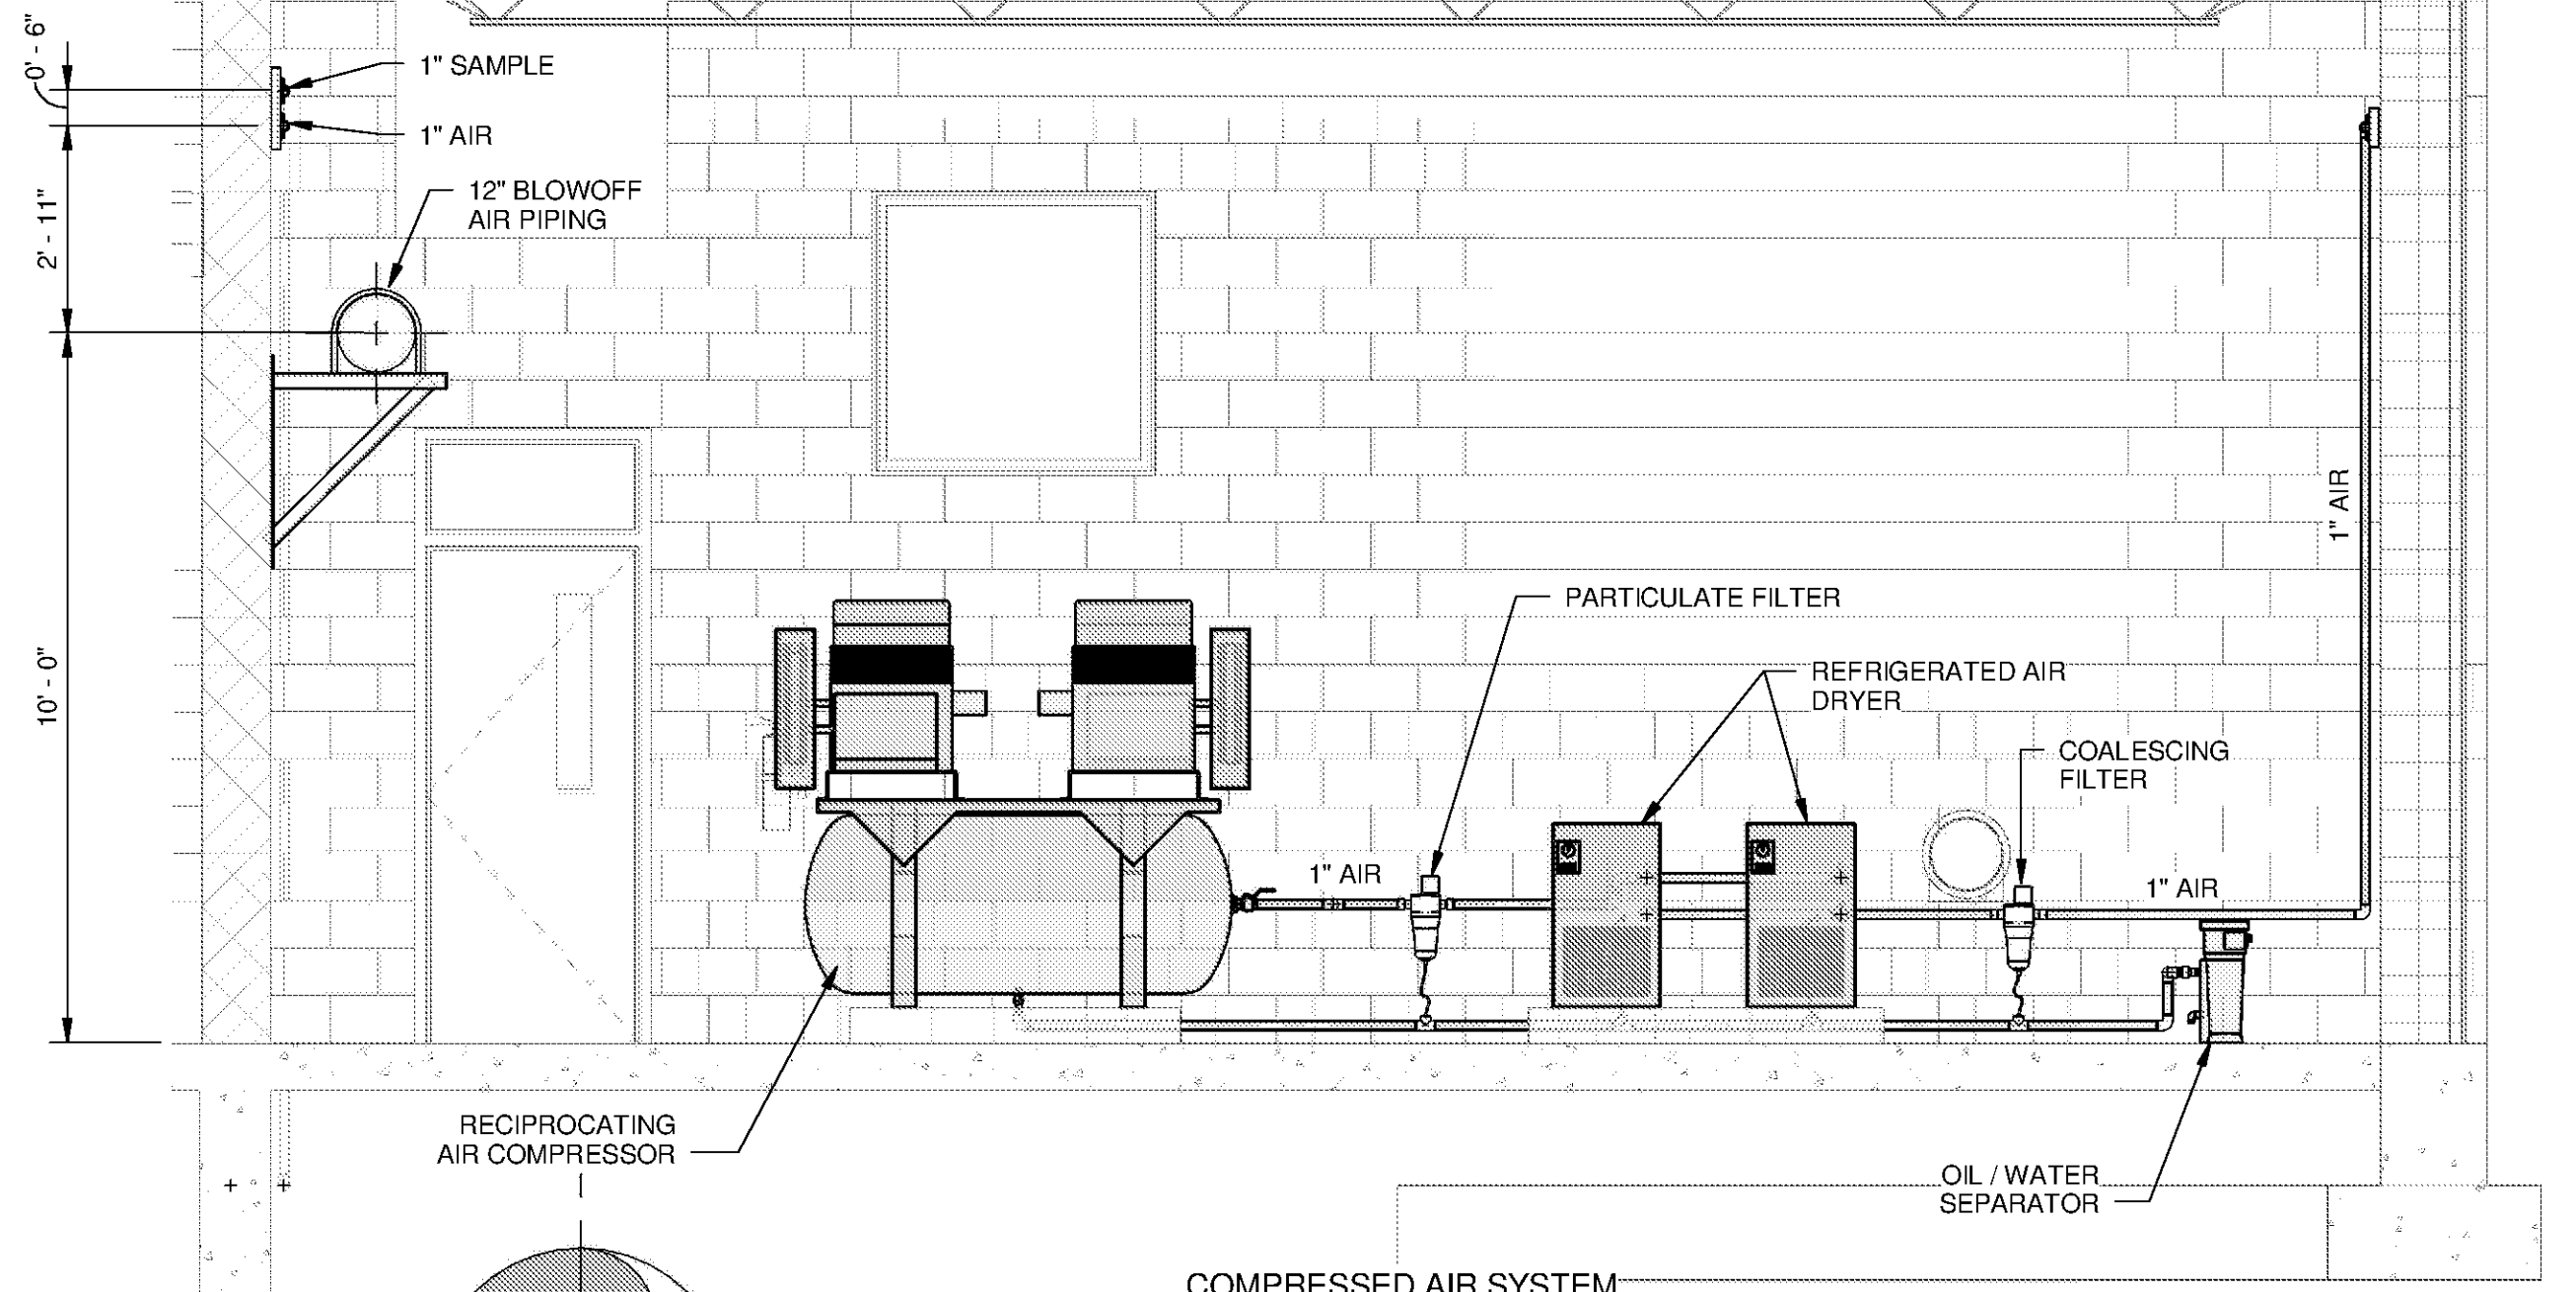


B SECTION
D-2108 SCALE: 3/8" = 1'-0"

NOTE:
1. REFER TO COMPRESSED AIR DIAGRAM (DWG D-2108) FOR COMPLETE PIPING SCHEMATIC.

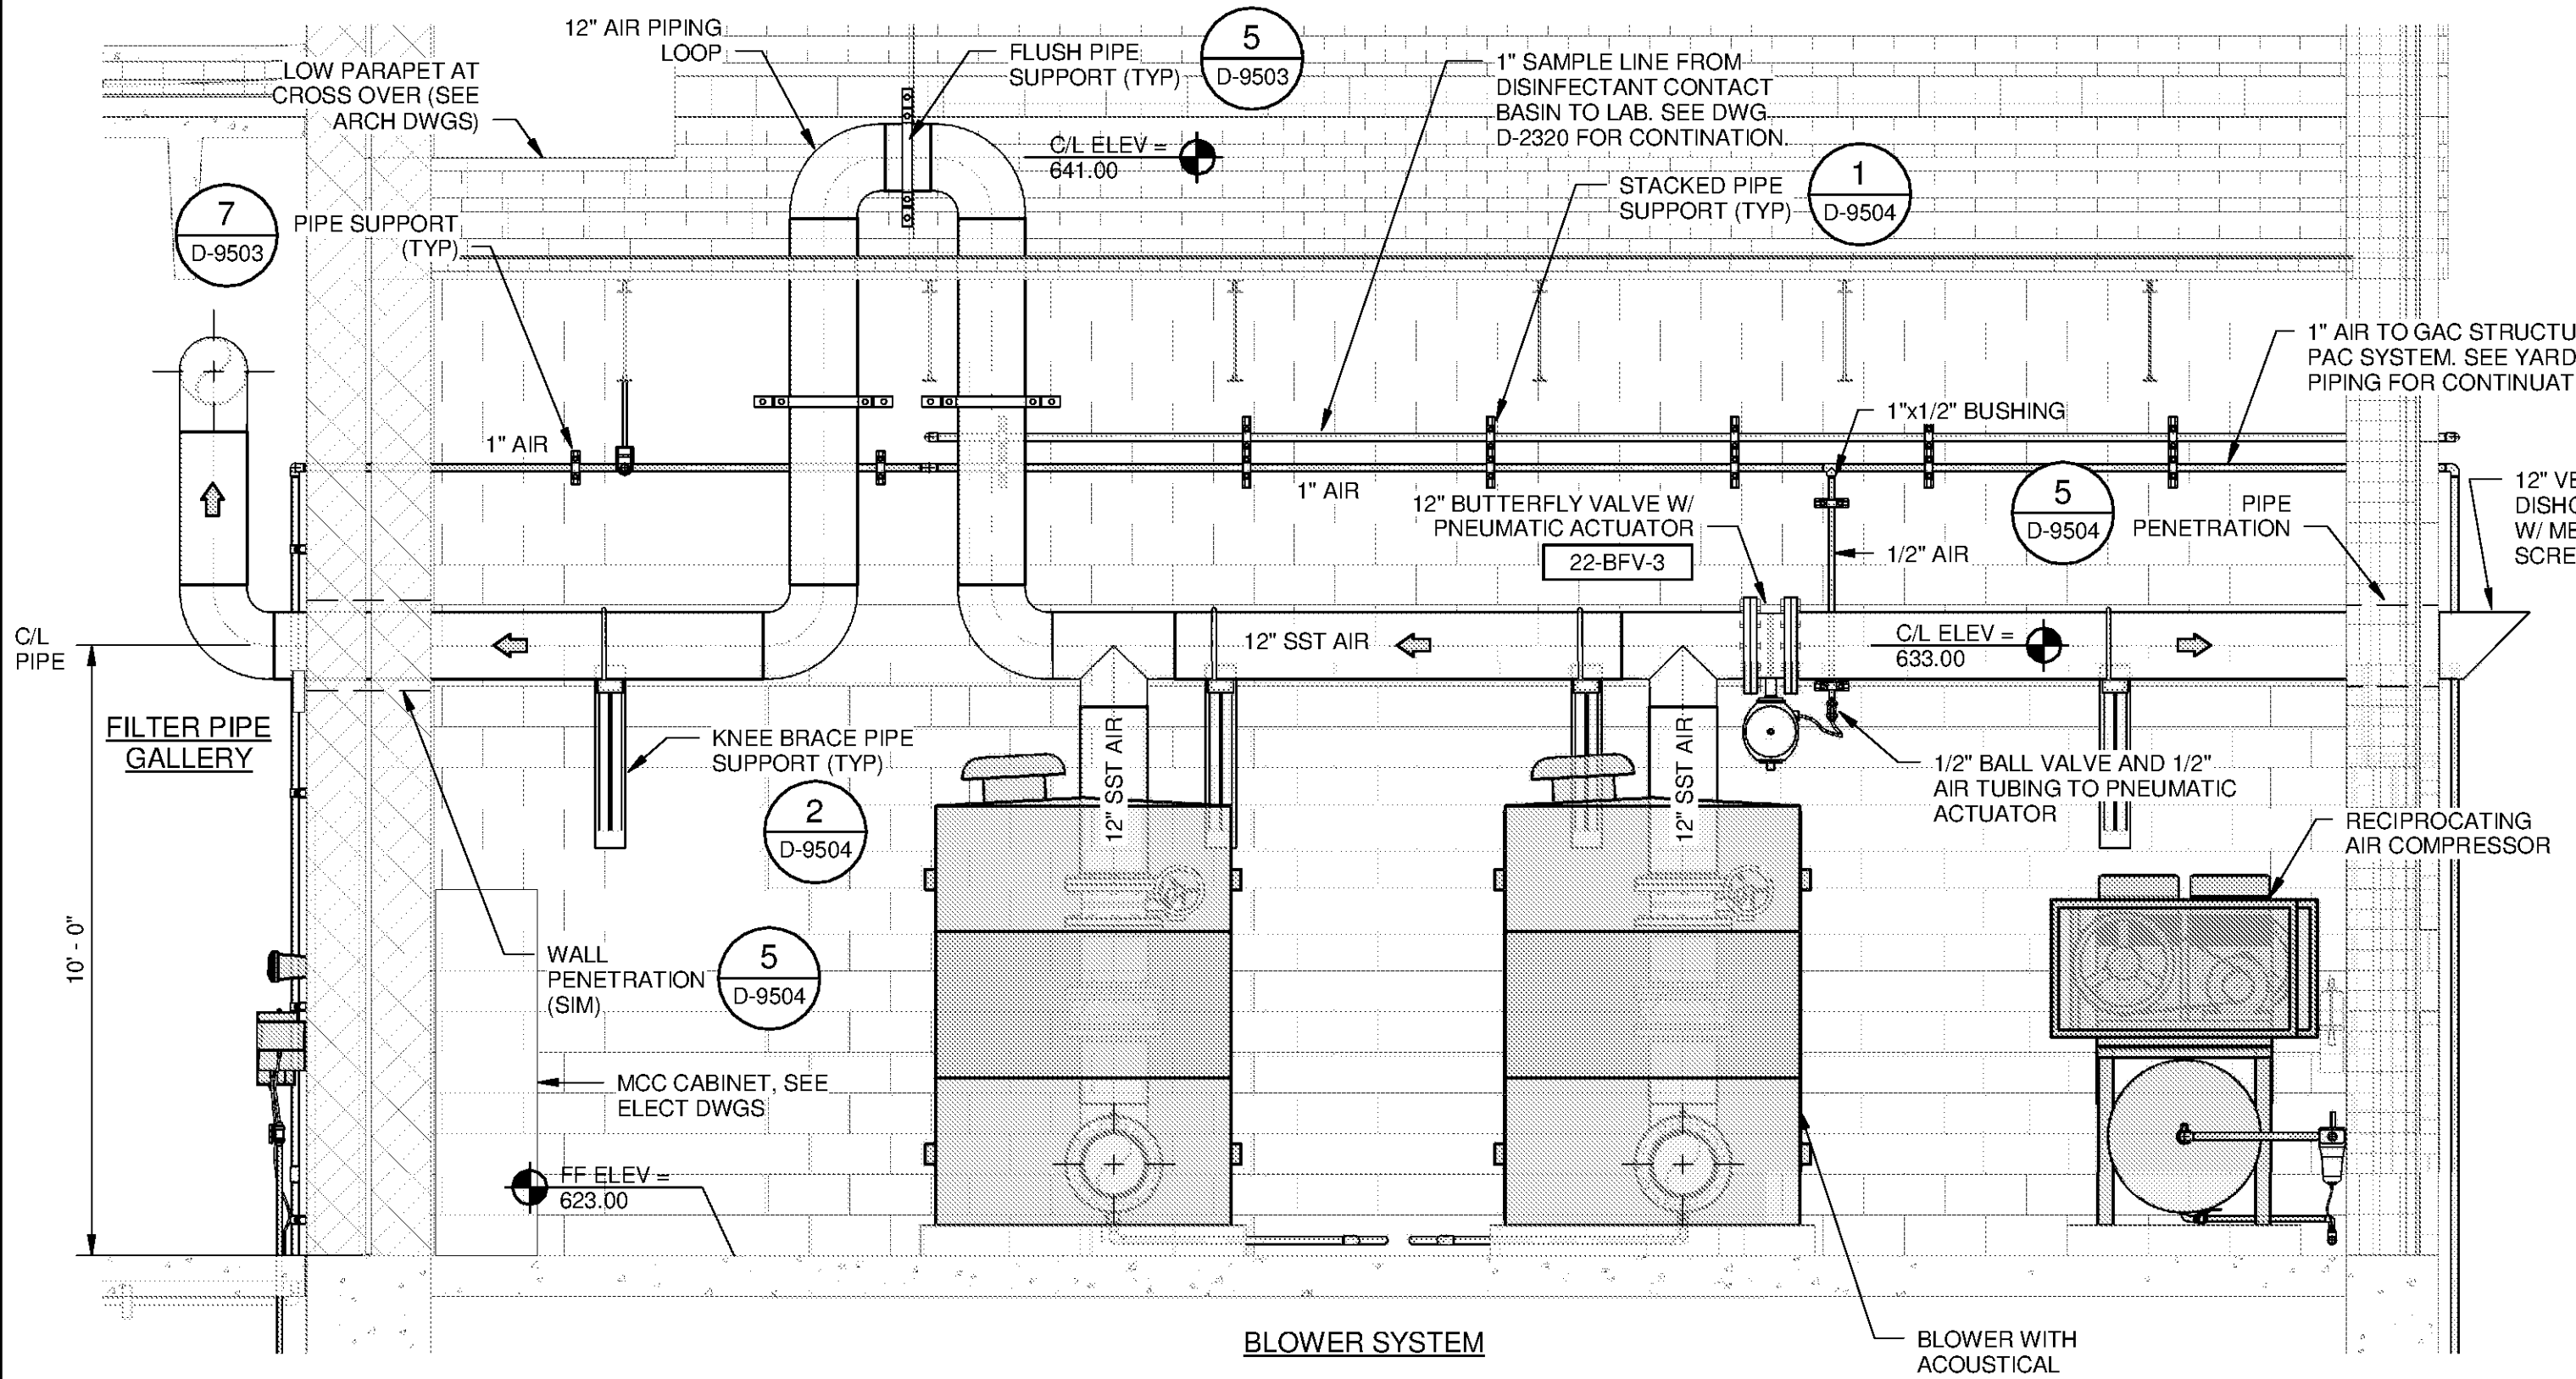


C SECTION
D-2108 SCALE: 3/8" = 1'-0"

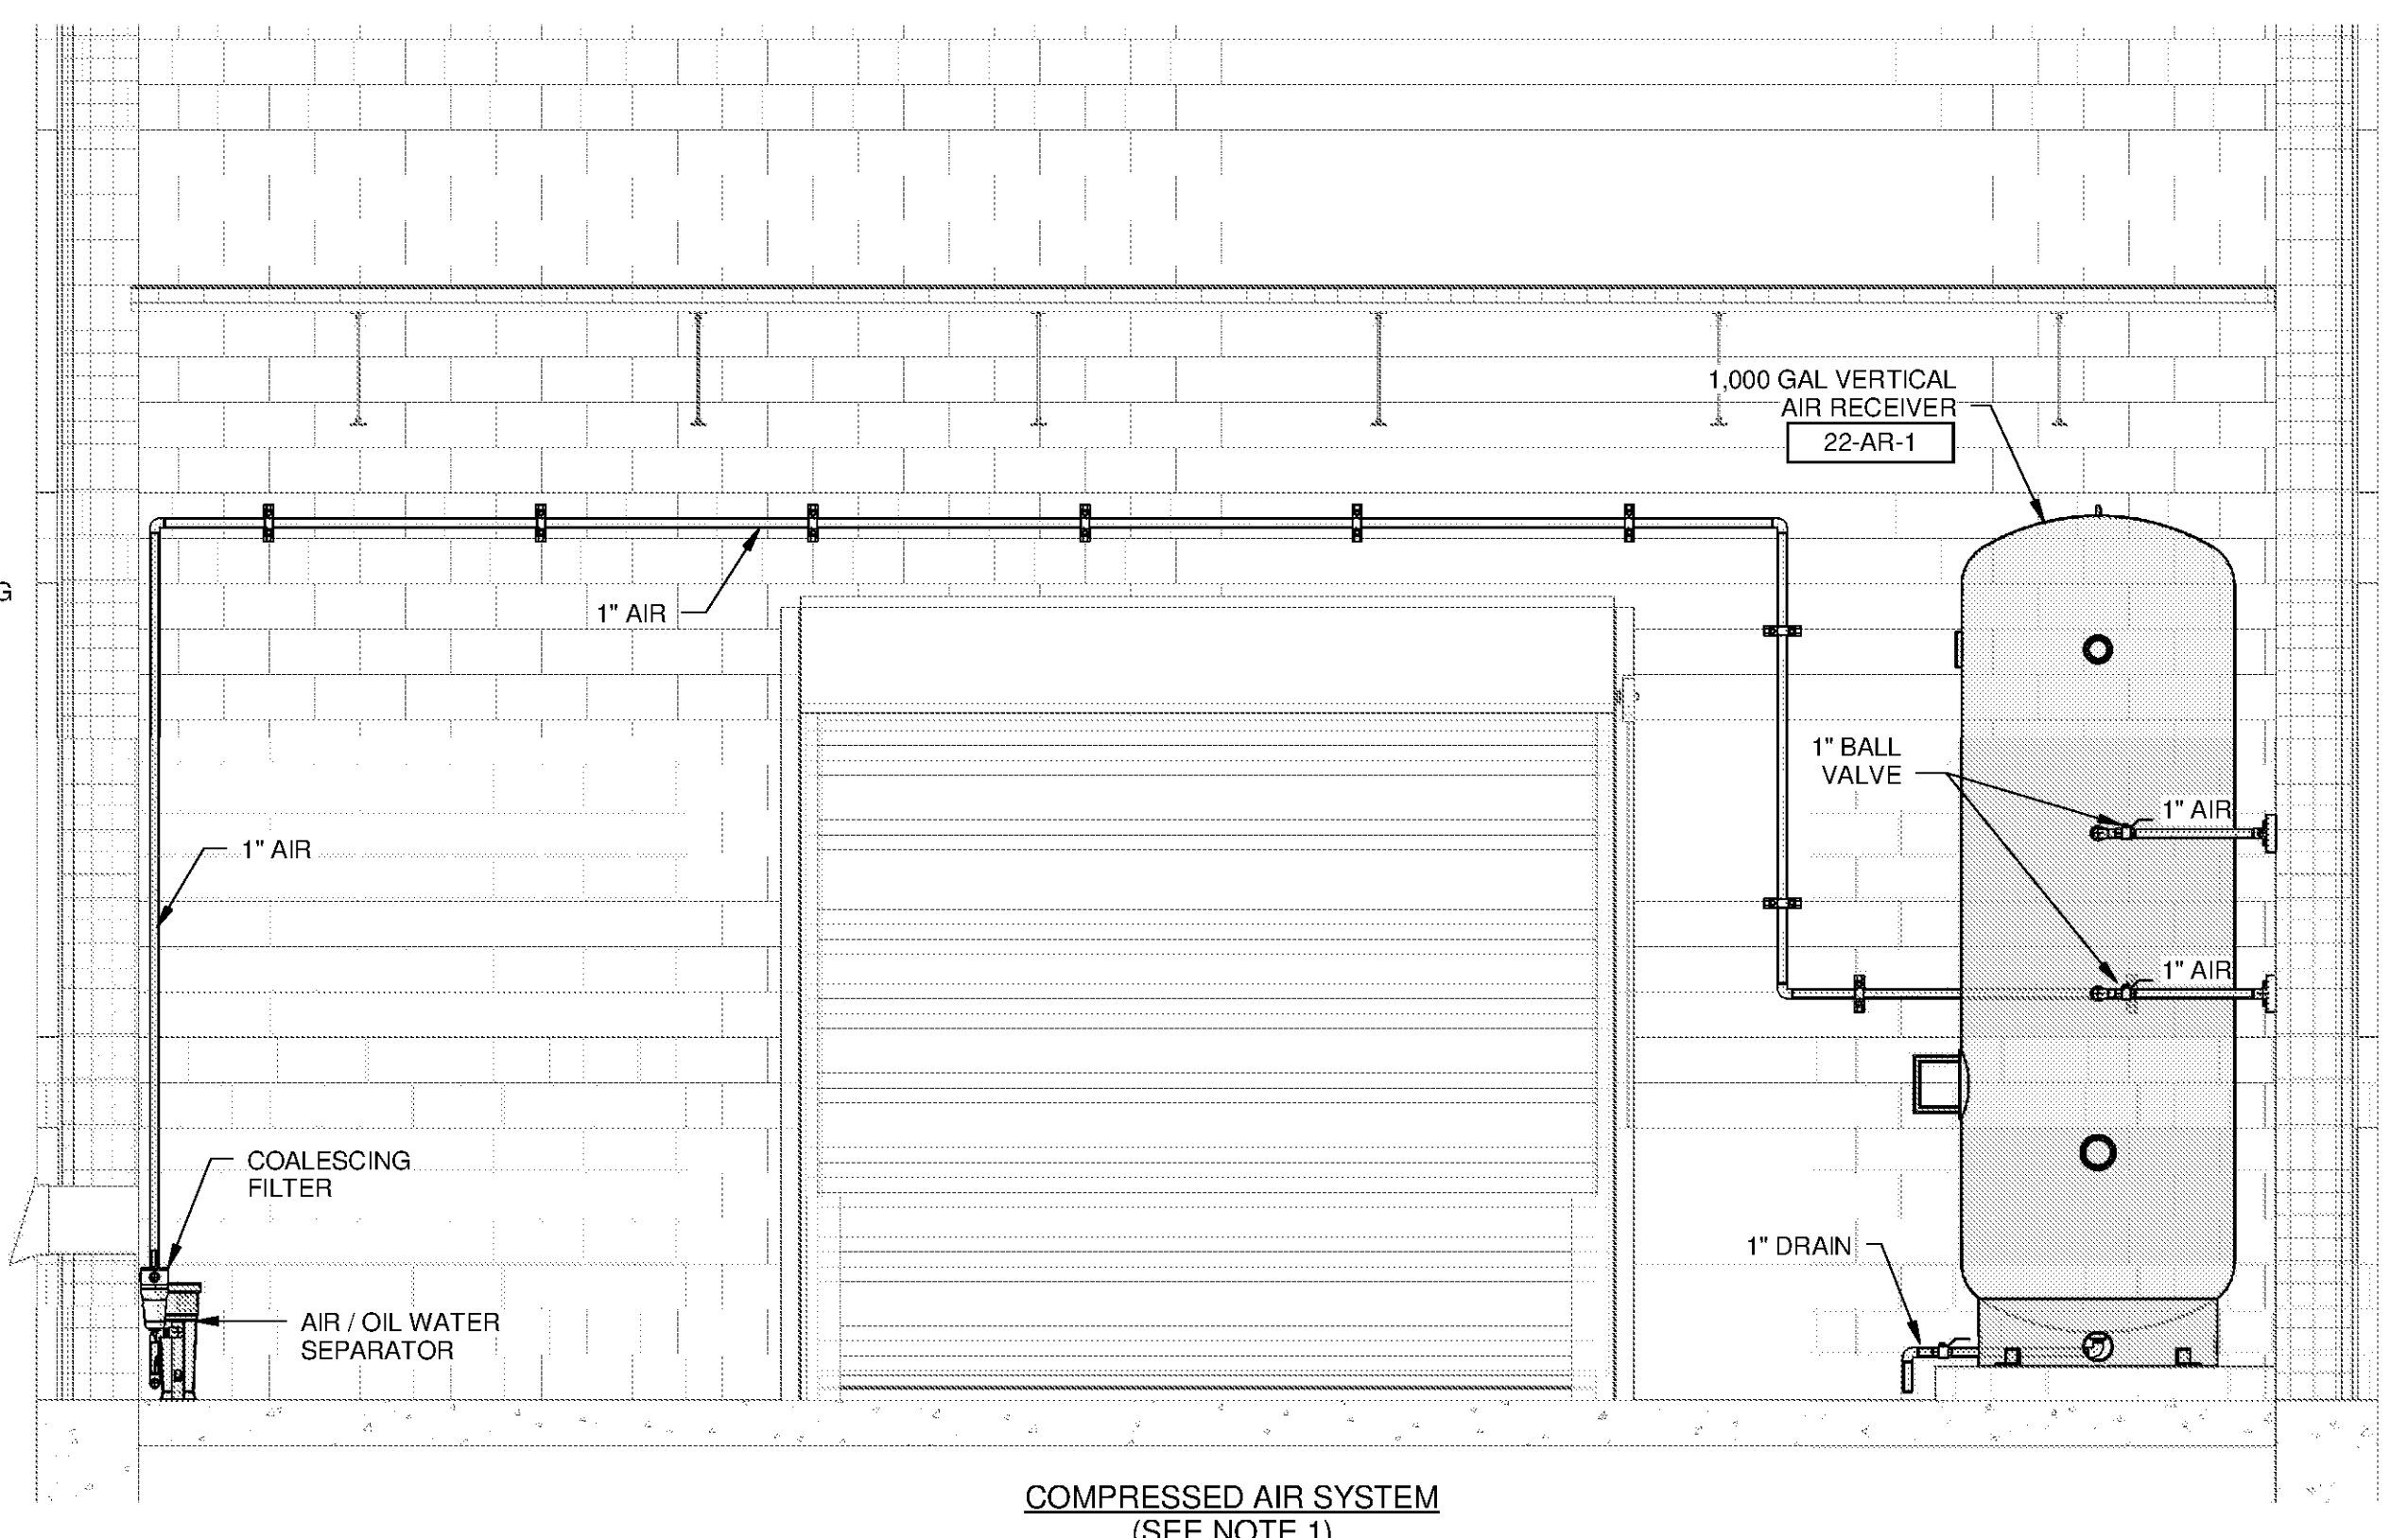

D SECTION
D-2108 SCALE: 3/8" = 1'-0"

TETRA TECH
www.tetrattech.com
101 QUALITY CIRCLE, SUITE 140
HUNTSVILLE, ALABAMA 35896
PHONE: (256) 424-4077 FAX: (256) 424-4087

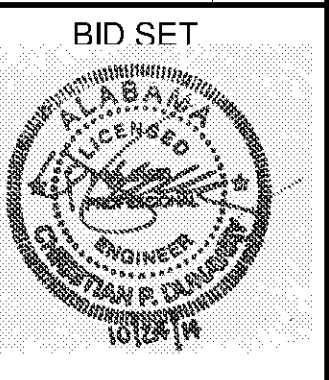

BY	DATE	DESCRIPTION

HUNTSVILLE UTILITIES
SOUTHEAST WATER TREATMENT PLANT
BLOWER ROOM SECTIONS

Project No.: 200-11740-10003
Designed By: JCB
Drawn By: JTE
Checked By: JPT

D-2307

10/17/2014 4:38:54 PM C:\Users\ion.evans\Desktop\Active Projects\Revit\WTP-11740-D-MAINPR_ion.evans.rvt