



10/17/2014 3:47:38 PM P:\IER\11740\200-11740-10003\CAD\SH\FILESTREATMENT PLANT\WTP-D-5101-SLUDGE THICKENER UNDERDRAIN SYSTEM.DWG - EVANS, JON

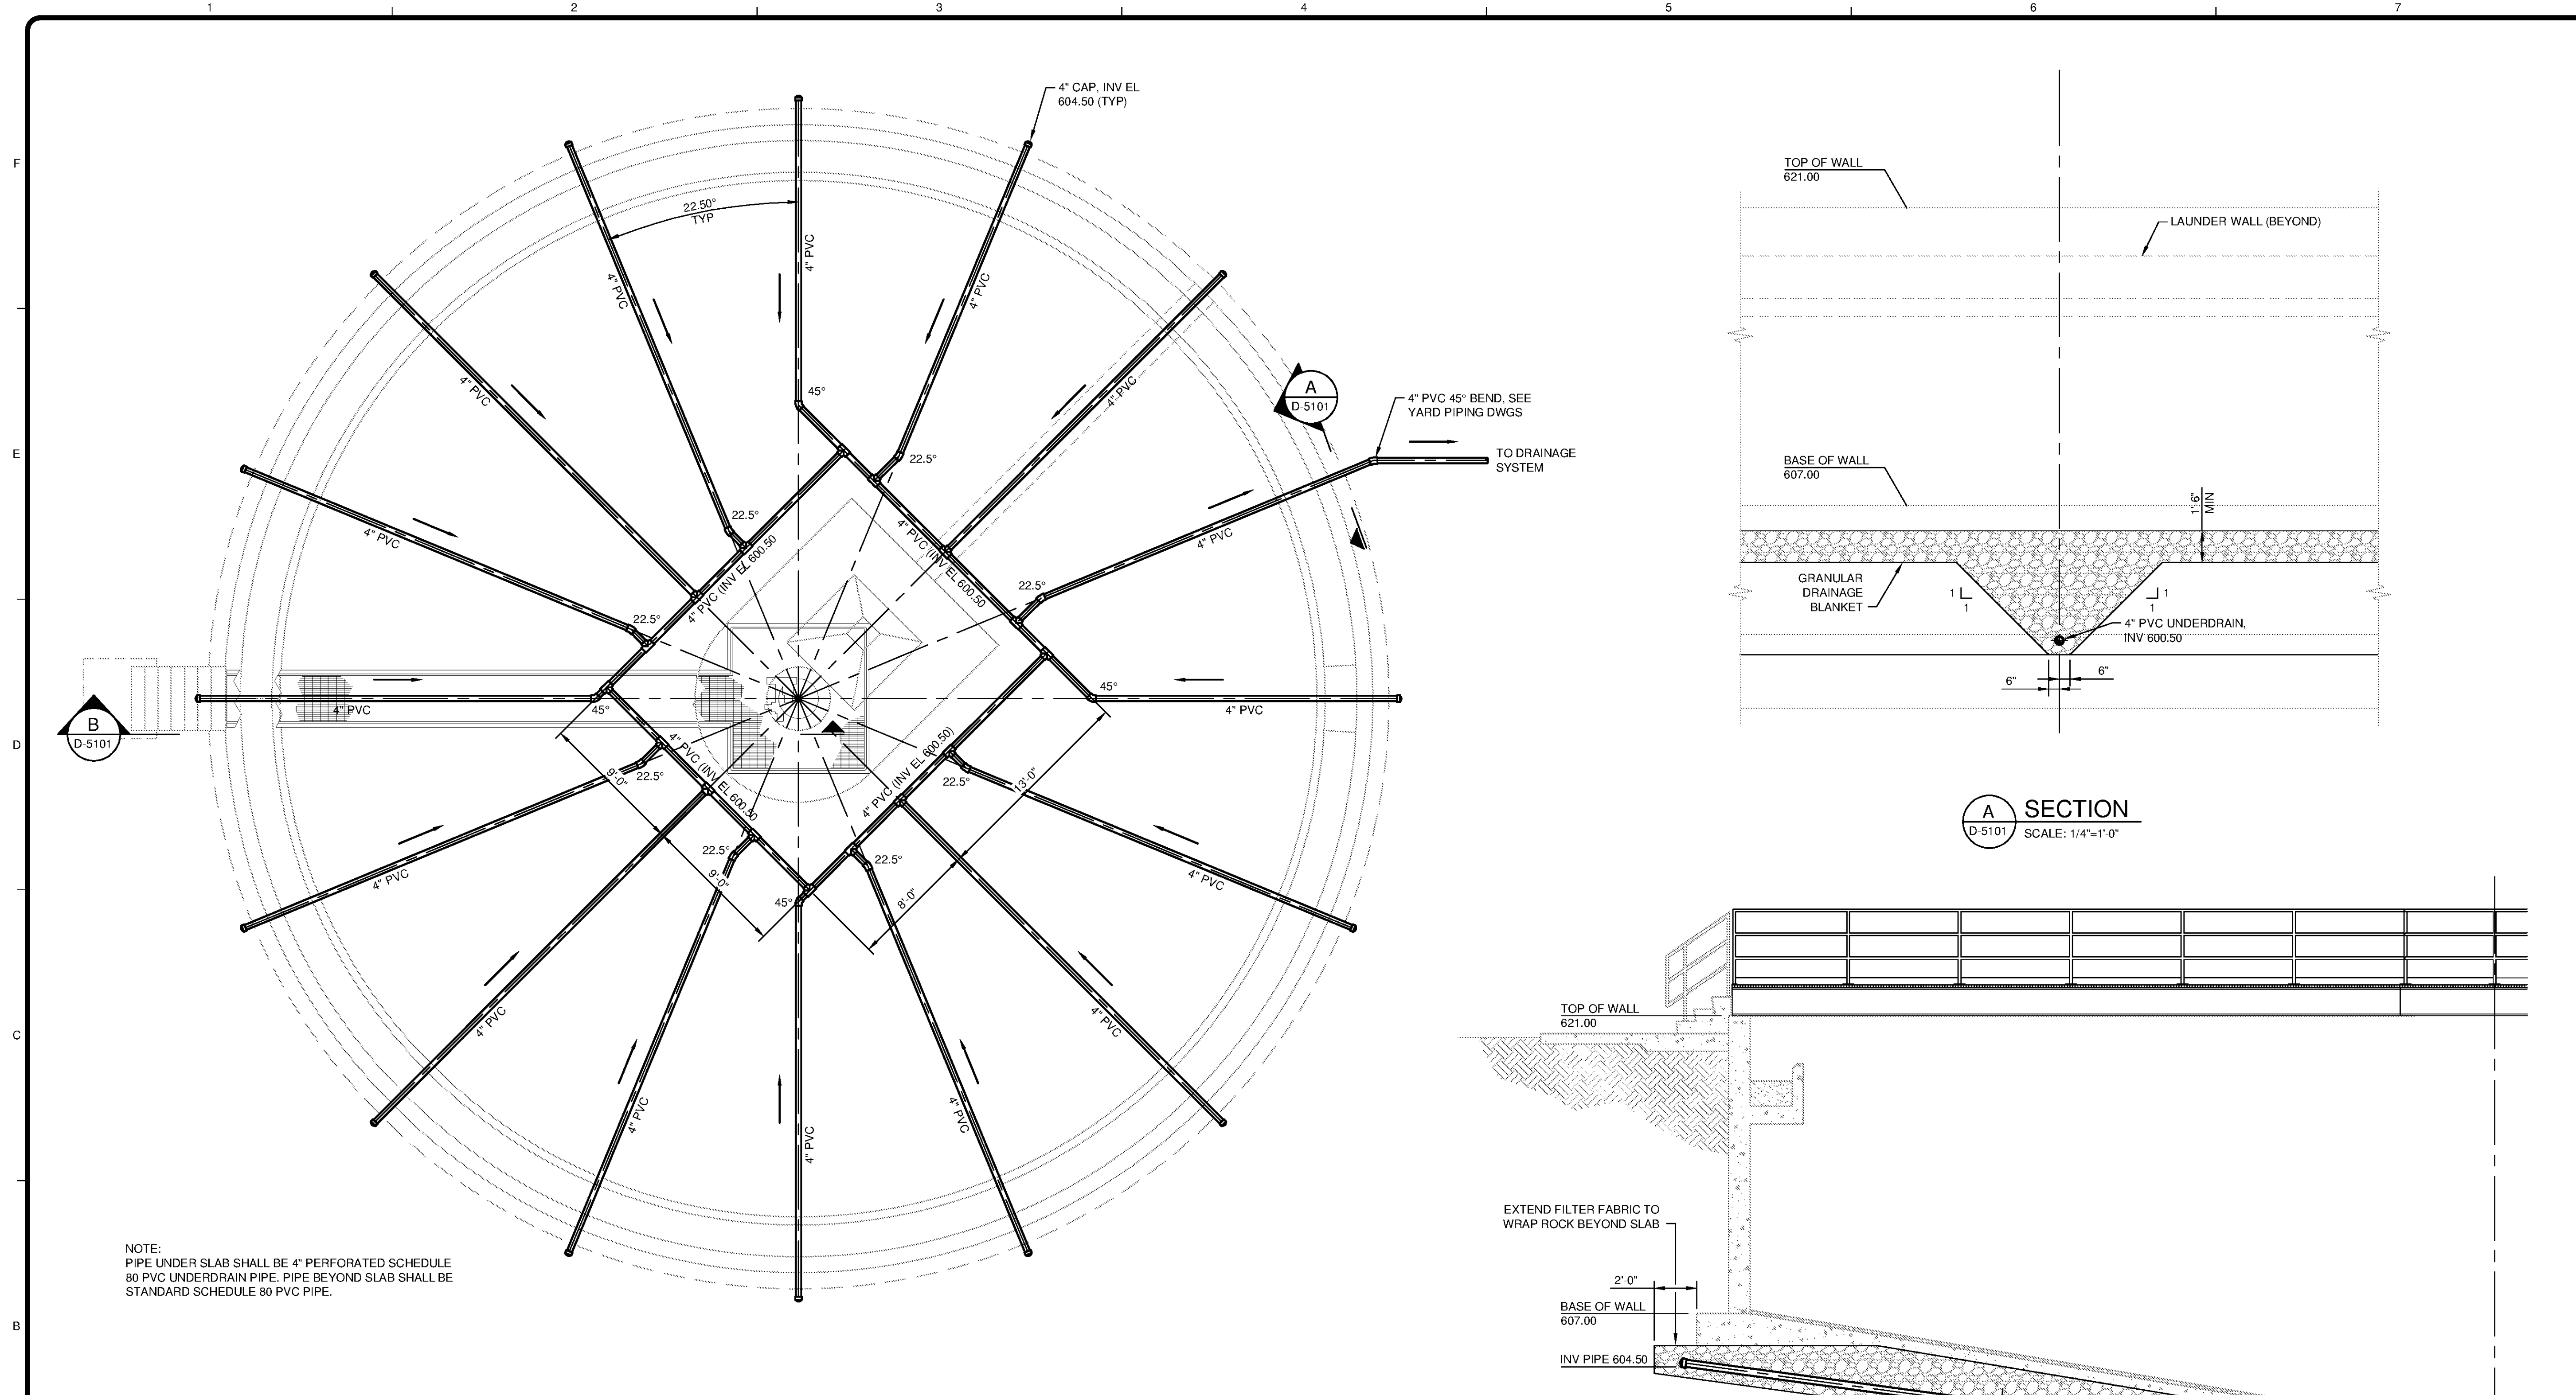


NOTE:
PIPE UNDER SLAB SHALL BE 4" PERFORATED SCHEDULE
80 PVC UNDERDRAIN PIPE. PIPE BEYOND SLAB SHALL BE
STANDARD SCHEDULE 80 PVC PIPE.

PLAN
SCALE: 1/4"=1'-0"

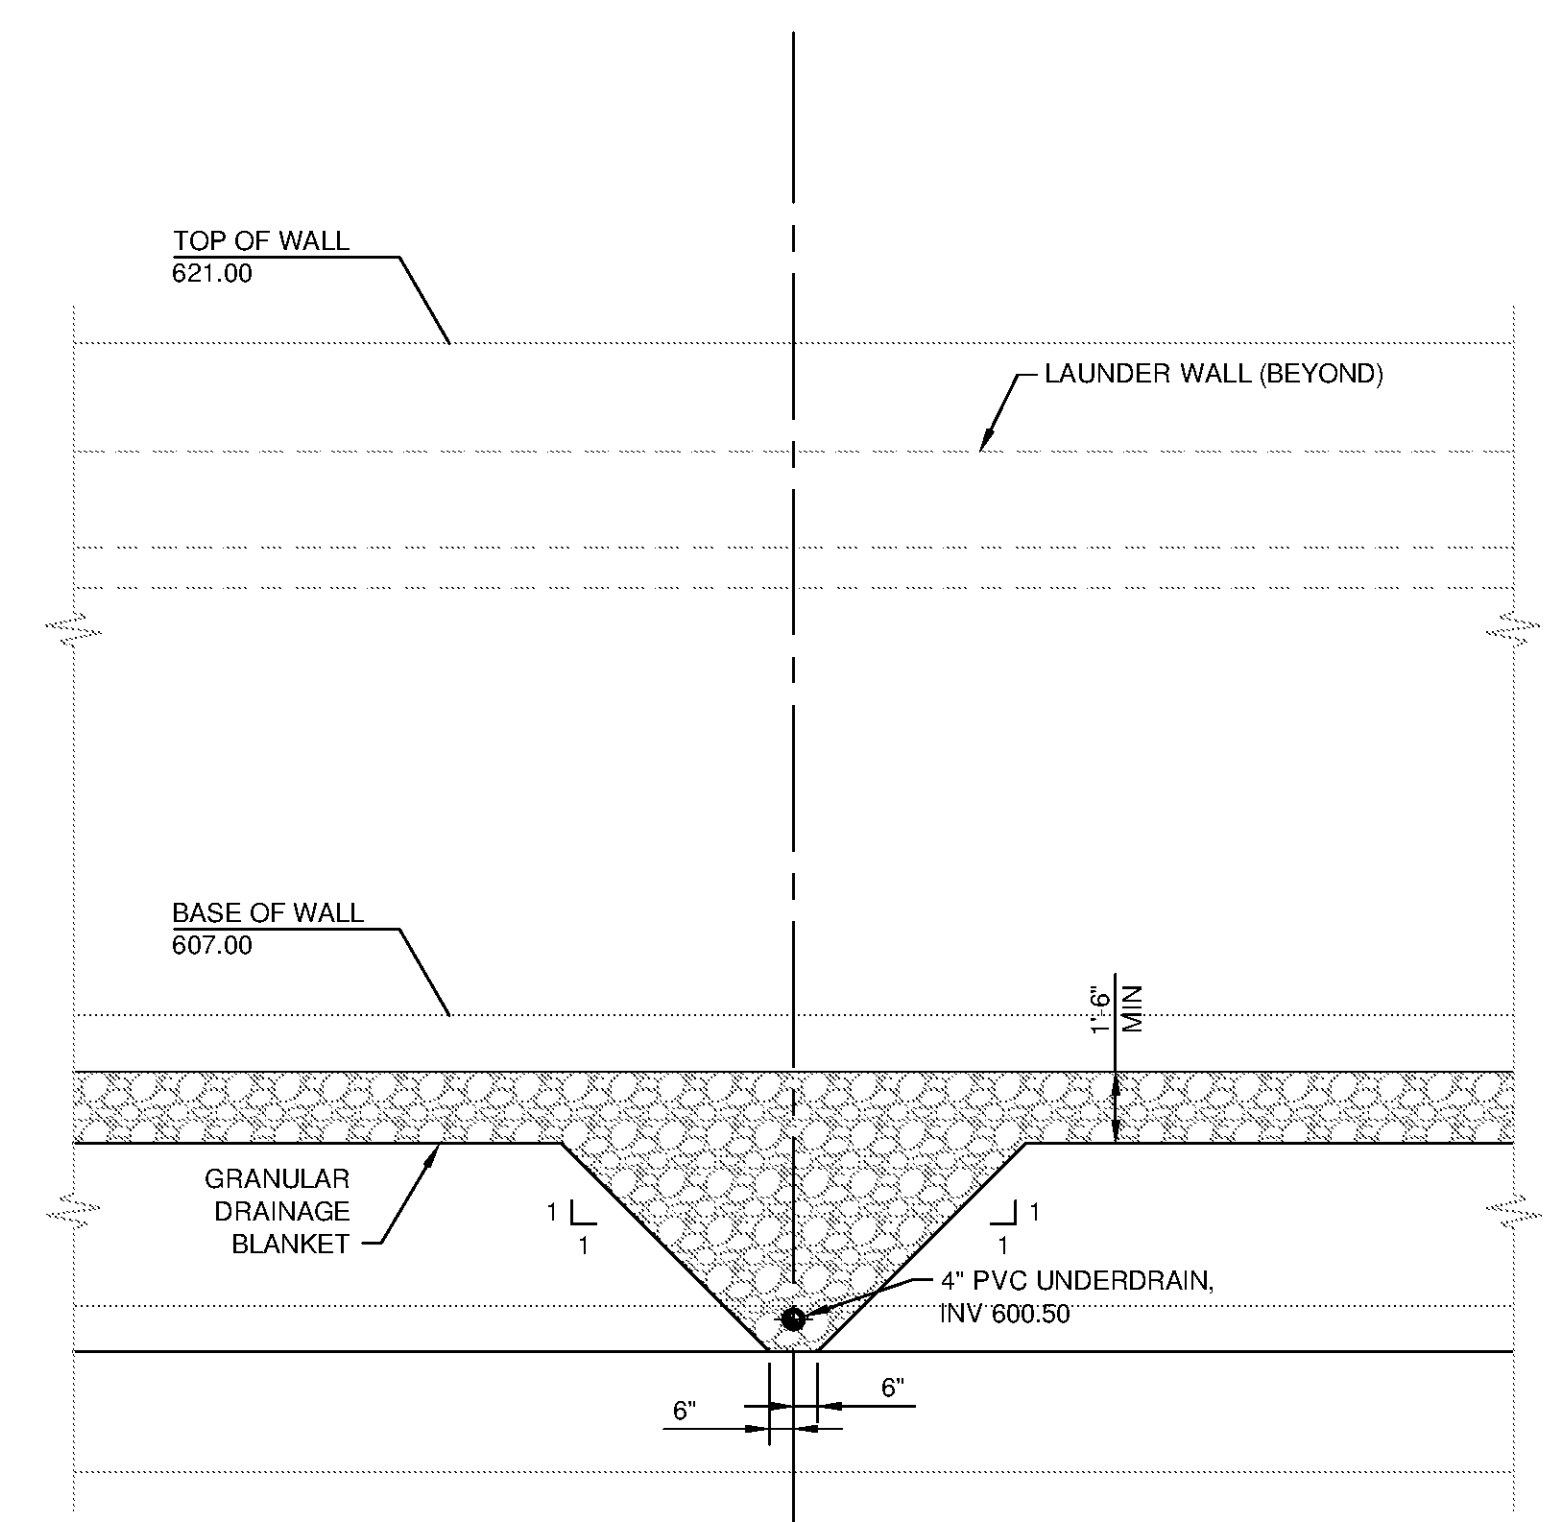

SECTION A
D-5101 SCALE: 1/4"=1'-0"

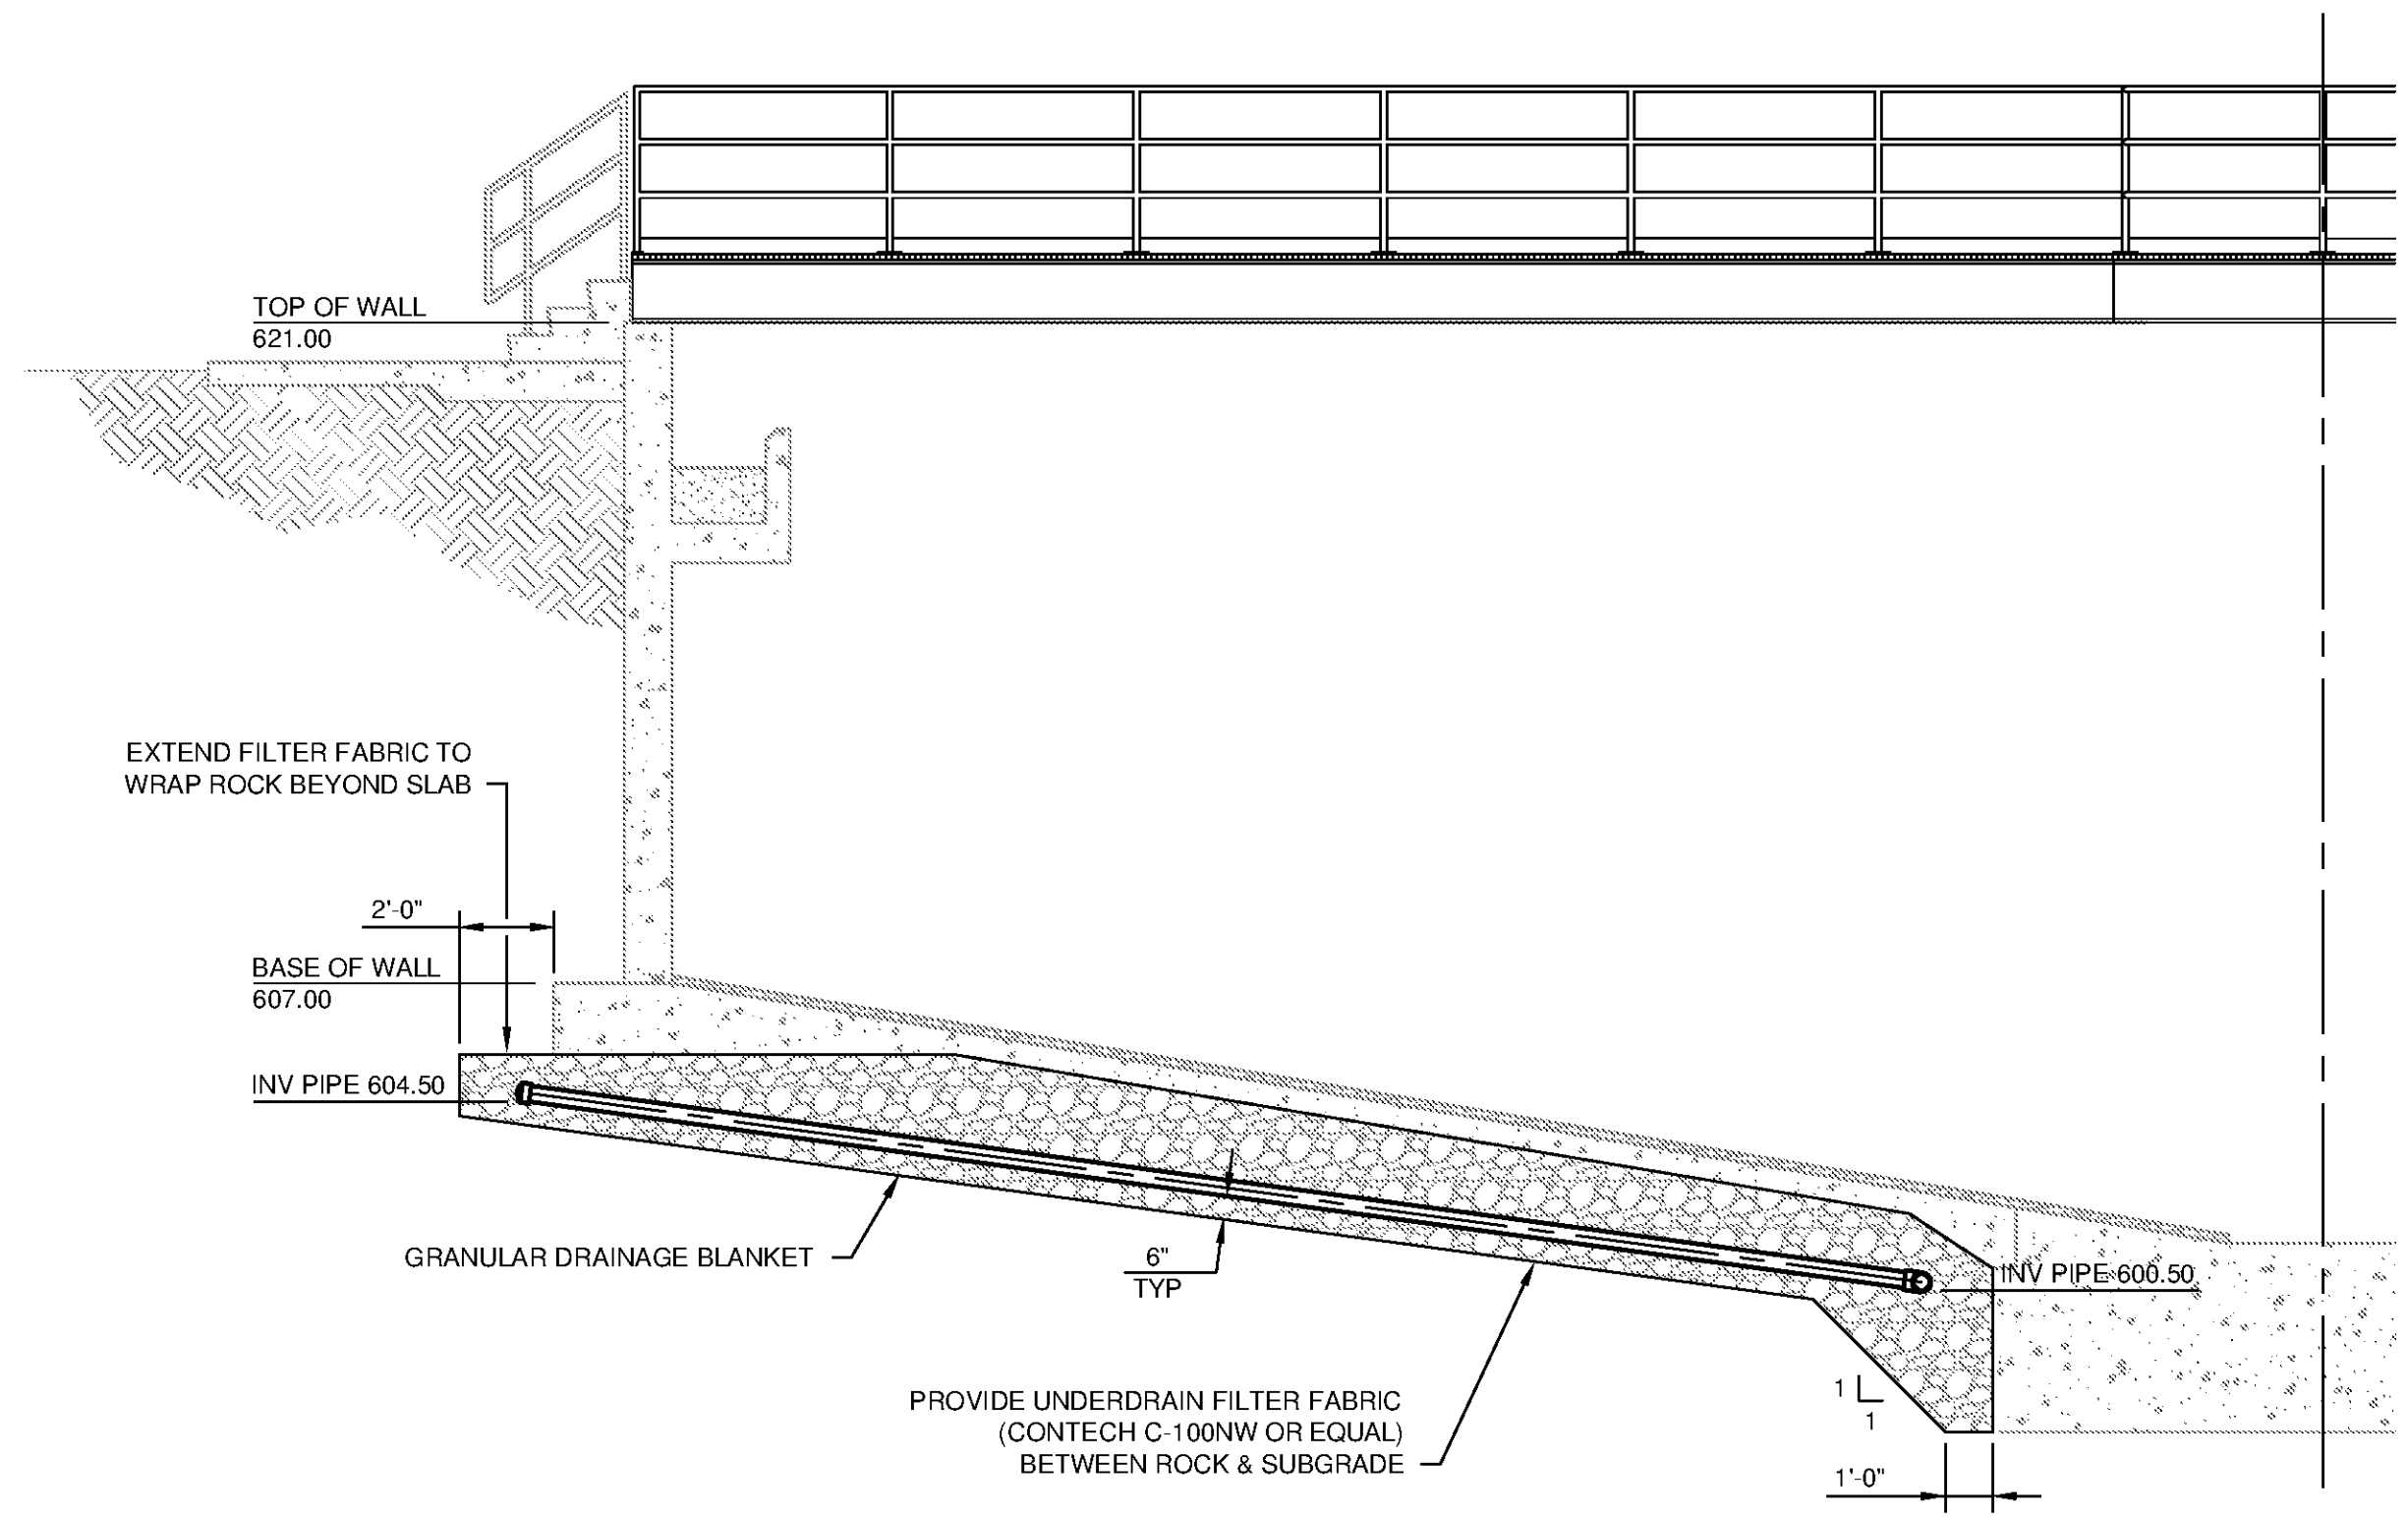

SECTION B
D-5101 SCALE: 1/4"=1'-0"

TETRA TECH
www.tetra-tech.com
101 QUALITY CIRCLE, SUITE 140
HUNTSVILLE, ALABAMA 35806
PHONE: (256) 424-4077 FAX: (256) 424-4097

BID SET
Professional Engineer
ALABAMA ENGINEERS & SURVEYORS
10/12/14

MARK	DATE	DESCRIPTION	BY

HUNTSVILLE UTILITIES
SOUTHEAST WATER TREATMENT PLANT
SLUDGE THICKENER
UNDERDRAIN SYSTEM

Project No.: 200-11740-10003
Designed By: JCB
Drawn By: JTE
Checked By: JPT

D-5101