



10/17/2014 3:48:57 PM P:\PIER\11740\200-11740-10003\CAD\SHEETFILES\TREATMENT PLANT\WTP-D-6103 SLUDGE FILTRATE PUMP STATION PLAN AND SECTIONS.DWG EVANS, JON

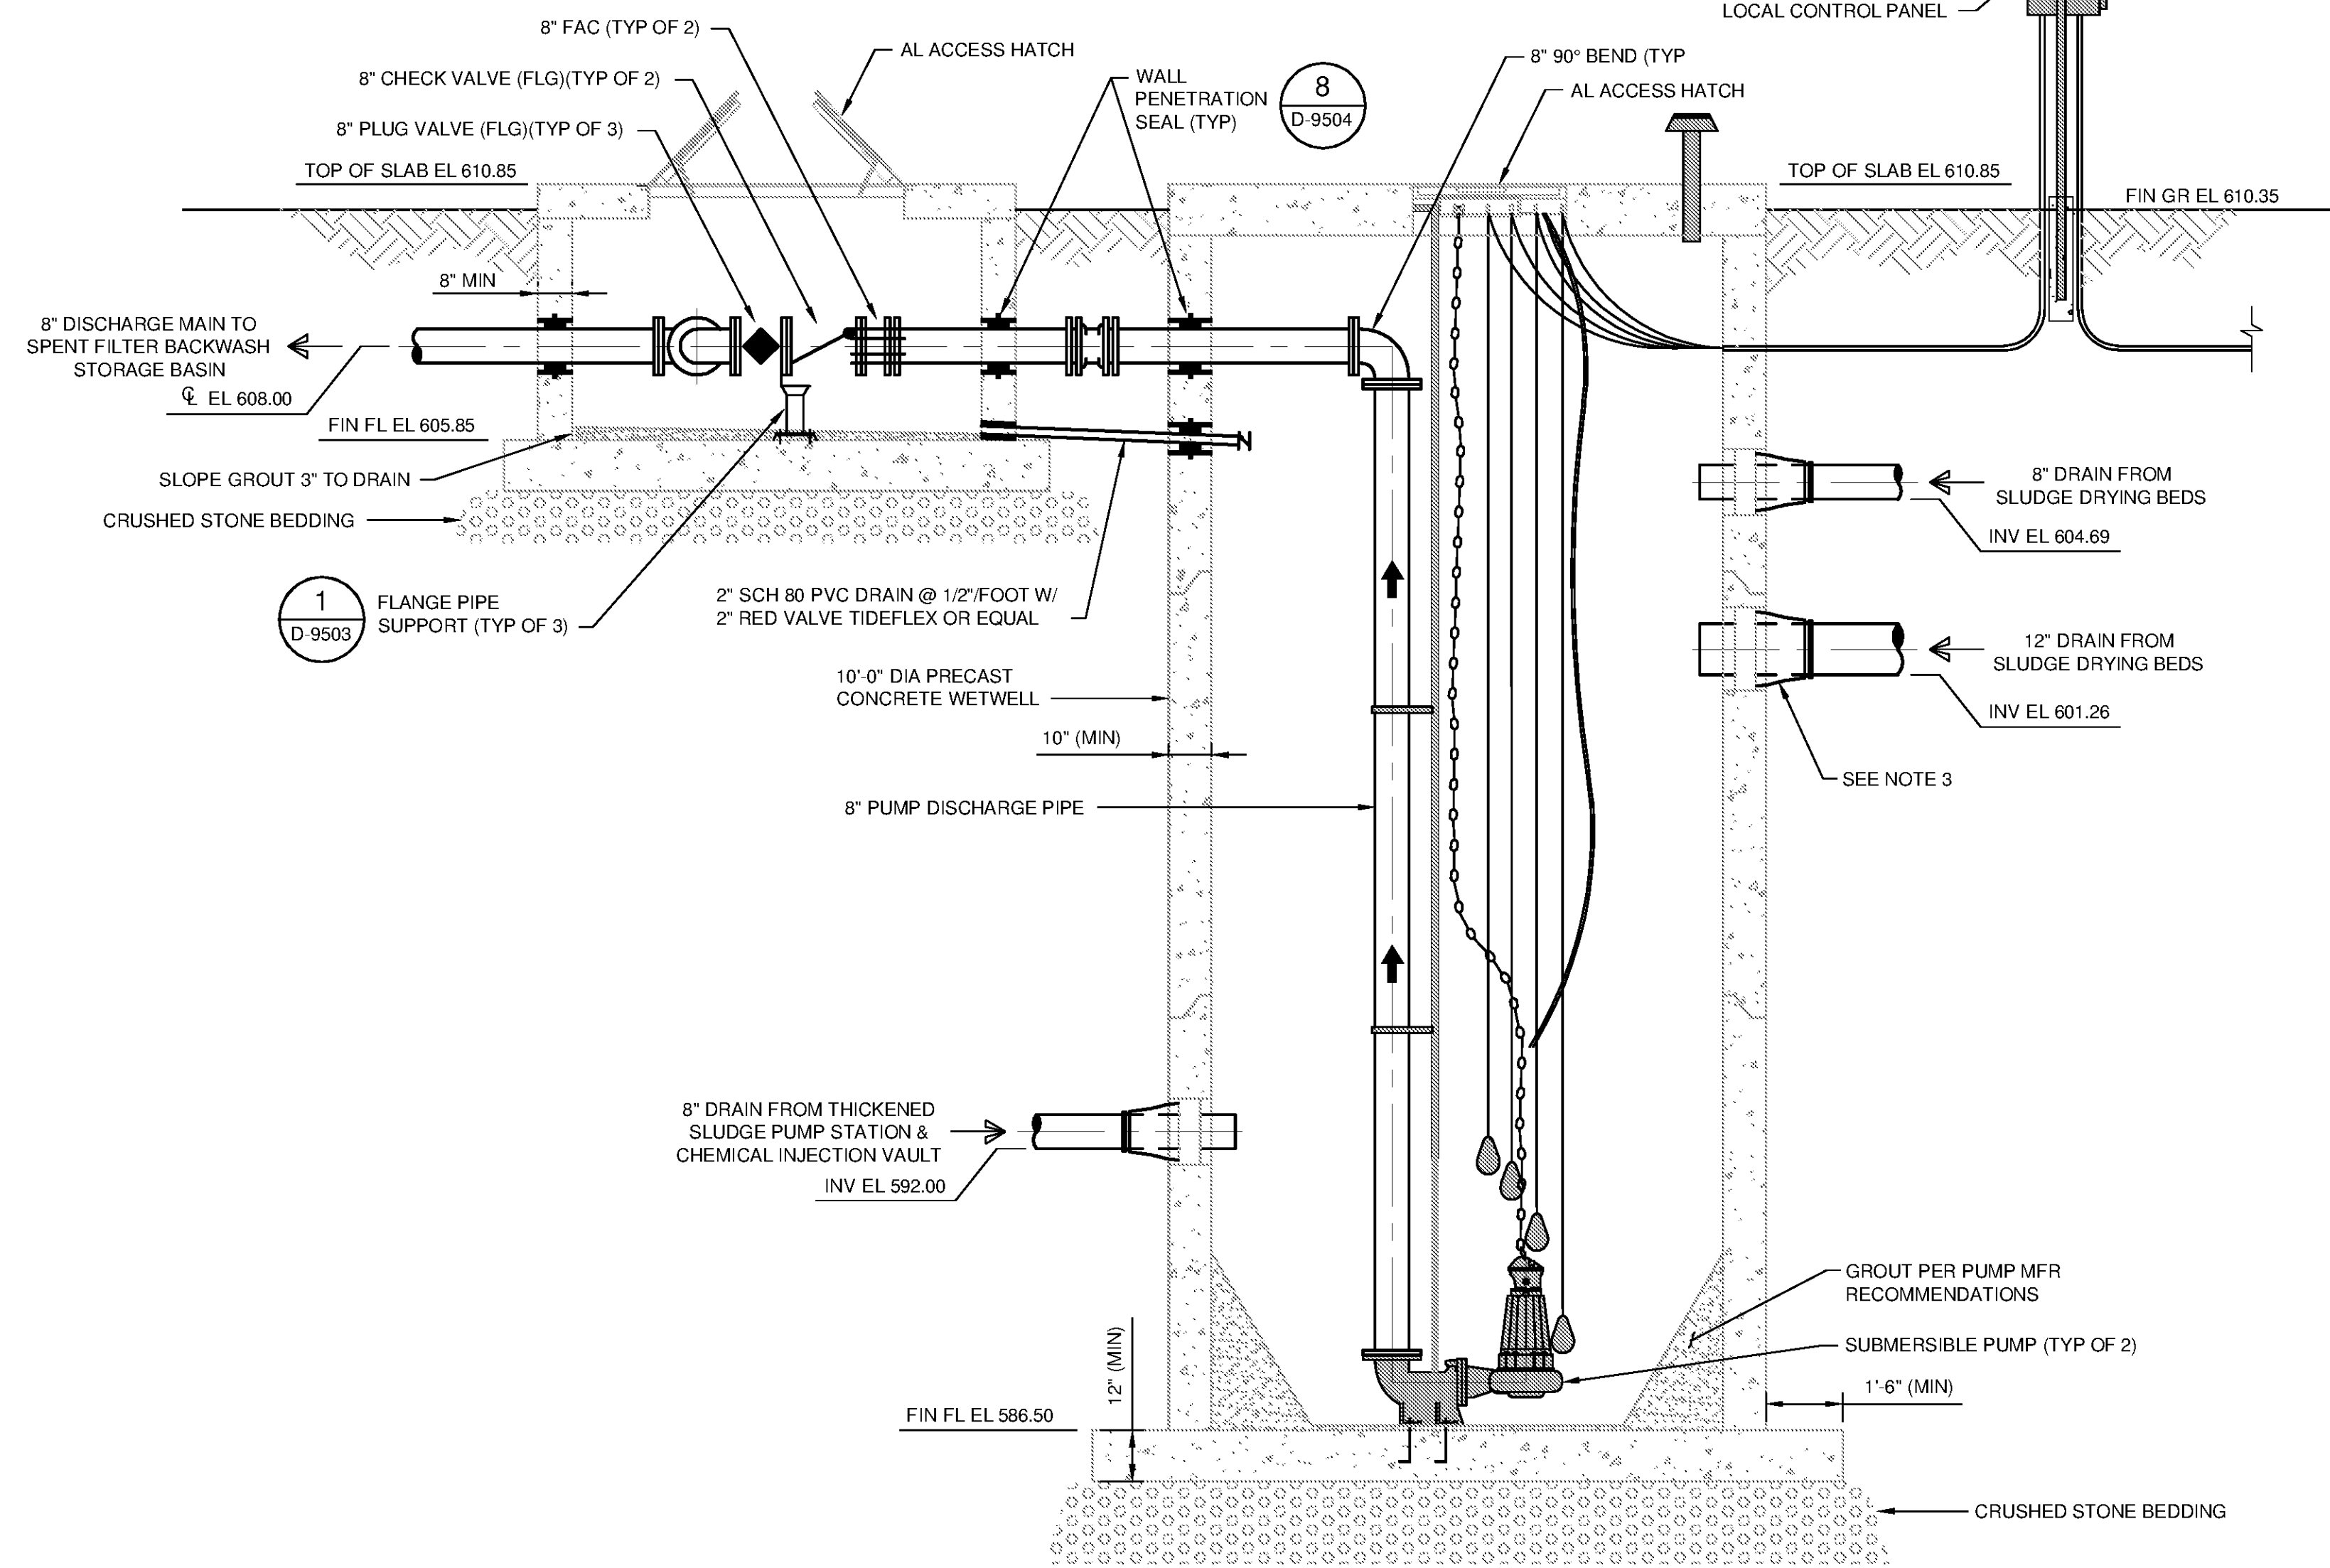

**NOTES:**

1. VERIFY PUMP SPACING & HATCH SIZES W/ PUMP MFR.
2. WET WELL, TOP SLAB & VALVE VAULT SHALL BE OF PRECAST CONCRETE.
3. WET WELL WALL PENETRATIONS FOR INFLUENT LINES SHALL BE INSTALLED WITH KOR-N SEAL CONNECTORS OR EQUAL.
4. WET WELL & VALVE VAULT WALL PENETRATIONS FOR DISCHARGE PIPING & DRAIN SHALL BE INSTALLED W/ COMPRESSION TYPE WALL SEALS.
5. DRAIN PIPING ROTATED FOR CLARITY.
6. FLOAT ELEVATIONS:  
PUMPS OFF = 588.00  
LEAD PUMP ON = 590.50  
LAG PUMP ON = 591.00  
ALARM = 591.50

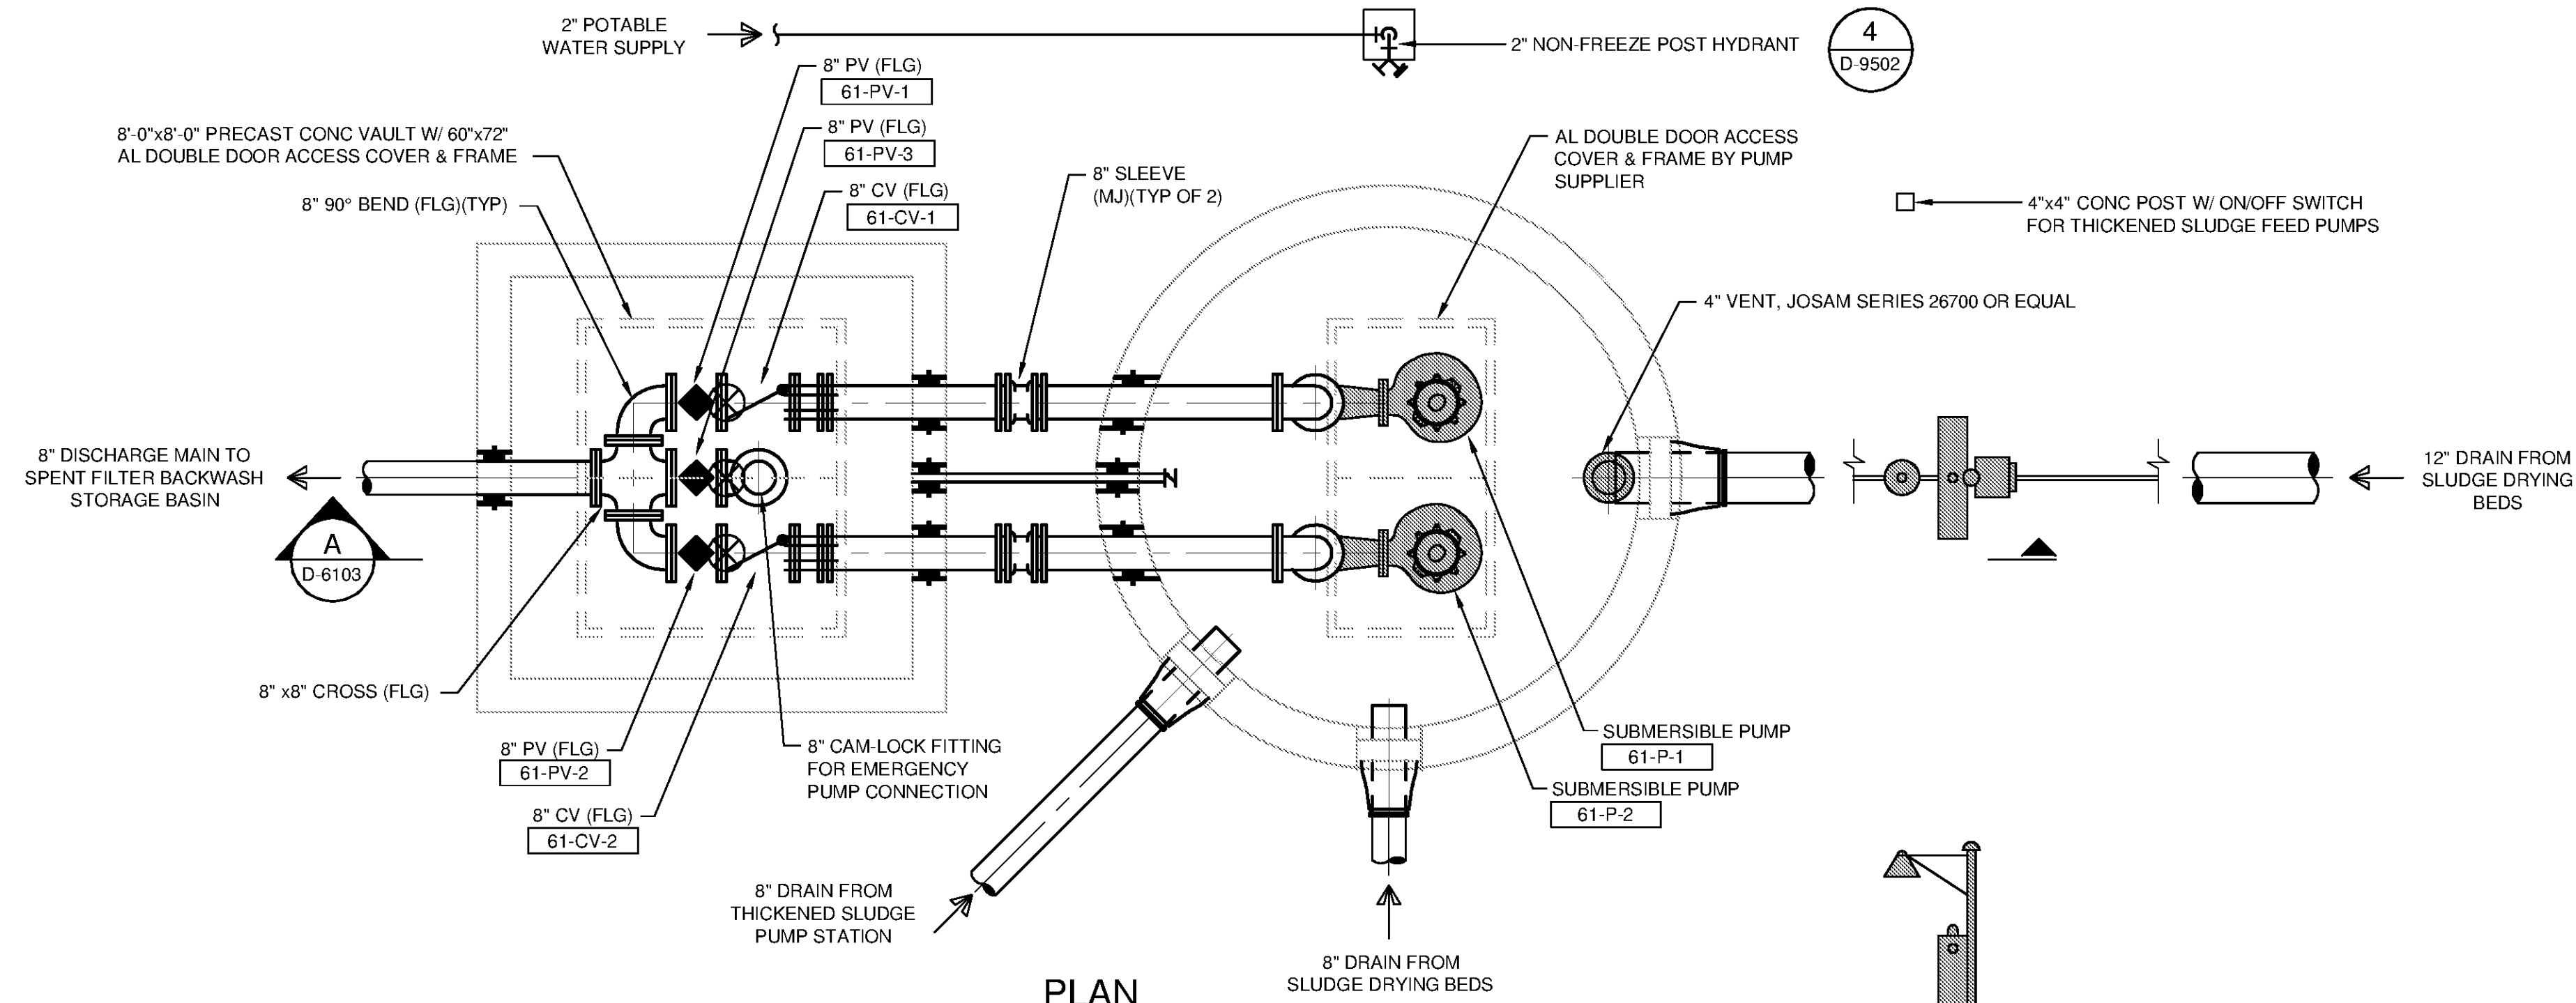

www.tetratech.com  
101 QUALITY CIRCLE, SUITE 140  
HUNTSVILLE, ALABAMA 35806  
PHONE: (256) 424-4077 FAX: (256) 424-4097

BID SET



MARK	DATE	DESCRIPTION

HUNTSVILLE UTILITIES  
SOUTHEAST WATER TREATMENT PLANT  
**SLUDGE FILTRATE PUMP STATION PLAN & SECTION**

Project No.: 200-11740-10003  
Designed By: SGN  
Drawn By: SGN  
Checked By: JPT

**D-6103**