



10/17/2014 3:49:21 PM P:\IER\11740\200-11740-10003\CAD\SHEET\FILESTREATMENT PLANT\WTP-D-7101 WASHWATER UNDERDRAIN SYSTEM.DWG - EVANS, JON

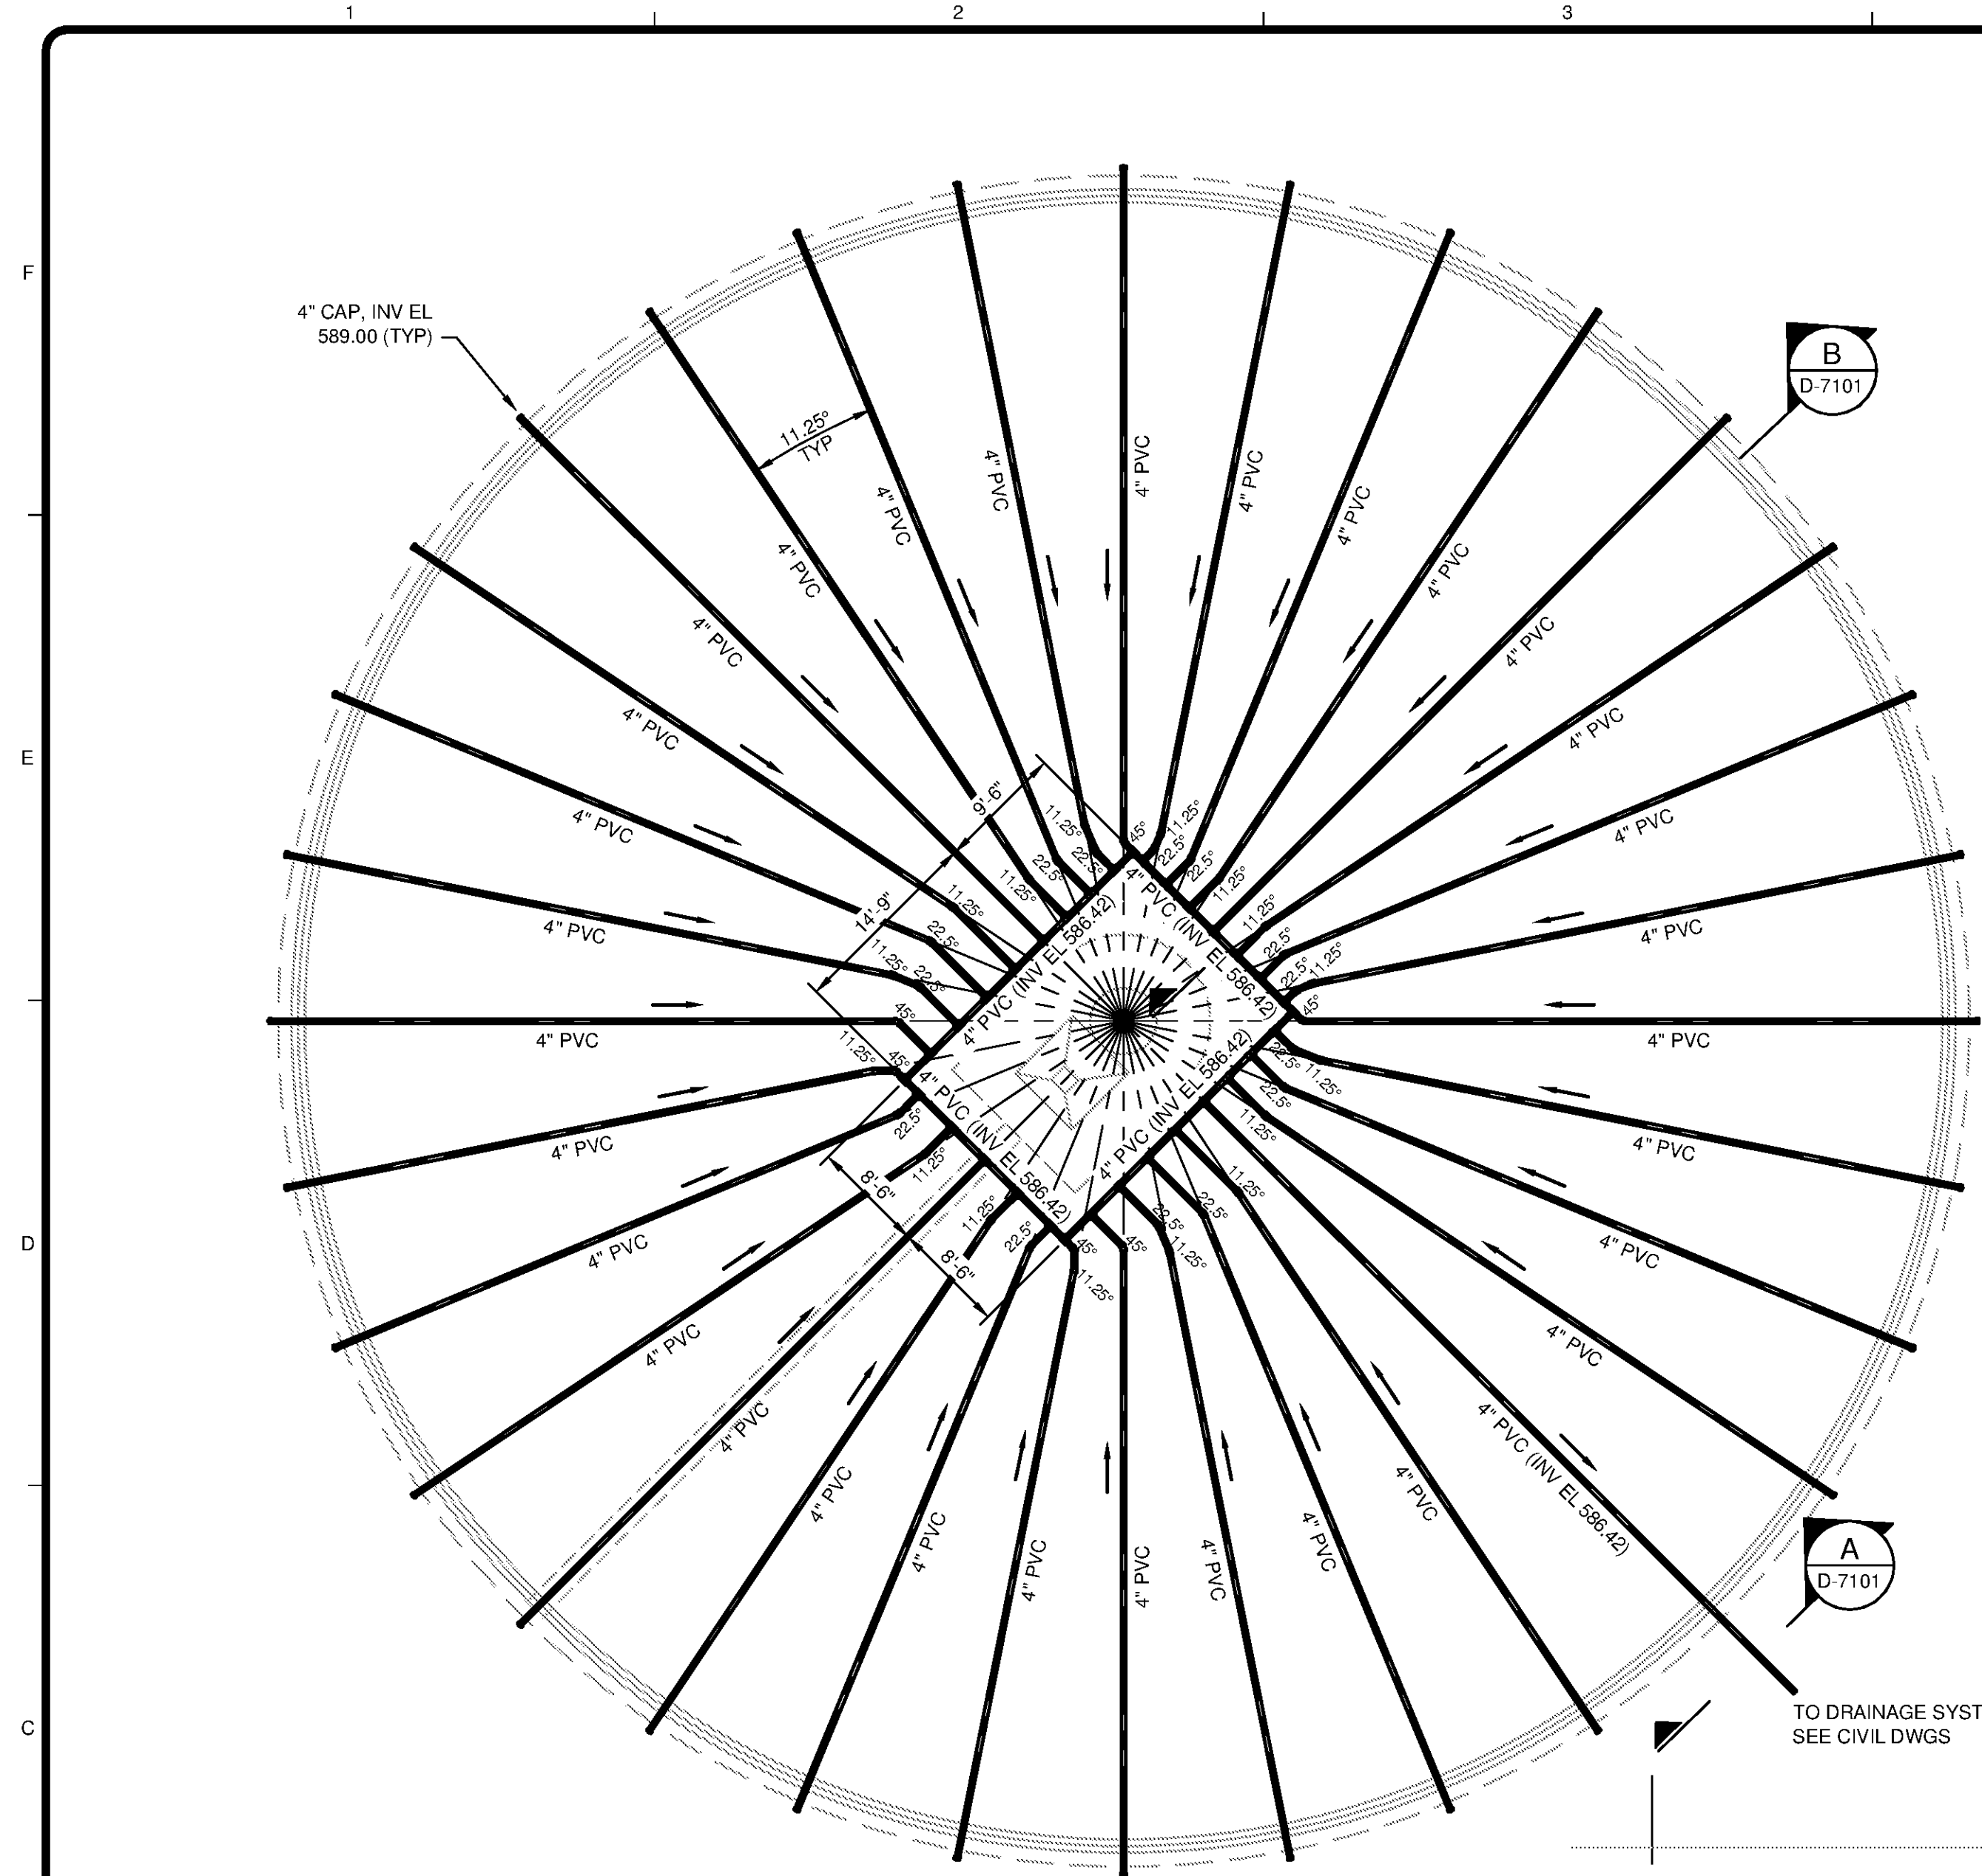


NOTE:
 PIPE UNDER SLAB SHALL BE 4" PERFORATED SCHEDULE
 80 PVC UNDERDRAIN PIPE. PIPE BEYOND SLAB SHALL BE
 STANDARD SCHEDULE 80 PVC PIPE.


PLAN
 SCALE: 3/32"=1'-0"

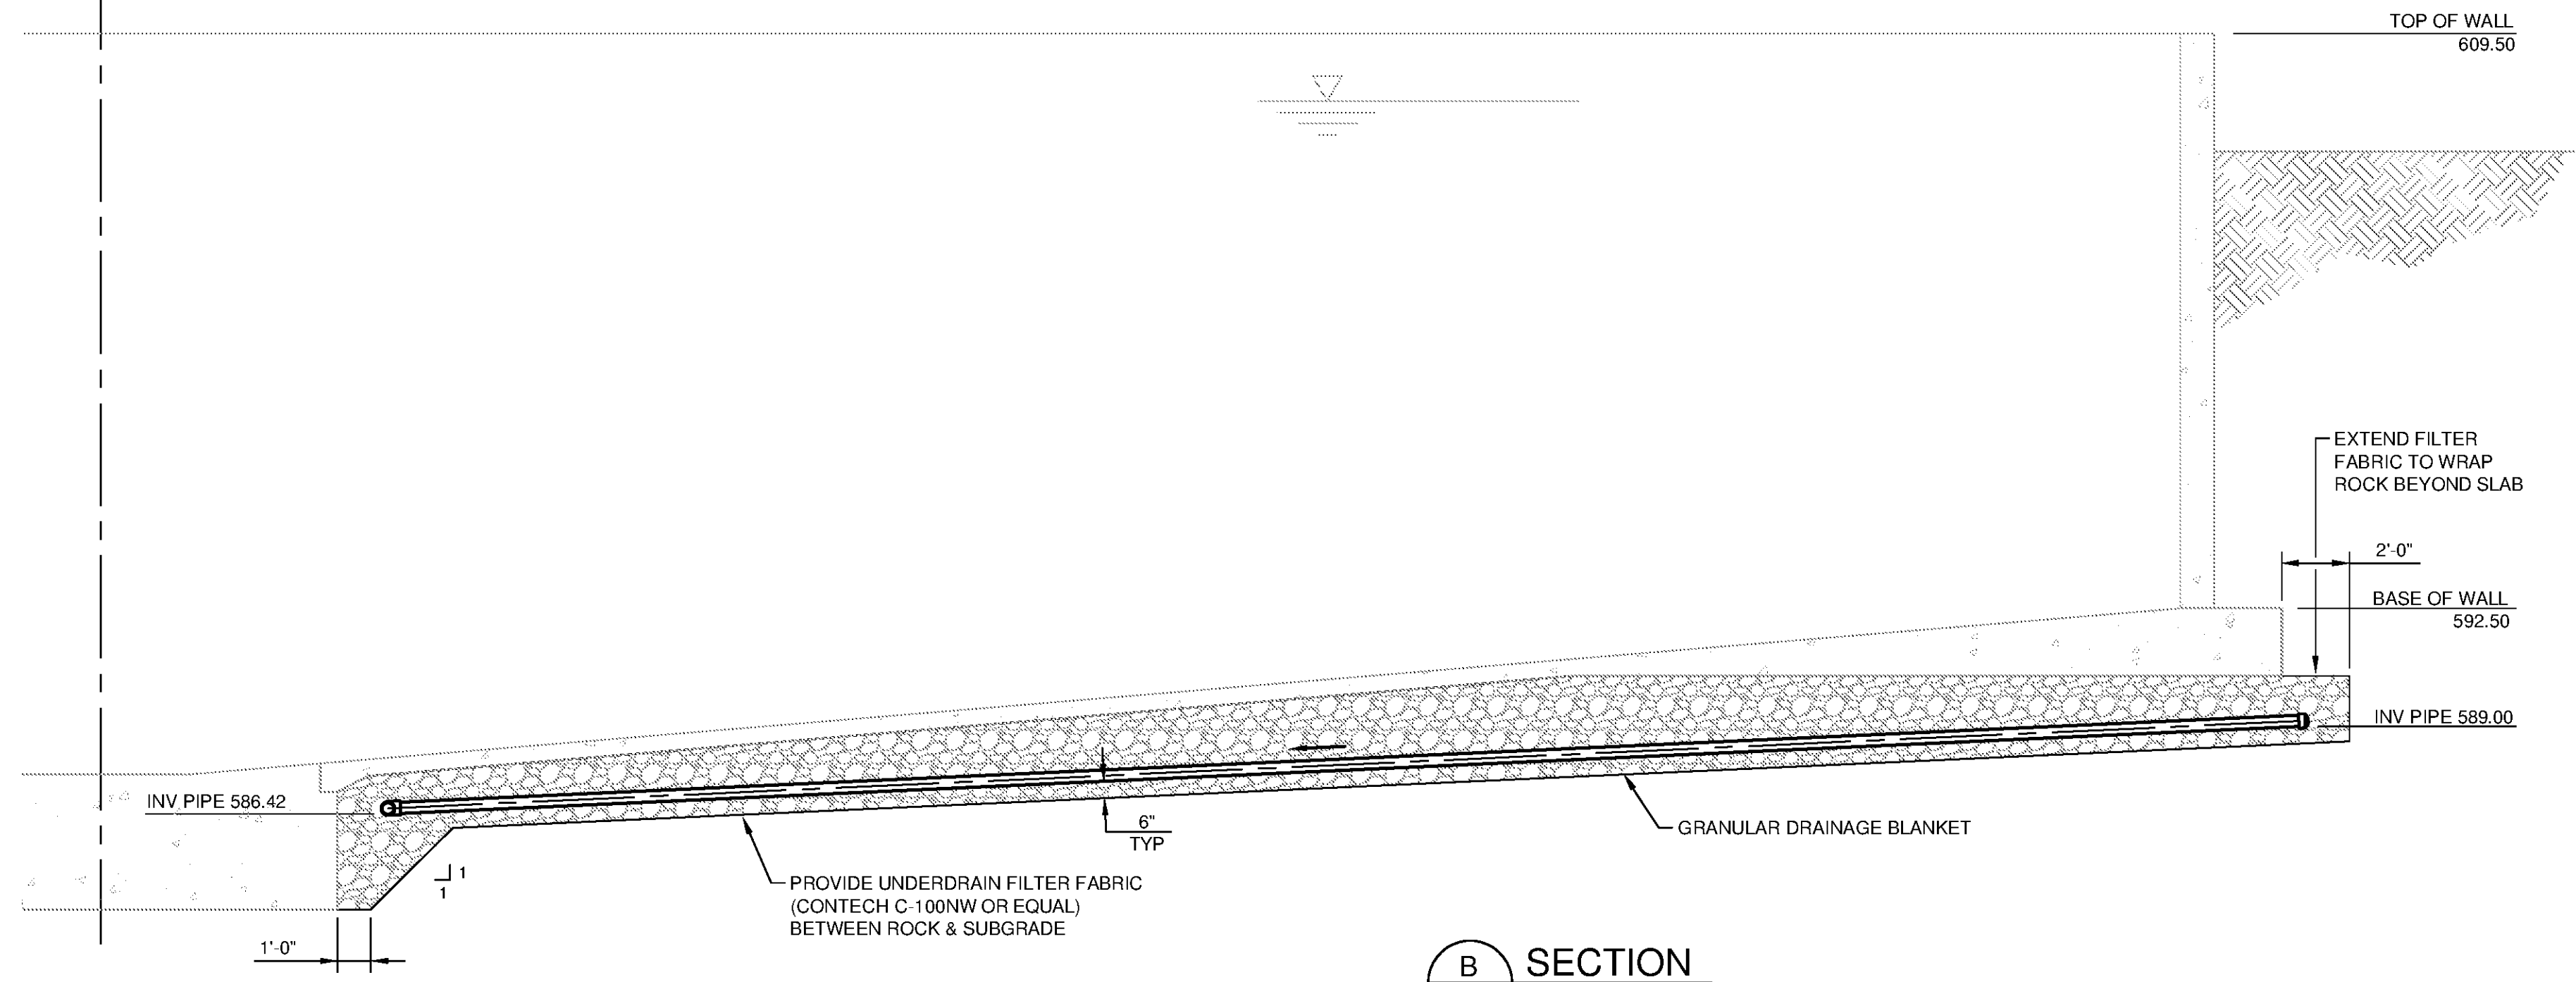

A SECTION
 D-7101 SCALE: 1/4"=1'-0"

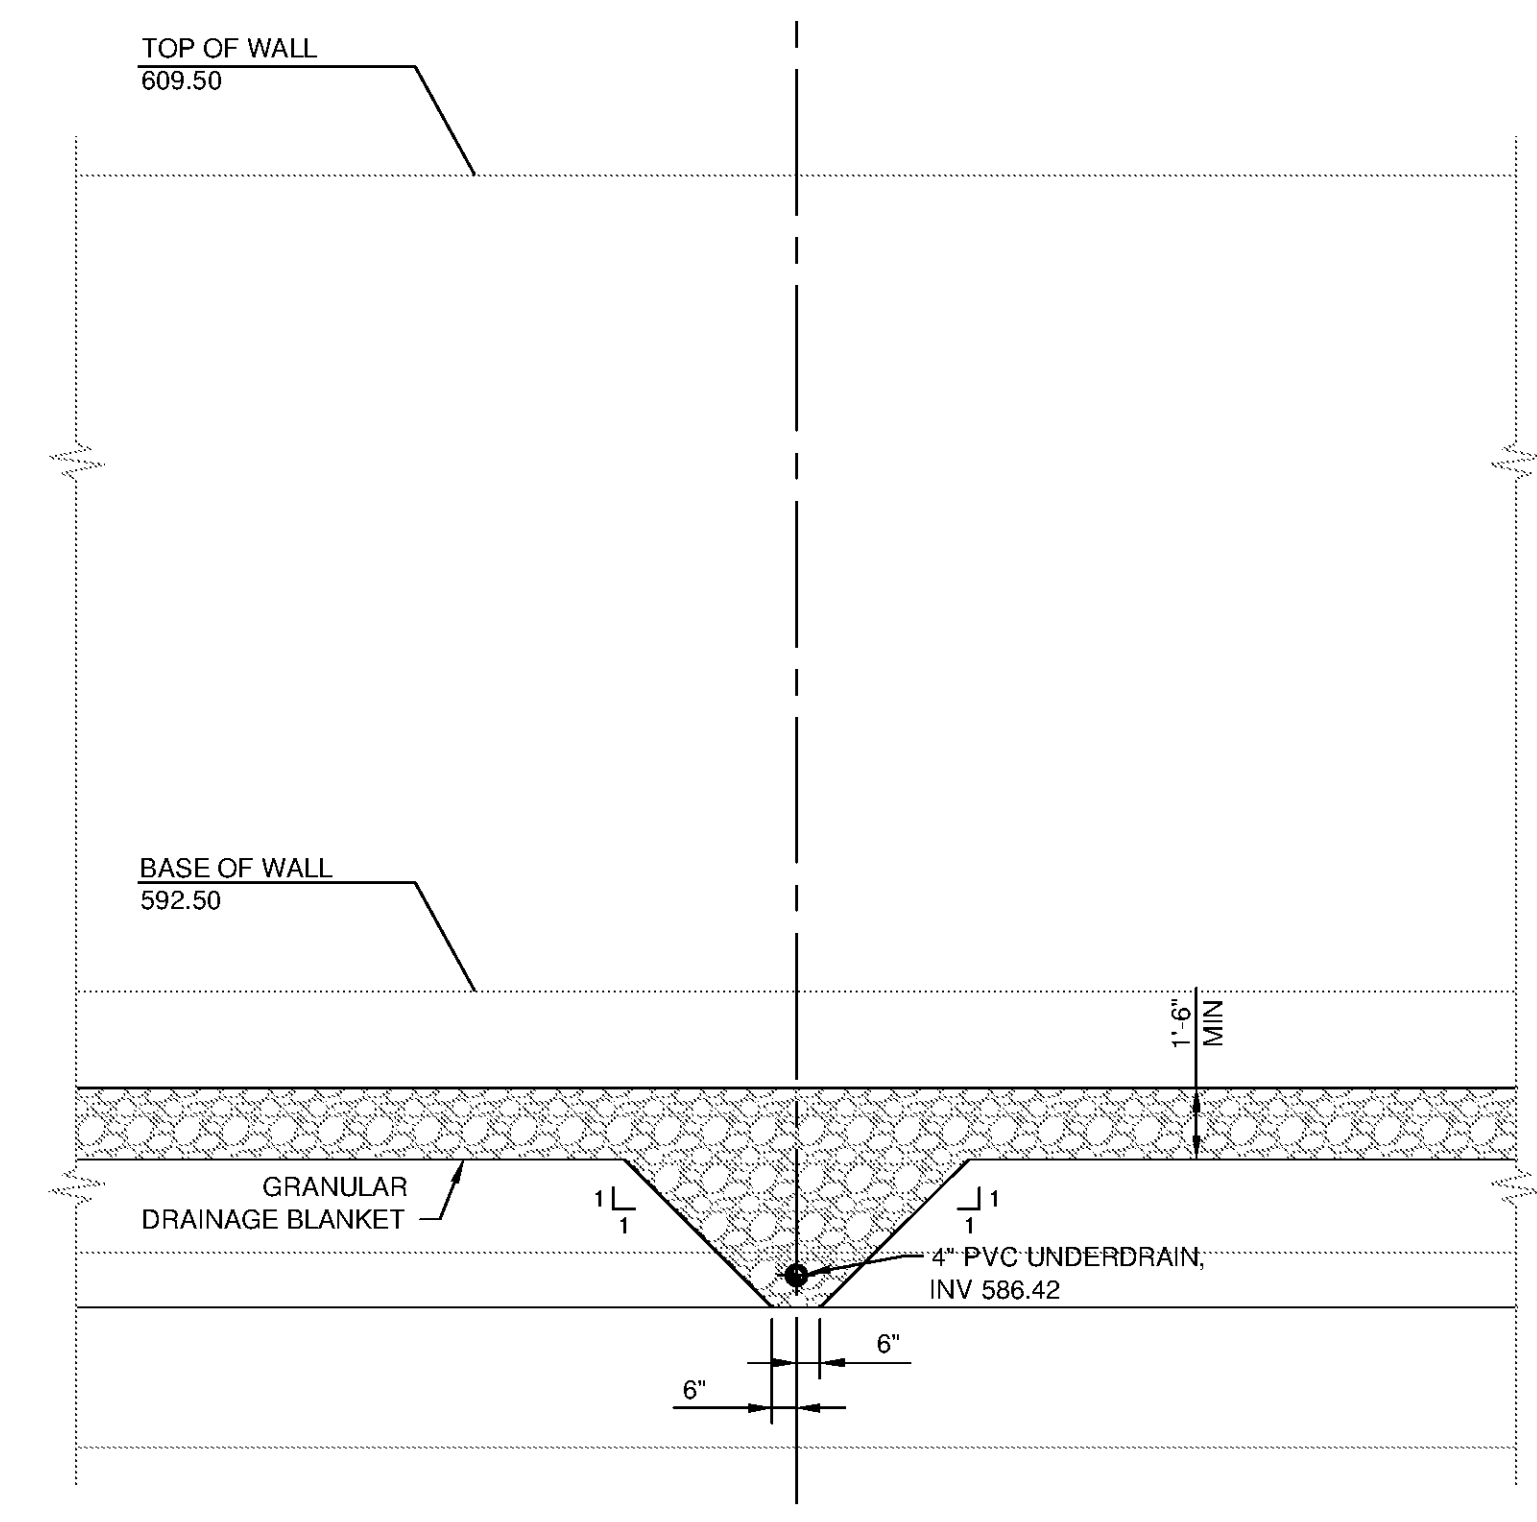

B SECTION
 D-7101 SCALE: 1/4"=1'-0"

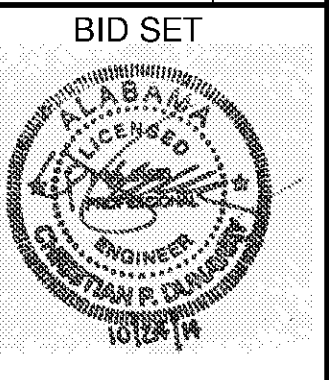

BID SET

BY	DATE	DESCRIPTION

MARK	DATE	DESCRIPTION

HUNTSVILLE UTILITIES
 SOUTHEAST WATER TREATMENT PLANT
**WASHWATER RECOVERY
 BASIN
 UNDERDRAIN SYSTEM**

Project No.: 200-11740-10003
 Designed By: JPT
 Drawn By: JTE
 Checked By: JPT

D-7101

Bar Measures 1 inch

Copyright Tetra Tech