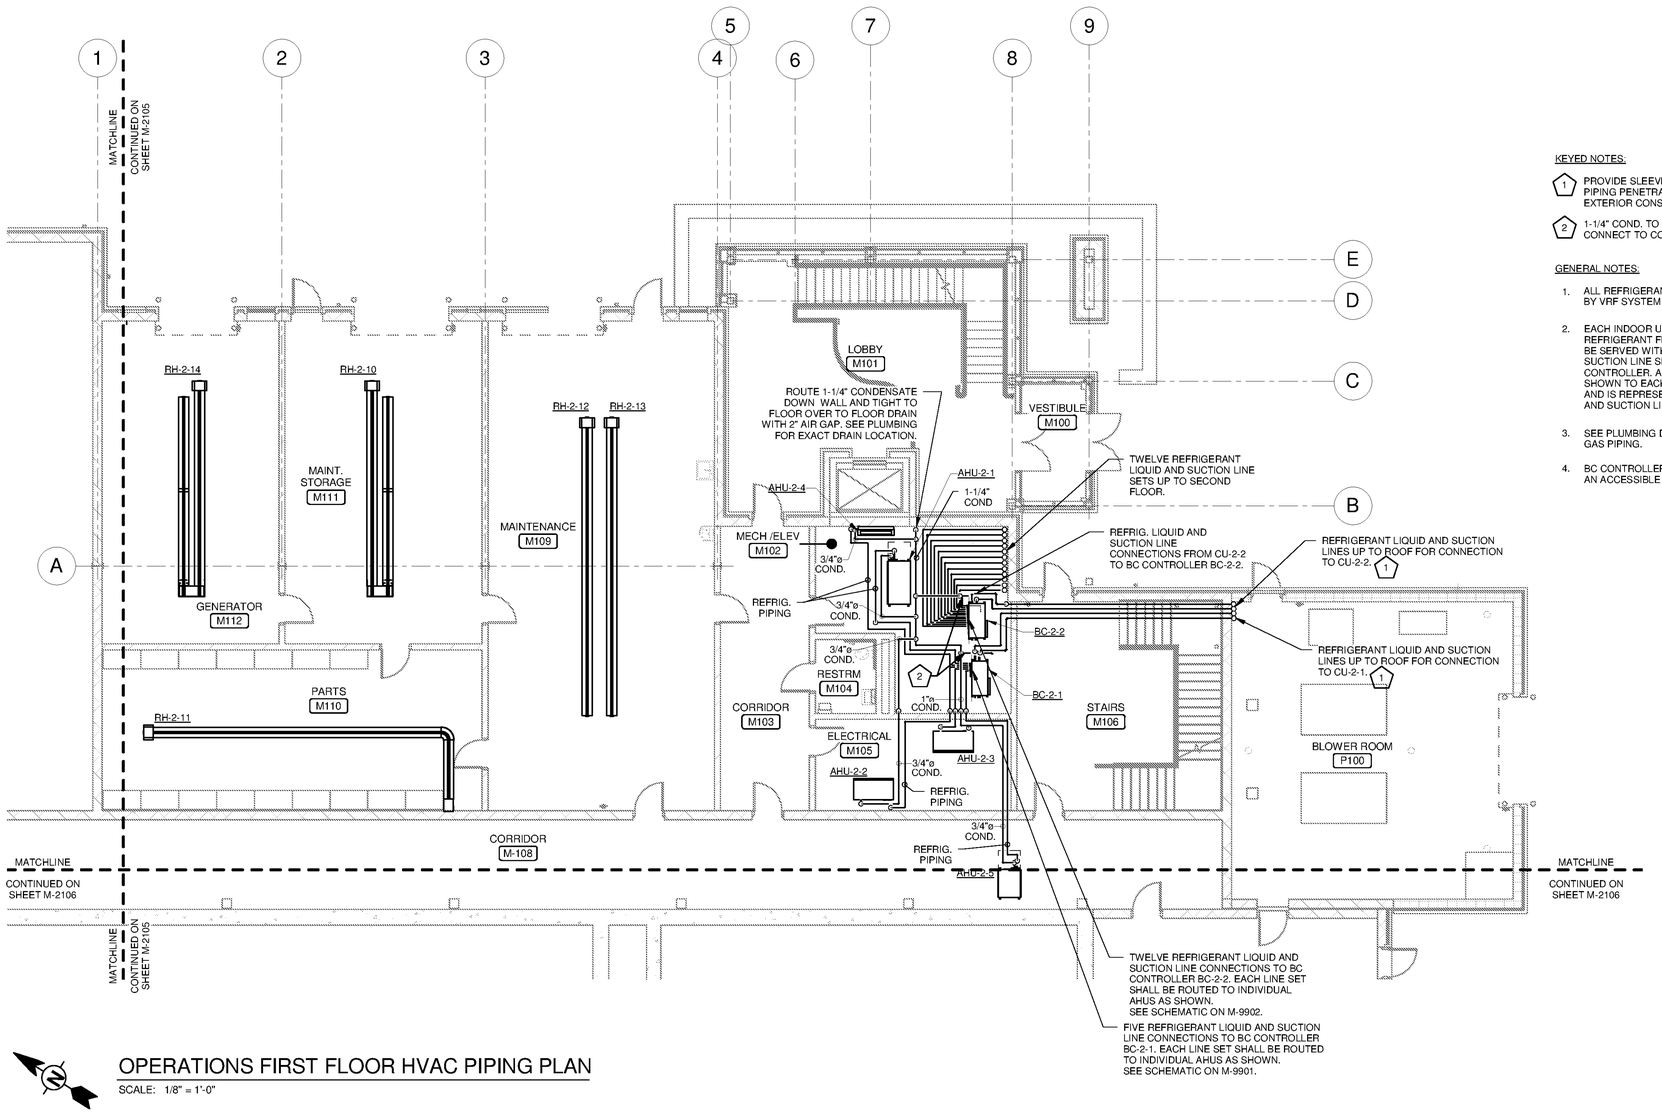

OPERATIONS FIRST FLOOR HVAC PIPING PLAN

SCALE: 1/8" = 1'-0"

KEYED NOTES:

1. PROVIDE SLEEVE FOR REFRIGERANT PIPING PENETRATION THROUGH EXTERIOR CONSTRUCTION.
2. 1-1/4" COND. TO BC CONTROLLER. CONNECT TO CONDENSATE MAIN.

GENERAL NOTES:

1. ALL REFRIGERANT PIPING SHALL BE SIZED BY VRF SYSTEM MANUFACTURER.
2. EACH INDOOR UNIT OF THE VARIABLE REFRIGERANT FLOW (VRF) SYSTEM WILL BE SERVED WITH INDIVIDUAL LIQUID AND SUCTION LINE SETS FROM THE BC CONTROLLER. A SINGLE PIPE LINE IS SHOWN TO EACH UNIT FOR CLARITY ONLY, AND IS REPRESENTATIVE OF BOTH LIQUID AND SUCTION LINES.
3. SEE PLUMBING DRAWINGS FOR NATURAL GAS PIPING.
4. BC CONTROLLERS SHALL BE MOUNTED IN AN ACCESSIBLE LOCATION.

0 4' 8' 16'

SCALE: 1/8" = 1'-0"

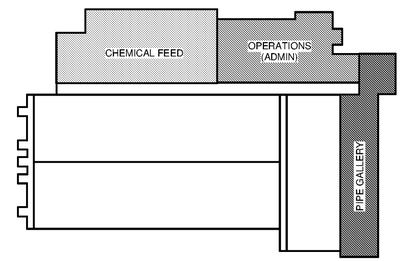

KEY PLAN

TETRA TECH
www.tetratech.com
101 QUALITY CIRCLE, SUITE 140
HUNTSVILLE, ALABAMA 35806
PHONE: (256) 424-4077 FAX: (256) 424-4097

BID SET

ALABAMA REGISTERED No. 16533 PROFESSIONAL ENGINEER DONALD S. BOGGS
10/24/2014

MARK	DATE	DESCRIPTION	BY

HUNTSVILLE UTILITIES

SOUTHEAST WATER TREATMENT PLANT

MAIN PROCESS BUILDING
OPERATIONS FIRST FLOOR
HVAC PIPING PLAN

Project No.:	200-11740-10003
Designed By:	SBR
Drawn By:	SBR
Checked By:	DSB

M-2103

Copyright: Tetra Tech

Bar Measures 1 inch

10/1/2014 5:29:05 PM C:\Users\madison.leffler\Documents\WTP-11740-M-MAINPR_madison.leffler.rvt