


10/17/2014 10:54:56 AM P:\SERV\1740\200-11740-10003\CAD\SHETS\FILES\TREATMENT PLANT\WTP E 0601 ELECTRICAL MEDIUM VOLTAGE NOTES.DWG - CALZARETTA, TIMOTHY

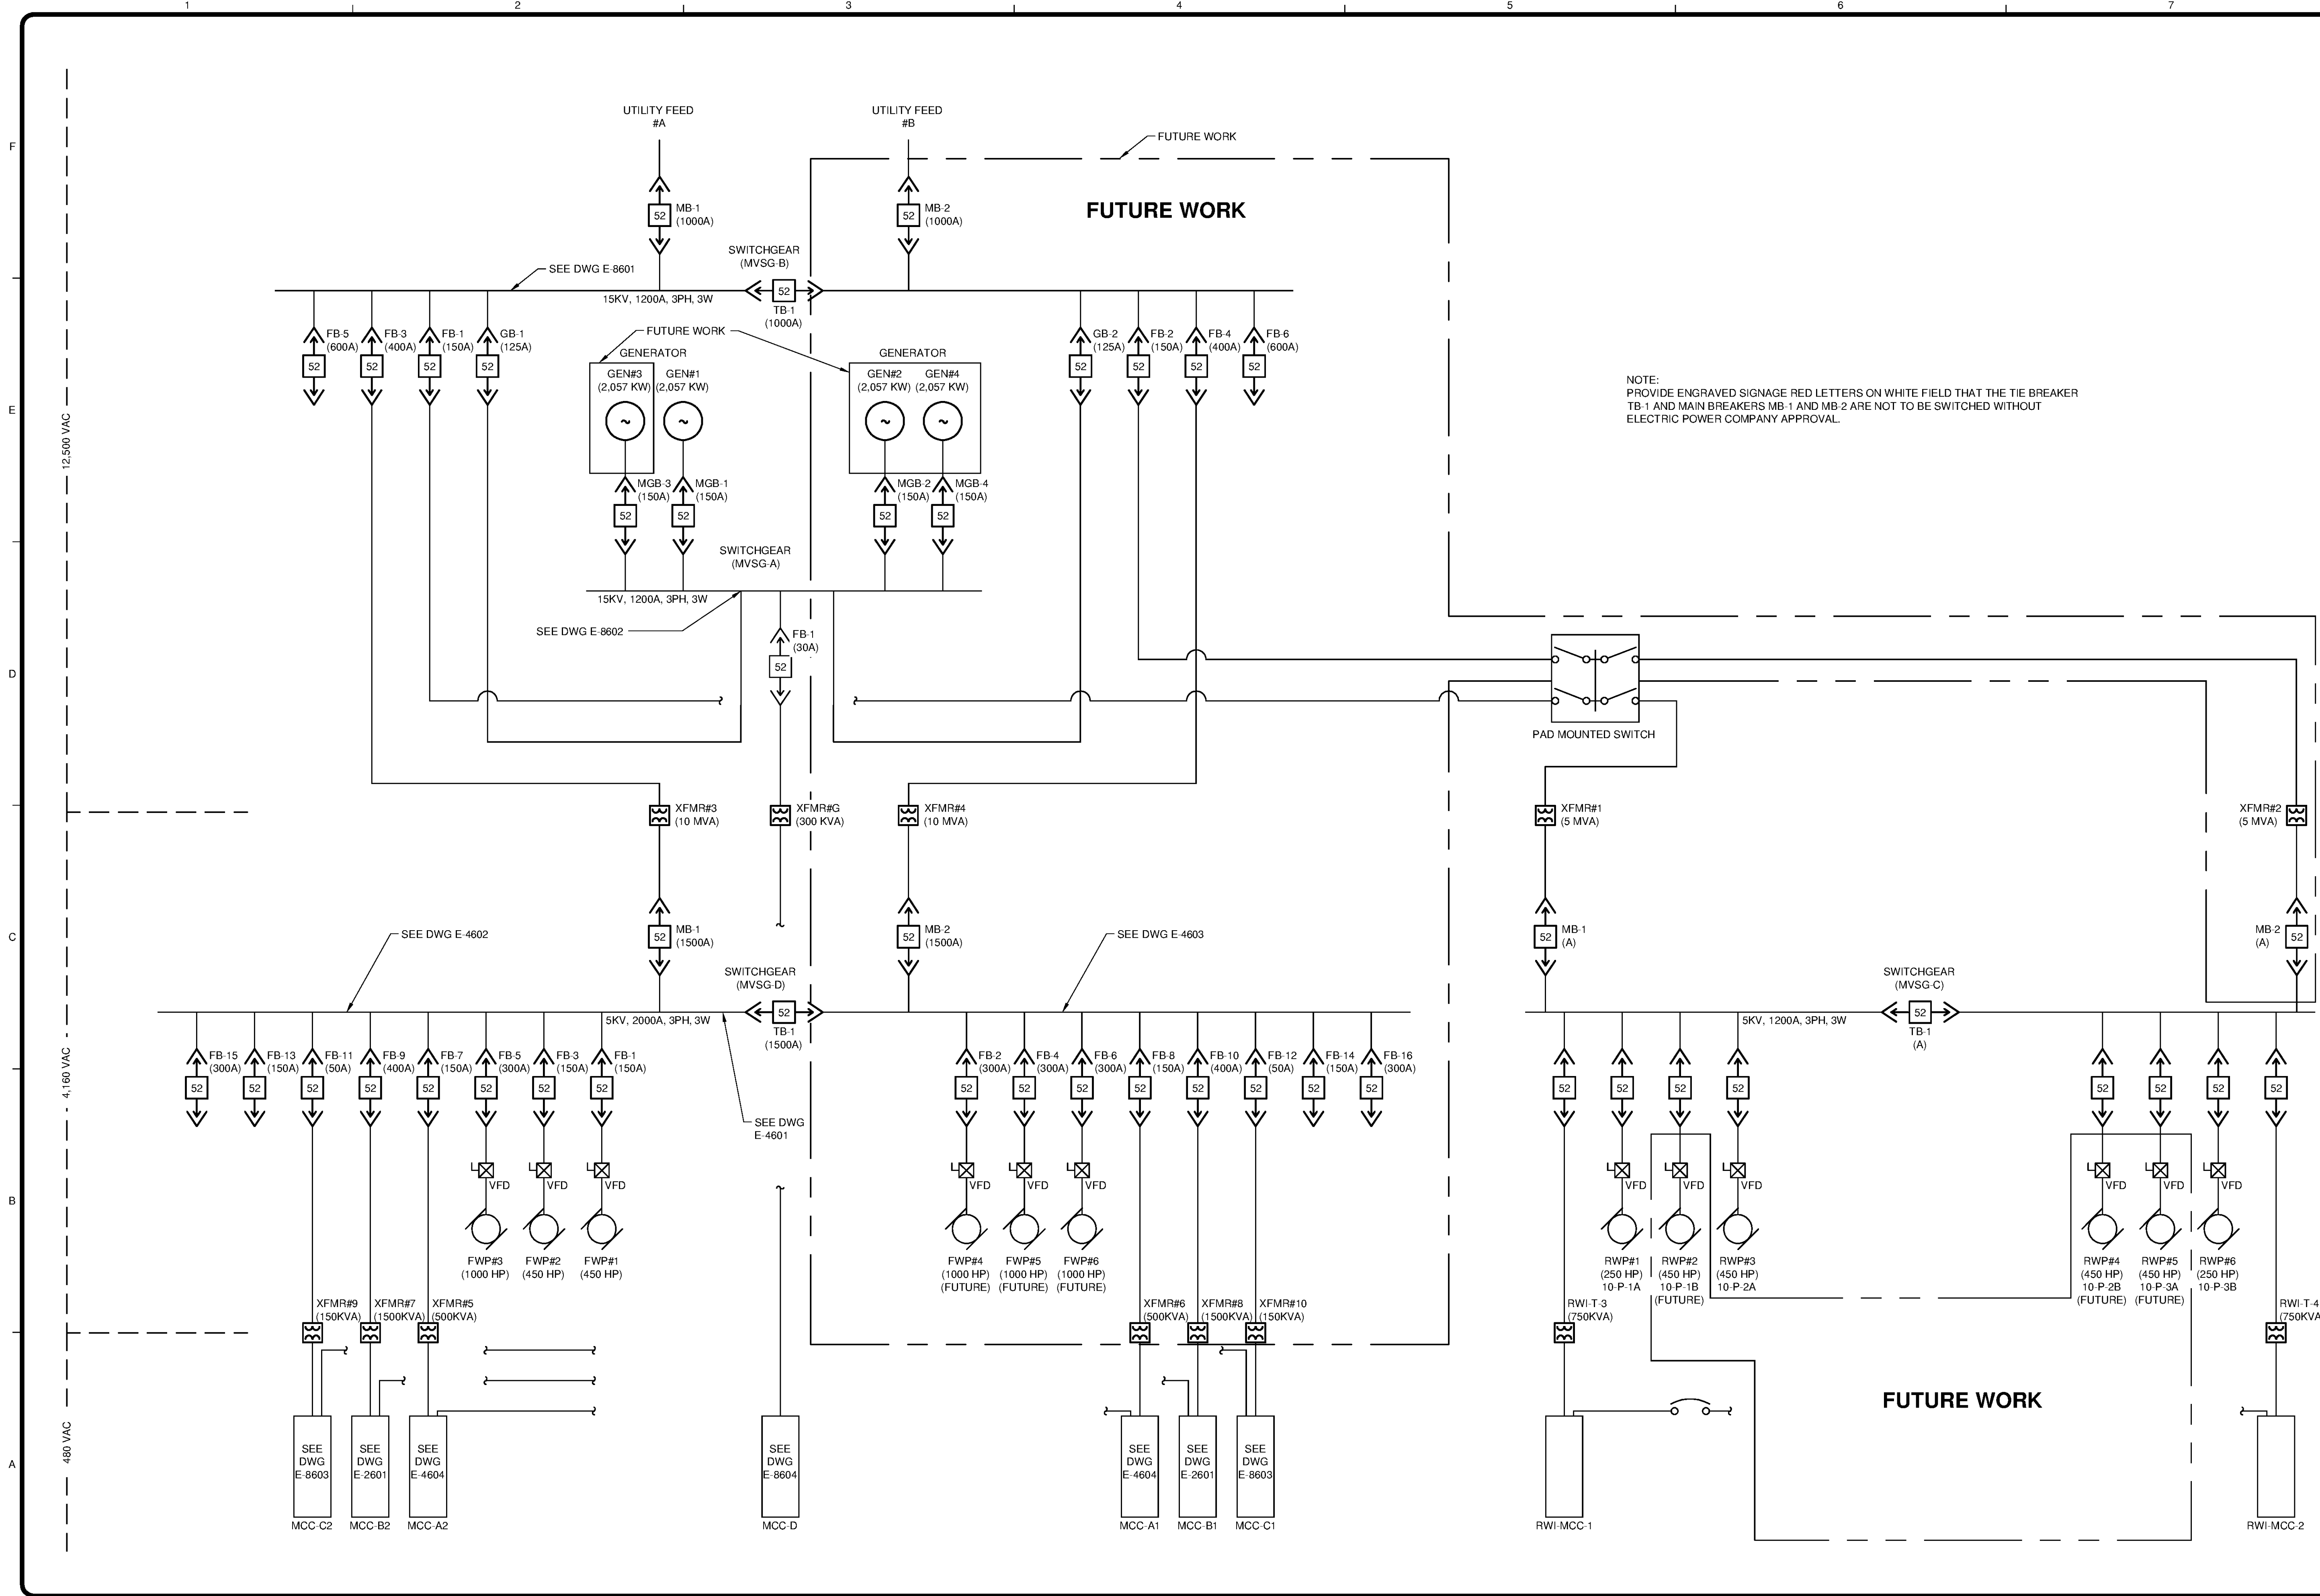

NOTE:  
 PROVIDE ENGRAVED SIGNAGE RED LETTERS ON WHITE FIELD THAT THE TIE BREAKER  
 TB-1 AND MAIN BREAKERS MB-1 AND MB-2 ARE NOT TO BE SWITCHED WITHOUT  
 ELECTRIC POWER COMPANY APPROVAL.

**TETRA TECH**  
 www.tetrattech.com  
 101 QUALITY CIRCLE, SUITE 140  
 HUNTSVILLE, ALABAMA 35806  
 PHONE: (256) 424-4077 FAX: (256) 424-4097

**BID SET**

MARK	DATE	DESCRIPTION

HUNTSVILLE UTILITIES  
 SOUTHEAST WATER TREATMENT PLANT  
**OVERALL PLANT  
 MEDIUM VOLTAGE ONE-LINE**

Project No.: 200-11740-10003  
 Designed By: CSW  
 Drawn By: CSW  
 Checked By: DAB

**E-0601**