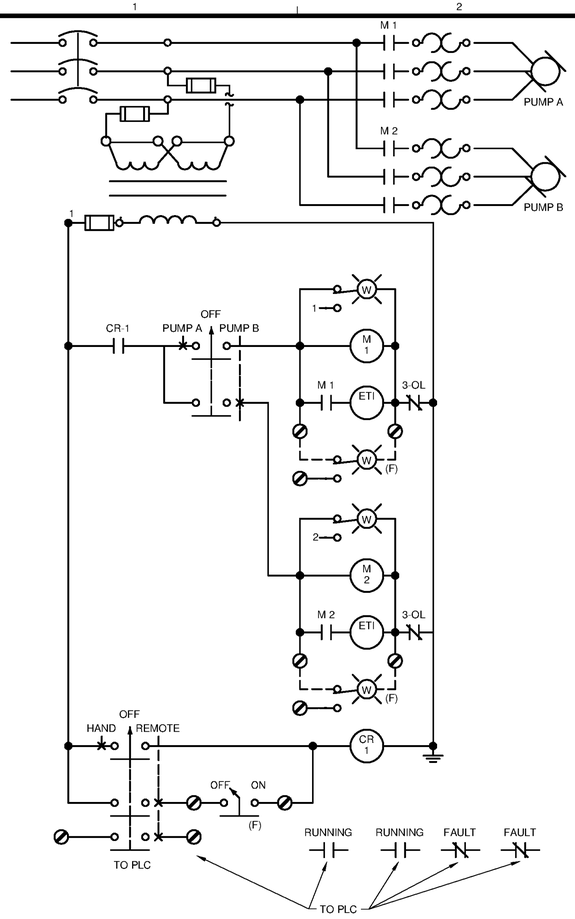

DUPLEX SAMPLE PUMP WIRING DIAGRAM

B2 7 · B1 7 · A2 13

SCALE: NA

NOTE:
1. B1-7 PUMP STARTER 3 NEMA 4X, STAINLESS STEEL ENCLOSURE



DUPLEX SAMPLE PUMP OPERATOR ELEMENTS

(LOCATED IN LAB RM, ADMIN BUILDING)

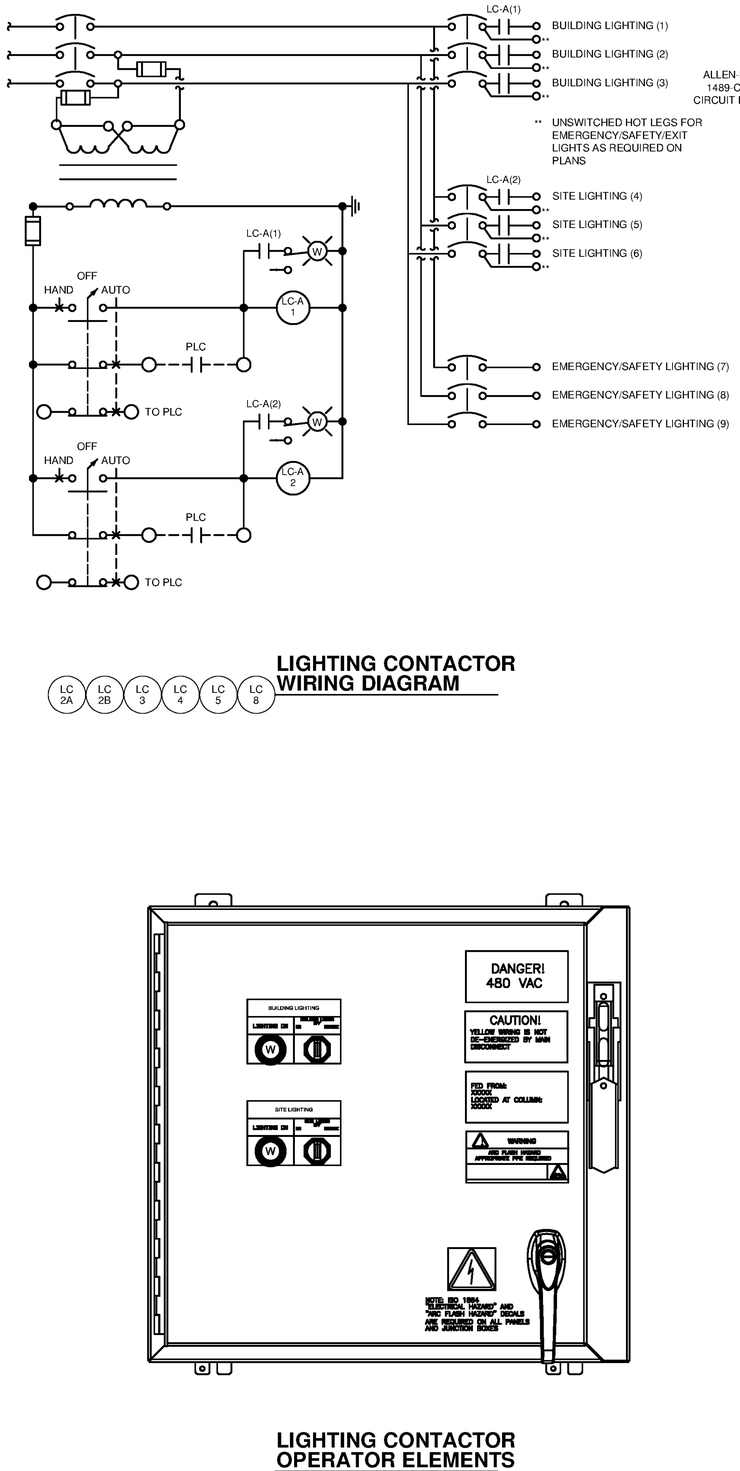

LC 2A · LC 2B · LC 3 · LC 4 · LC 5 · LC 8

LIGHTING CONTACTOR WIRING DIAGRAM

LIGHTING CONTACTOR OPERATOR ELEMENTS

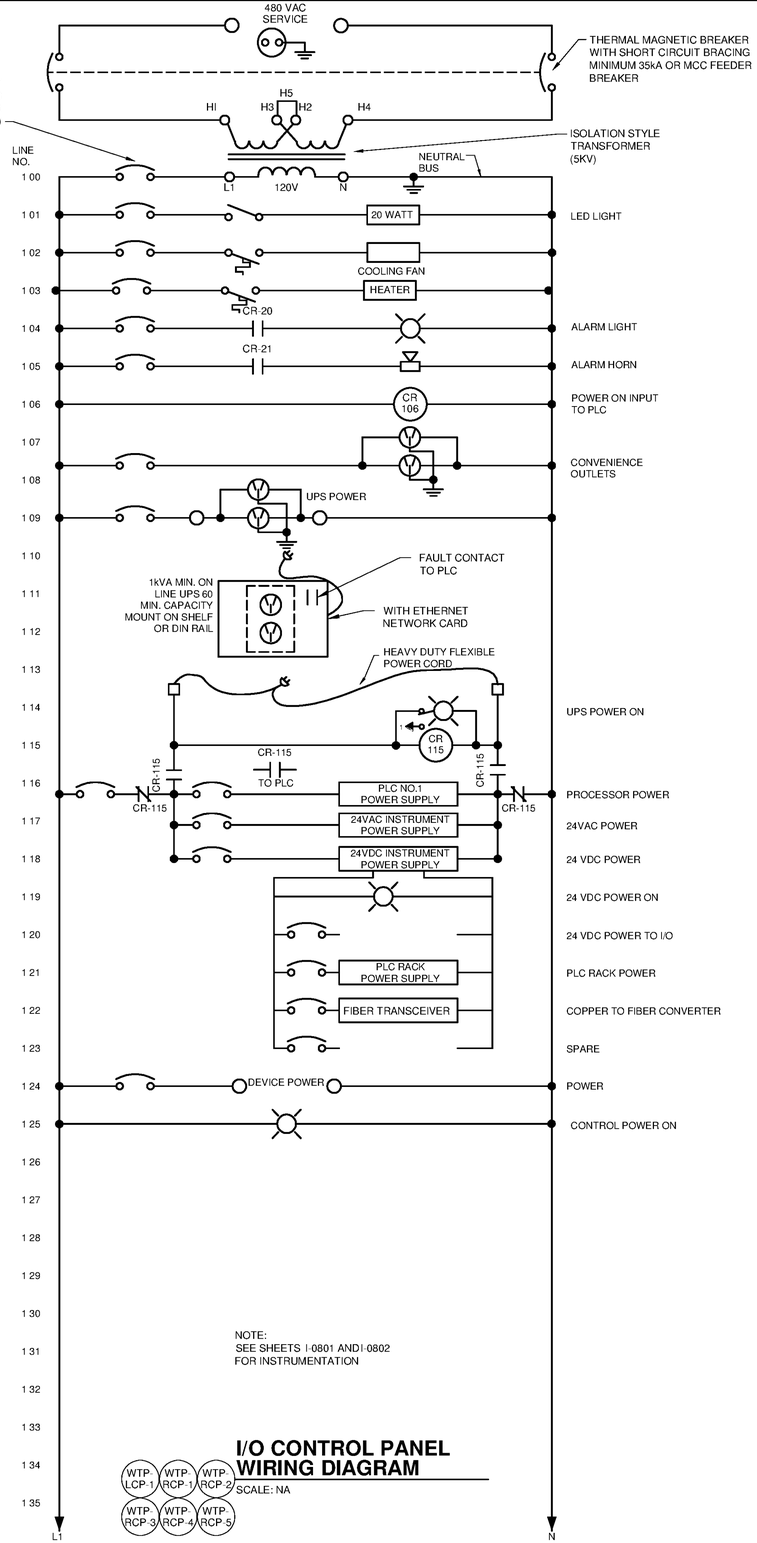

NOTE:
SEE SHEETS I-0801 AND I-0802 FOR INSTRUMENTATION

I/O CONTROL PANEL WIRING DIAGRAM

WTP-LCP-1 · WTP-RCP-1 · WTP-RCP-2 · WTP-RCP-3 · WTP-RCP-4 · WTP-RCP-5

SCALE: NA

TETRA TECH
www.tetratech.com
101 QUALITY CIRCLE, SUITE 140
HUNTSVILLE, ALABAMA 35806
PHONE: (256) 424-4077 FAX: (256) 424-4097

BID SET

ALABAMA LICENSED PROFESSIONAL ENGINEER No. 21939 TIMOTHY A. CALZARETTA ANDREW GUNDER

MARK	DATE	DESCRIPTION	BY

HUNTSVILLE UTILITIES
SOUTHEAST WATER TREATMENT PLANT

WIRING SCHEMATICS

Project No.:	200-11740-10003
Designed By:	AJK
Drawn By:	AJK
Checked By:	DAB

E-0607

Copyright: Tetra Tech

Bar Measures 1 inch

10/17/2014 10:55:40 AM - P:\IER\11740\200 11740 -10003\CAD\SHEETFILES\TREATMENT PLANT\WTP-E-0602_E-0606 WIRING DIAGRAMS.DWG - CALZARETTA, TIMOTHY