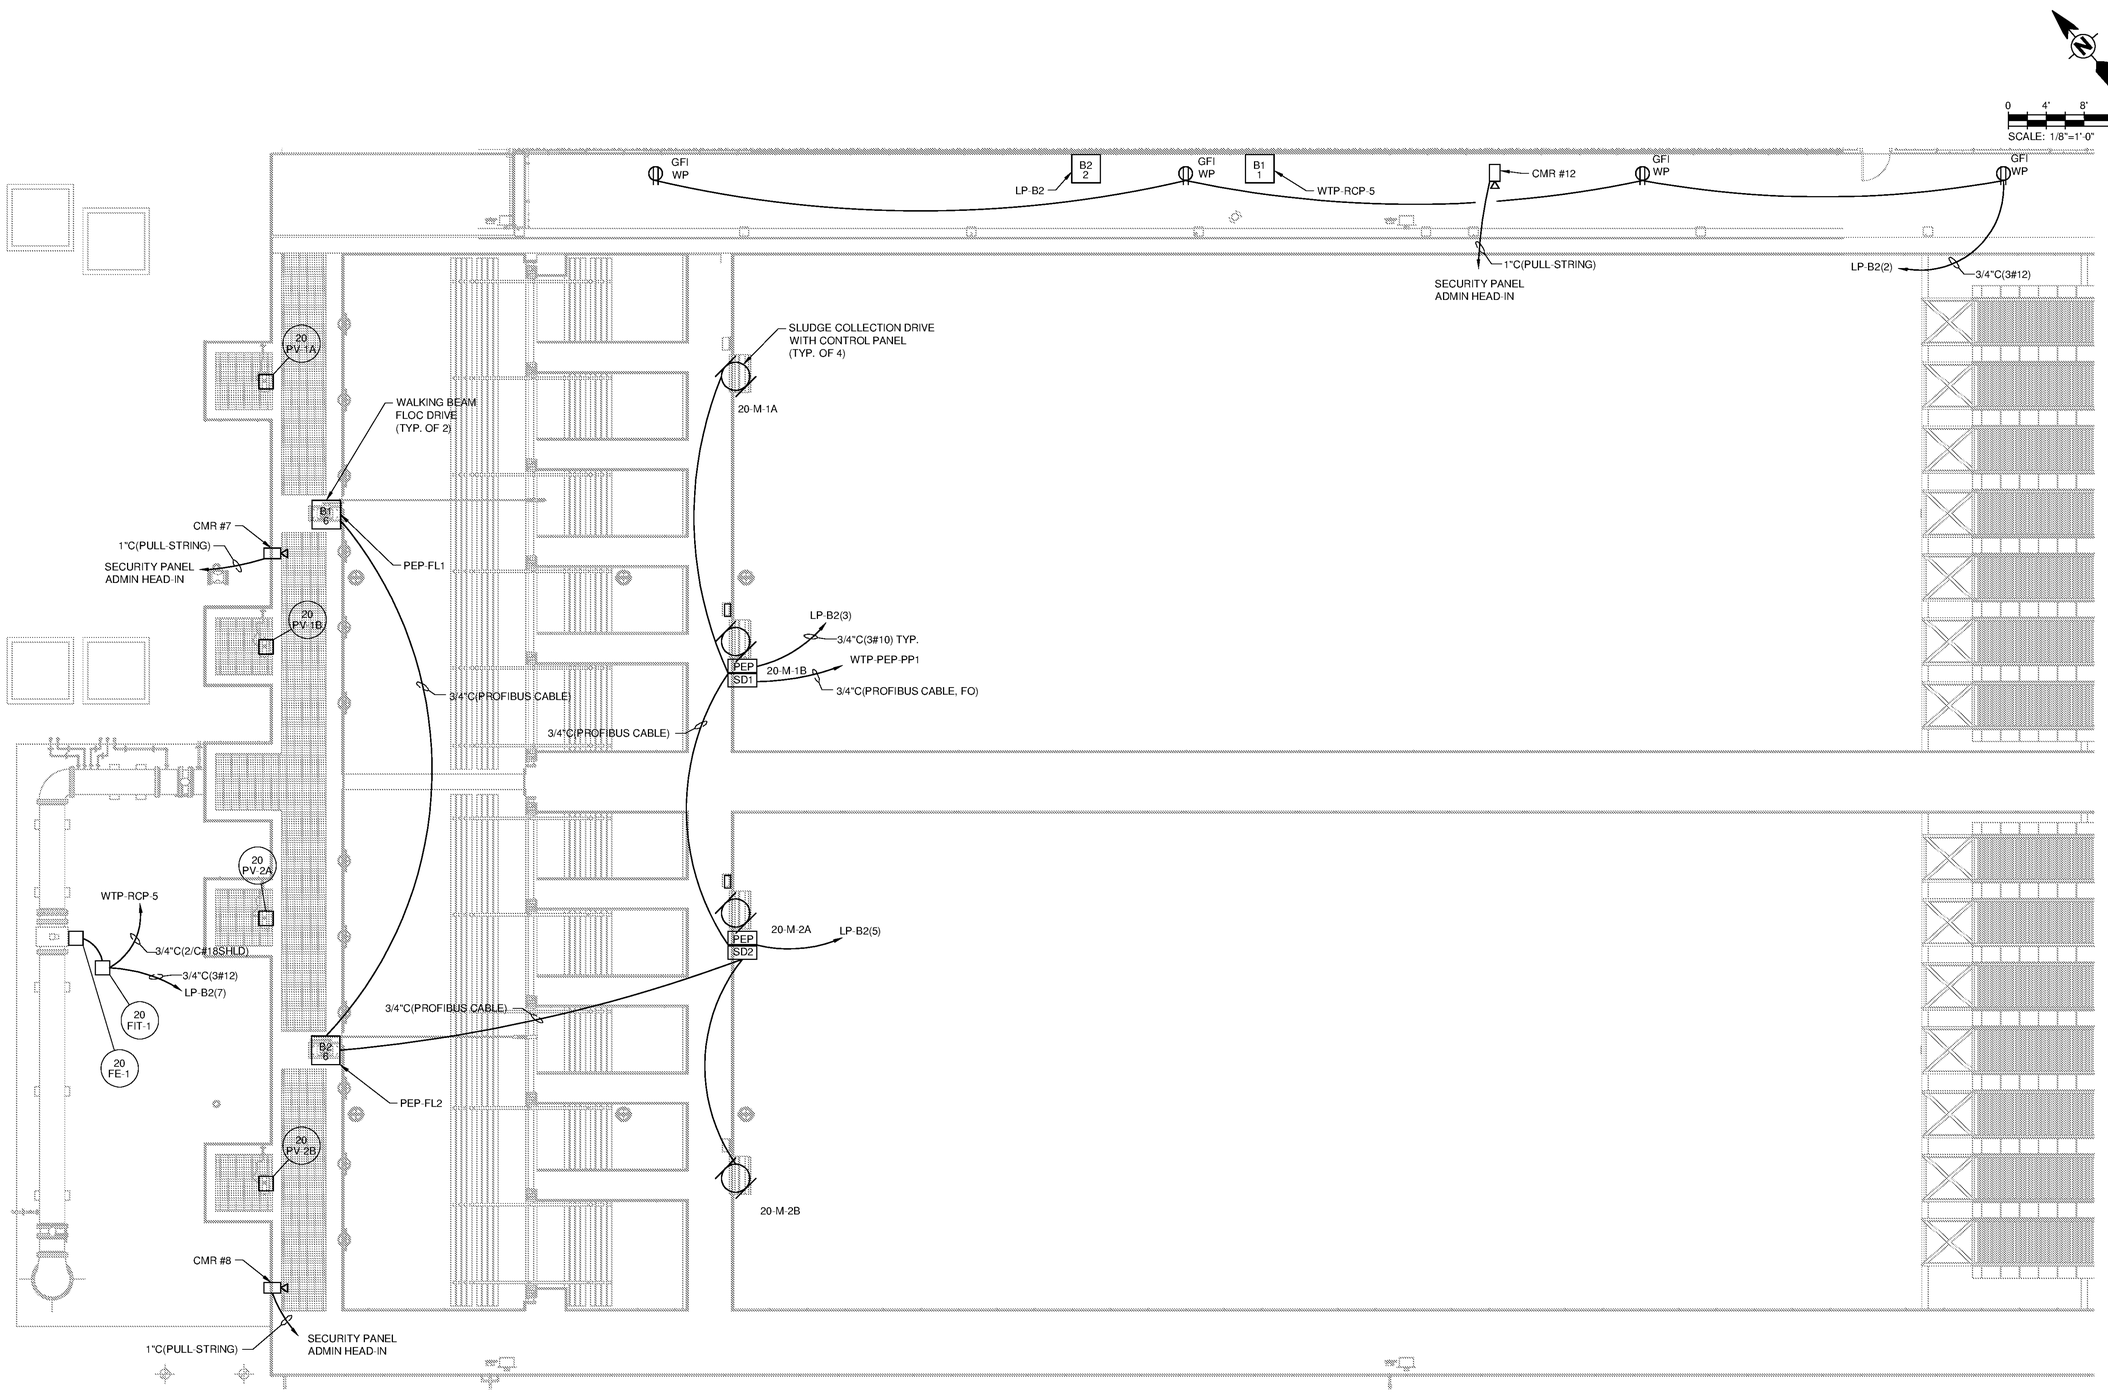

PLAN

SCALE: 1/8"=1'-0"

NOTES:

1. SEE SHEET I-2601 AND I-2602 FOR CONDUIT AND WIRE REQUIREMENTS. COORDINATE W/ PROCESS FOR EXACT LOAD LOCATIONS.

TETRA TECH
www.tetratech.com
101 QUALITY CIRCLE, SUITE 140
HUNTSVILLE, ALABAMA 35806
PHONE: (256) 424-4077 FAX: (256) 424-4097

BID SET

ALABAMA LICENSED No. 21939 PROFESSIONAL ENGINEER CHRISTOPHER S. WILLIAMS

MARK	DATE	DESCRIPTION	BY

HUNTSVILLE UTILITIES
SOUTHEAST WATER TREATMENT PLANT

ELECTRICAL PLAN - FLOCCULATION/ SEDIMENTATION BASINS

Project No.:	200-11740-10003
Designed By:	CSW
Drawn By:	CSW
Checked By:	DAB

E-2401

Copyright: Tetra Tech

Bar Measures 1 inch

10/17/2014 10:56:40 AM P:\IER\11740\200-11740-10003\CAD\SHEETFILES\TREATMENT PLANT\WTP-E-2401_E-2404 MAIN PROCESS BUILDING.DWG - CALZARETTA, TIMOTHY