


SEE SHEET E-2413 FOR FILL STATION DETAIL (TYPICAL)

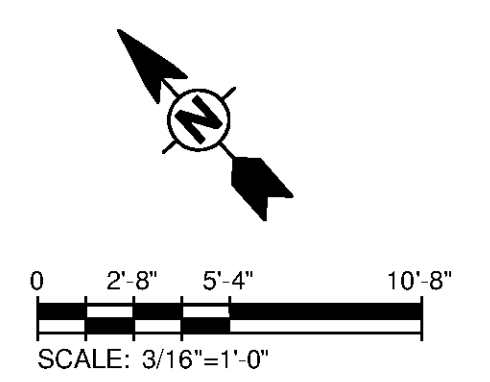

**PLAN**  
SCALE: 3/16"=1'-0"

- KEYED NOTES:**
- 1 PROVIDE 120VAC, 20 AMP SPECIFICATION GRADE RECEPTACLE, BOX, STRUT AND FASTENERS AT EACH RADIANT HEATER BLOWER FOR CORD AND PLUG CONNECTION.
  - 2 ALLOW ADEQUATE SPACE FOR FUTURE PUMPS.
  - 3 PROVIDE UNISTRUT TO MOUNT PANELS ON TO AVOID INTERFERENCE AND PROVIDE PROPER CLEARANCES WITH PIPING PER N.E.C
  - 4 COLLECT SUMP LEVEL SWITCH WIRES IN COMMON CONDUIT.

- NOTE:**
1. SEE FILL STATION DETAIL "A" SHEET E-2413 FOR LEVEL DISPLAY REQUIREMENTS.
  2. SEE CHEMICAL PUMP DETAIL "B" SHEET E-2413 FOR ADDITIONAL REQUIREMENTS.
  3. SEE CHEM TANK LEVEL SENSOR DETAIL "C" SHEET E-2413 FOR ADDITIONAL REQUIREMENTS.
  4. INSTALL WEATHERPROOF COVERS ON RECEPTACLES.

10/17/2014 10:57:13 AM P:\IER11740\200-11740-10003\CAD\SHEETFILES\TREATMENT PLANT\WTP E-2405 ELECTRICAL PLAN - CHEMICAL FEED ROOM.DWG CALZARETTA, TIMOTHY

www.tetra-tech.com  
101 QUALITY CIRCLE, SUITE 140  
HUNTSVILLE, ALABAMA 35896  
PHONE: (256) 424-4077 FAX: (256) 424-4097

HUNTSVILLE UTILITIES  
SOUTHEAST WATER TREATMENT PLANT

**ELECTRICAL PLAN -  
CHEMICAL FEED ROOM**

Project No.: 200-11740-10003  
Designed By: CSW  
Drawn By: TAC  
Checked By: DAB

BY

DESCRIPTION

MARK

DATE

TETRA TECH

BID SET

E-2405

Bar Measures 1 inch