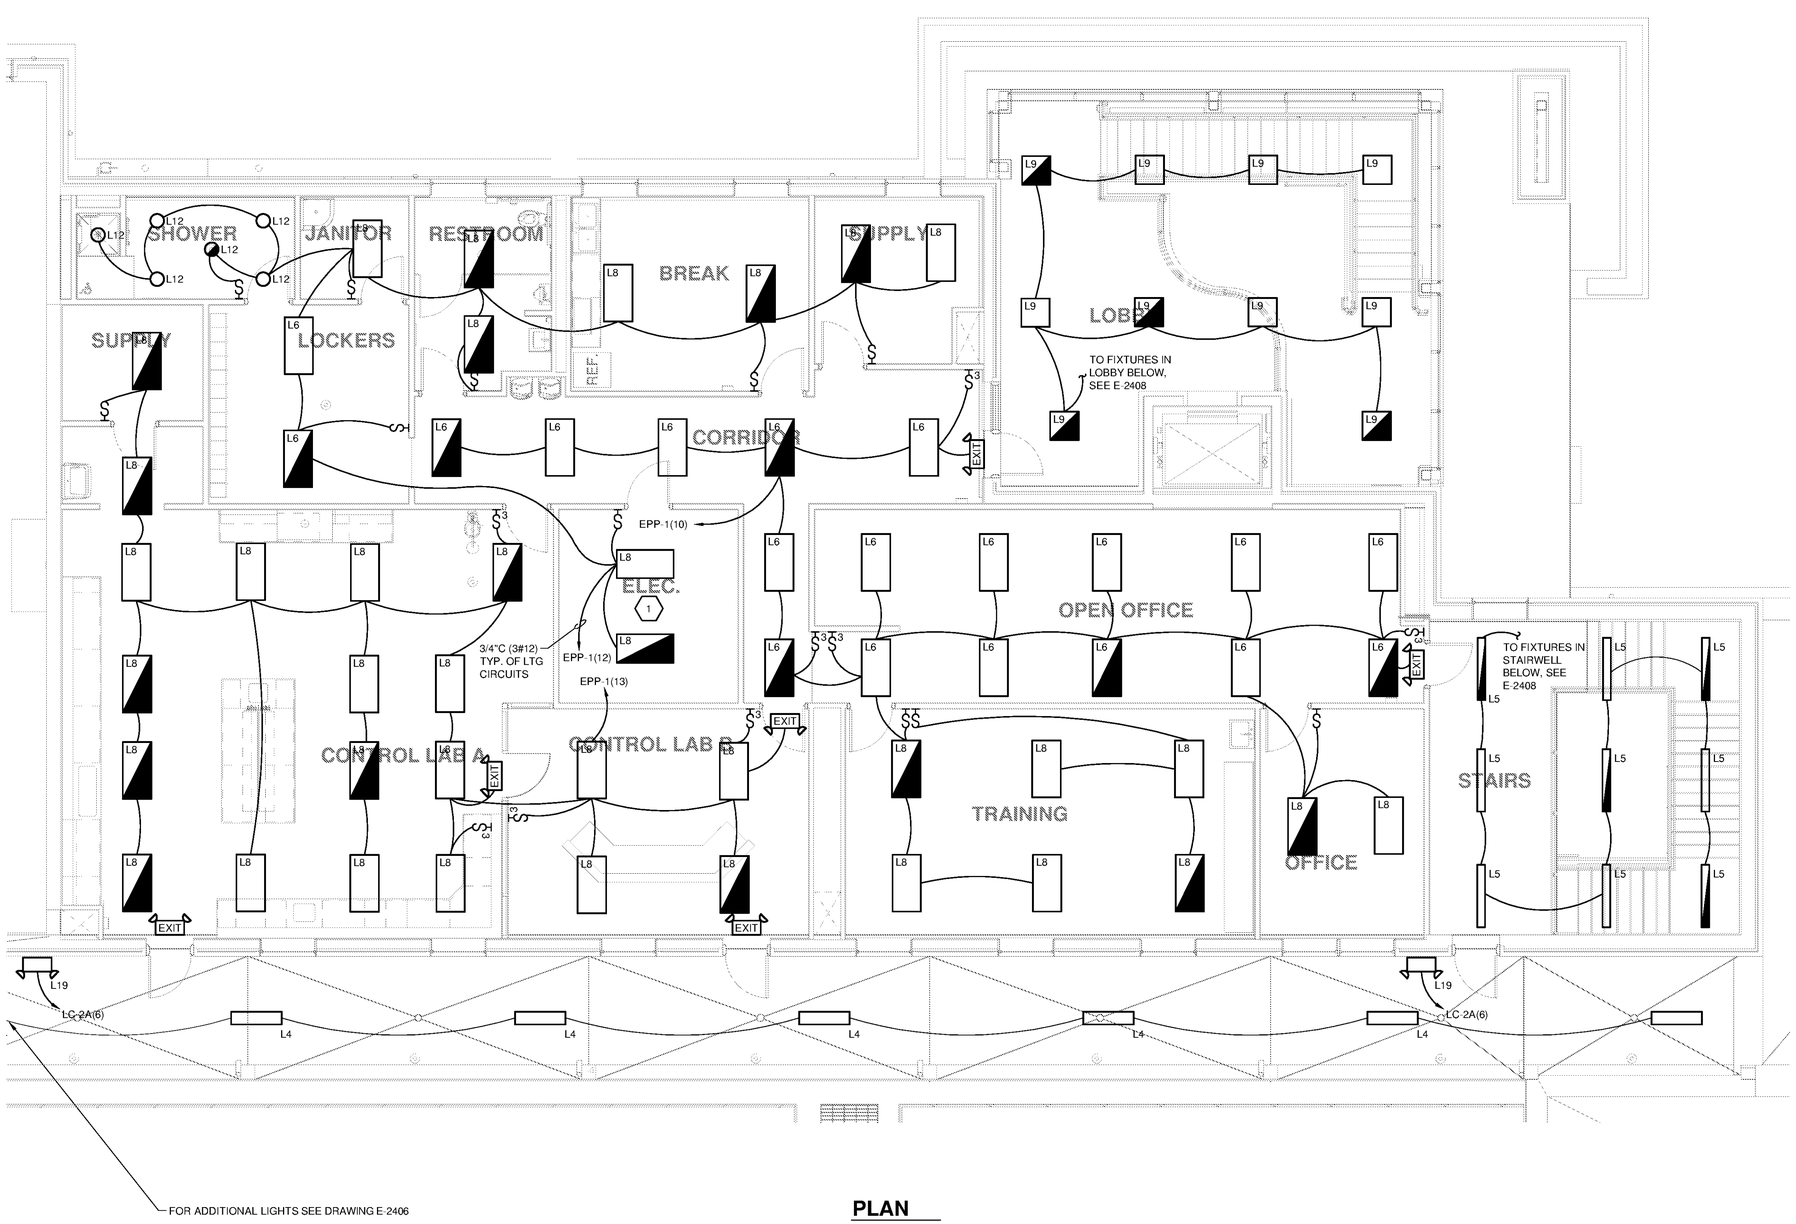

PLAN

SCALE: 3/16"=1'-0"

0 2'-8" 5'-4" 10'-8"
SCALE: 3/16"=1'-0"

KEYED NOTES:

1. COORDINATE LIGHTS, CABLE TRAY AND AIR HANDLERS PRIOR TO INSTALLATION.

NOTE:

1. SEE ARCHITECTURAL PLANS FOR FIRE RATED WALLS. PROVIDE FIRE PUTTY PADS ON ALL OUTLET AND DEVICES BOXES IN RATED WALLS.

TETRA TECH
www.tetratech.com
101 QUALITY CIRCLE, SUITE 140
HUNTSVILLE, ALABAMA 35806
PHONE: (256) 424-4077 FAX: (256) 424-4097

BID SET

MARK	DATE	DESCRIPTION	BY

HUNTSVILLE UTILITIES
SOUTHEAST WATER TREATMENT PLANT

LIGHTING PLAN - MAIN PROCESS 2ND FLOOR

Project No.:	200-11740-10003
Designed By:	CSW
Drawn By:	TAC
Checked By:	DAB

E-2411

Copyright: Tetra Tech

Bar Measures 1 inch

10/17/2014 10:58:11 AM - P:\IER\11740\200-11740-10003\CAD\SHEETFILES\TREATMENT PLANT\WTP-E-2411 LIGHTING PLAN - MAIN PROCESS 2ND FLOOR.DWG - CALZARETTA, TIMOTHY