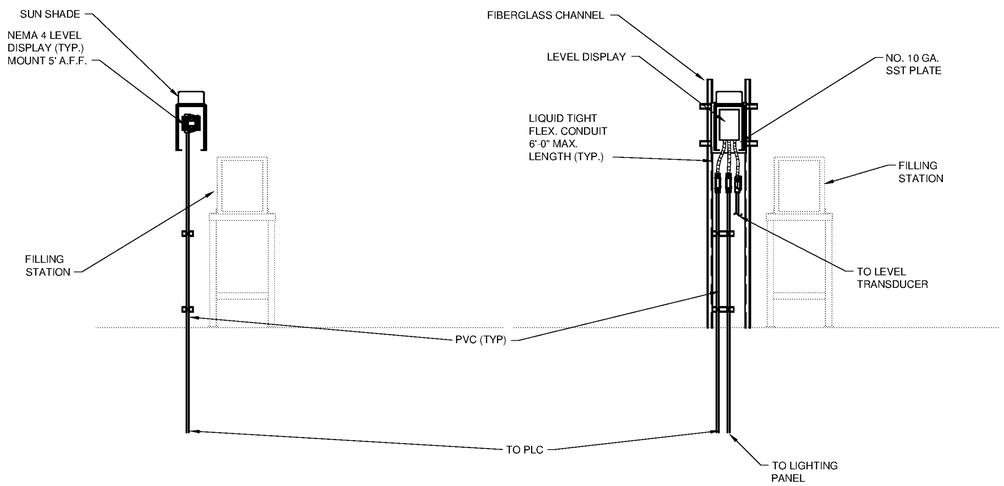

A E-2405 **FILL STATION**
SCALE: NONE

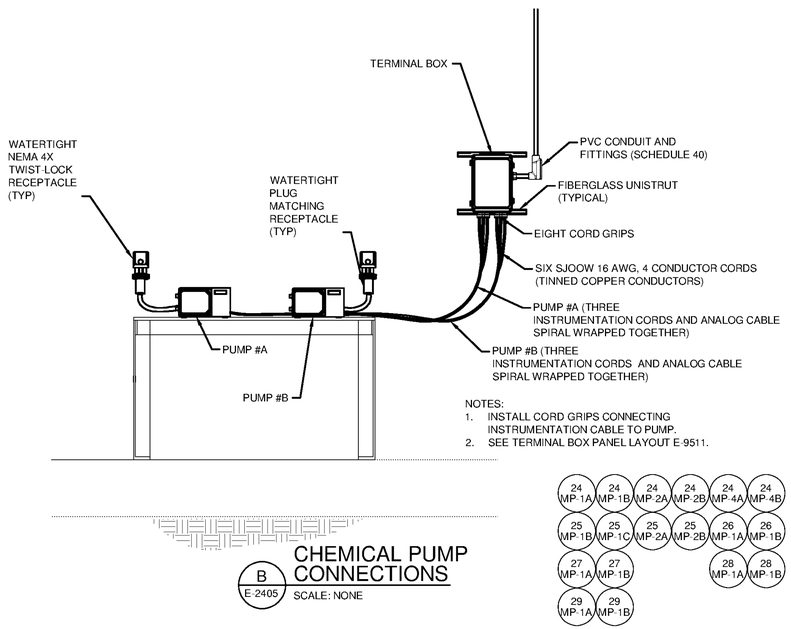

NOTES:
1. INSTALL CORD GRIPS CONNECTING INSTRUMENTATION CABLE TO PUMP.
2. SEE TERMINAL BOX PANEL LAYOUT E-9511.

24 MP-1A	24 MP-1B	24 MP-2A	24 MP-2B	24 MP-4A	24 MP-4B	
25 MP-1B	25 MP-1C	25 MP-2A	25 MP-2B	26 MP-1A	26 MP-1B	
27 MP-1A	27 MP-1B			28 MP-1A	28 MP-1B	
29 MP-1A	29 MP-1B					

B E-2405 **CHEMICAL PUMP CONNECTIONS**
SCALE: NONE

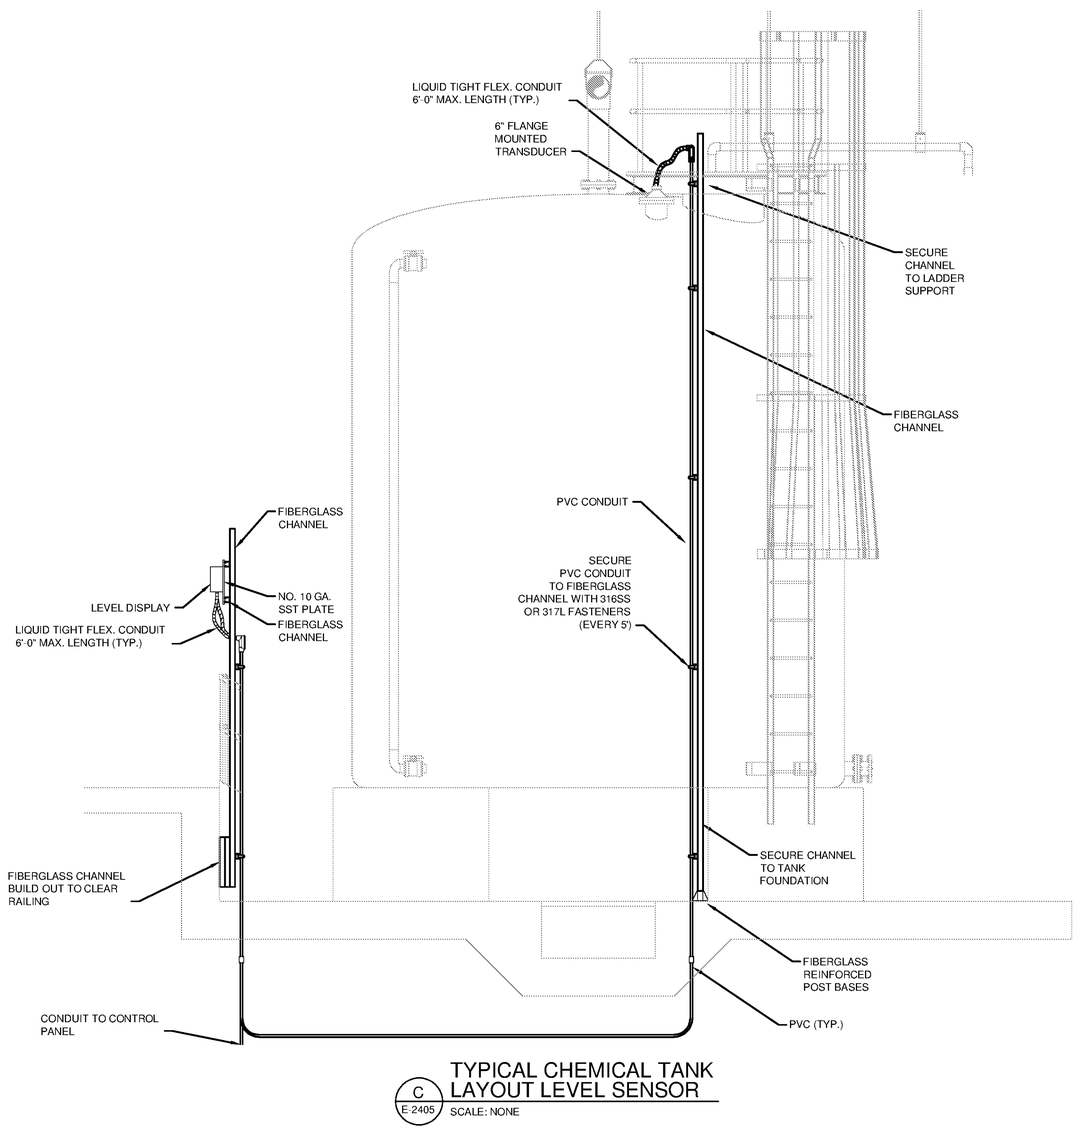

C E-2405 **TYPICAL CHEMICAL TANK LAYOUT LEVEL SENSOR**
SCALE: NONE

TETRA TECH
www.tetratech.com
101 QUALITY CIRCLE, SUITE 140
HUNTSVILLE, ALABAMA 35806
PHONE: (256) 424-4077 FAX: (256) 424-4097

BID SET

ALABAMA LICENSED No. 21939 PROFESSIONAL ENGINEER ANDREW SUMMERS

MARK	DATE	DESCRIPTION	BY

HUNTSVILLE UTILITIES
SOUTHEAST WATER TREATMENT PLANT

ELECTRICAL SECTIONS - CHEM FEED SECTIONS

Project No.:	200-11740-10003
Designed By:	CSW
Drawn By:	CSW
Checked By:	DAB

E-2413

Copyright: Tetra Tech

Bar Measures 1 inch

10/17/2014 10:58:32 AM - P:\ER\117402\200-11740-10003\CAD\SHEETFILES\TREATMENT PLANT\WTP E-2413 ELECTRICAL SECTIONS - CHEM FEED SECTIONS.DWG - CALZARETTA, TIMOTHY