


10/17/2014 10:34:07 AM - P:\IER\1740\200-11740-10003\CAD\SHEETFILES\TREATMENT PLANT\WTP-16601-SLUDGE FILTRATE CP.DWG - CALZARETTA, TIMOTHY

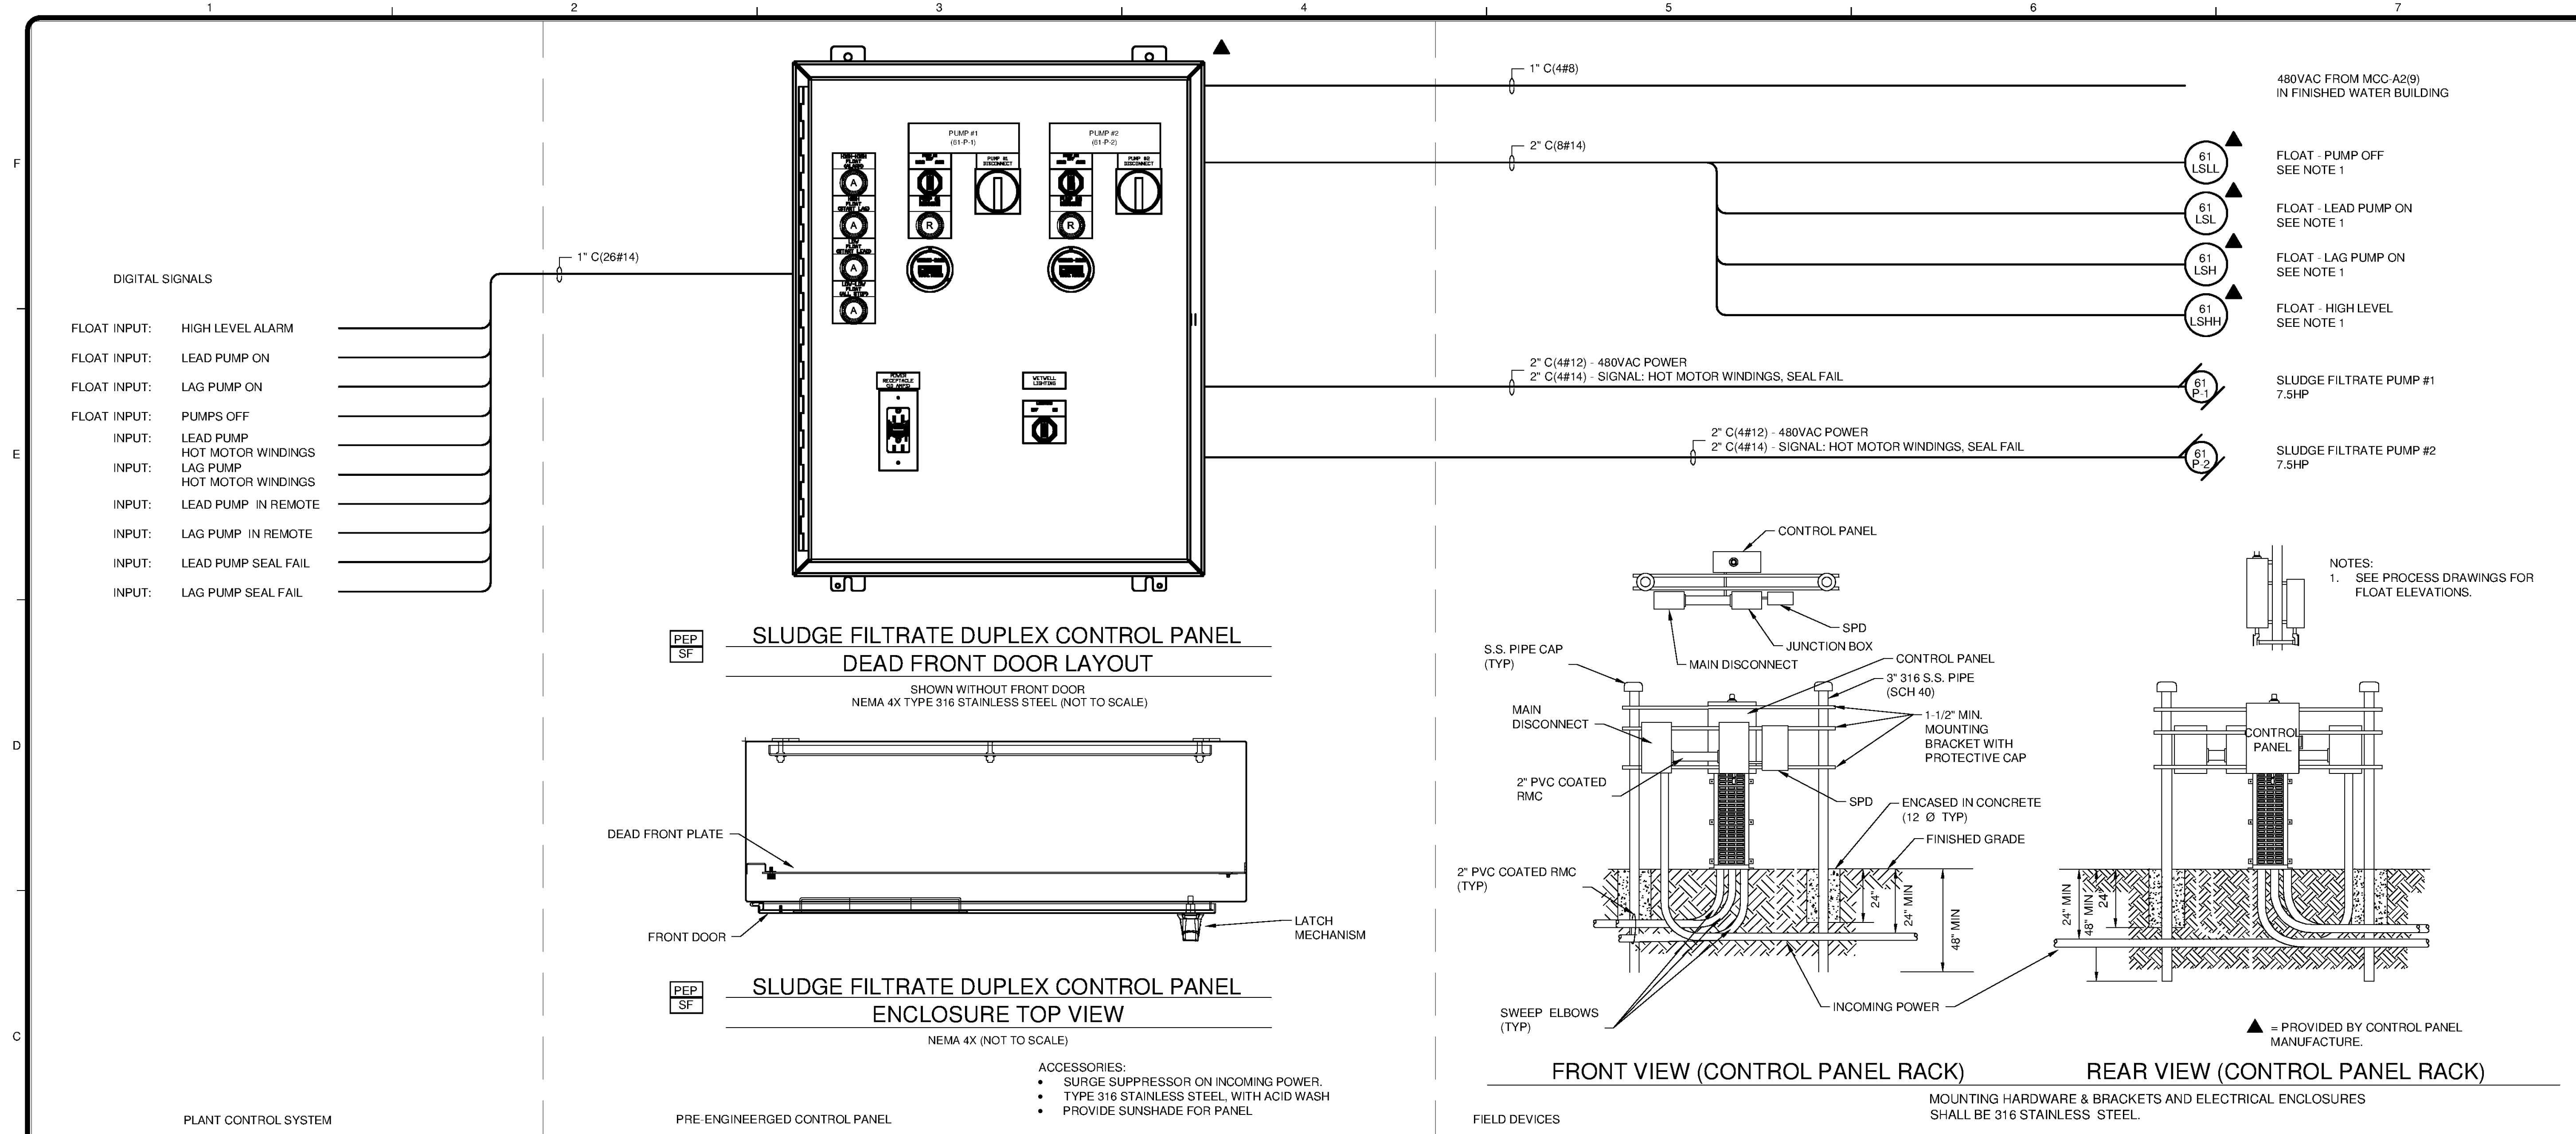

GENERAL NOTES:

- SEE SECTION 40 99 90 "PACKAGE CONTROL SYSTEMS" FOR PANEL REQUIREMENTS. OUTDOOR PANELS SHALL BE NEMA 4X TYPE 316 STAINLESS STEEL
- SEE ELECTRICAL SPECIFICATIONS FOR CONDUIT AND WIRE REQUIREMENTS.
- EQUIPMENT PLACEMENT SHOWN ON E-6401.
- SKID MANUFACTURER MUST DEMONSTRATE INTEGRATION TO SIEMENS S7-1500 PROCESS PRIOR TO COMMISSIONING.

TETRA TECH

www.tetrattech.com
101 QUALITY CIRCLE, SUITE 140
HUNTSVILLE, ALABAMA 35806
PHONE: (256) 424-4077 FAX: (256) 424-4097

BID SET

BY	DATE	DESCRIPTION

HUNTSVILLE UTILITIES
SOUTHEAST WATER TREATMENT PLANT

SLUDGE FILTRATE
CONTROL PANEL

Project No.: 200-11740-10003

Designed By: CSW

Drawn By: TAC

Checked By: WAP

I-6601

Copyright Tetra Tech
Bar Measures 1 inch