


SIEMENS
DI 16x24VDC HF
SLOT: 07

① IN 0
② IN 1
③ IN 2
④ IN 3
⑤ IN 4
⑥ IN 5
⑦ IN 6
⑧ IN 7
⑪ IN 8
⑫ IN 9
⑫ IN 10
⑭ IN 11
⑮ IN 12
⑯ IN 2
⑰ IN 14
⑱ IN 15
⑲
⑳




- METERING PUMP IN-AUTO (25-MP-1B)
- METERING PUMP RUNNING (25-MP-1B)
- SPARE
- METERING PUMP ALARM (25-MP-1B)
- METERING PUMP IN-AUTO (25-MP-1C)
- METERING PUMP RUNNING (25-MP-1C)
- SPARE
- METERING PUMP ALARM (25-MP-1C)
- METERING PUMP IN-AUTO (25-MP-2A)
- METERING PUMP RUNNING (25-MP-2A)
- SPARE
- METERING PUMP ALARM (25-MP-2A)
- METERING PUMP IN-AUTO (25-MP-2B)
- METERING PUMP RUNNING (25-MP-2B)
- SPARE
- METERING PUMP ALARM (25-MP-2B)

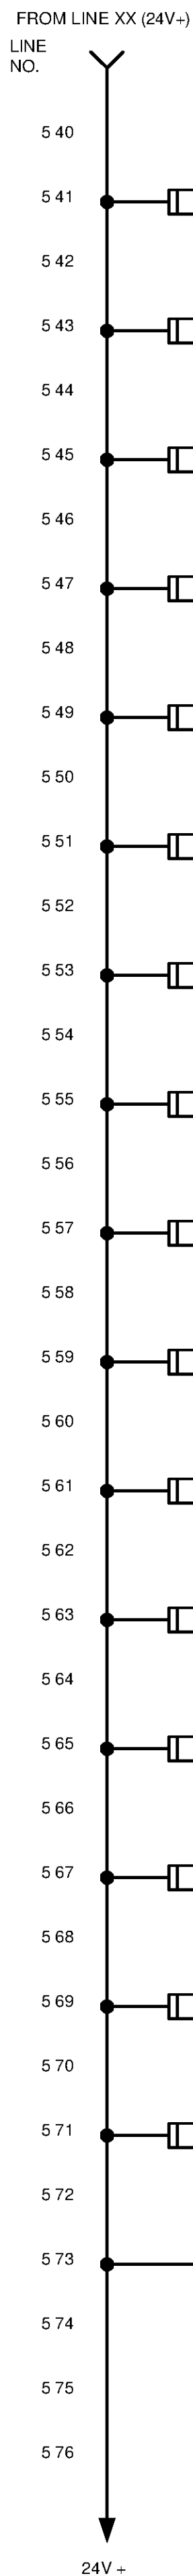


SIEMENS
DI 16x24VDC HF
SLOT: 08

① IN 0
② IN 1
③ IN 2
④ IN 3
⑤ IN 4
⑥ IN 5
⑦ IN 6
⑧ IN 7
⑪ IN 8
⑫ IN 9
⑫ IN 10
⑭ IN 11
⑮ IN 12
⑯ IN 2
⑰ IN 14
⑱ IN 15
⑲
⑳




- METERING PUMP IN-AUTO (25-MP-3A) (FUTURE)
- METERING PUMP RUNNING (25-MP-3A) (FUTURE)
- SPARE
- METERING PUMP ALARM (25-MP-3A) (FUTURE)
- METERING PUMP IN-AUTO (25-MP-3B) (FUTURE)
- METERING PUMP RUNNING (25-MP-3B) (FUTURE)
- SPARE
- METERING PUMP ALARM (25-MP-3B) (FUTURE)
- METERING PUMP IN-AUTO (26-MP-1A)
- METERING PUMP RUNNING (26-MP-1A)
- SPARE
- METERING PUMP ALARM (26-MP-1A)
- METERING PUMP IN-AUTO (26-MP-1B)
- METERING PUMP RUNNING (26-MP-1B)
- SPARE
- METERING PUMP ALARM (26-MP-1B)

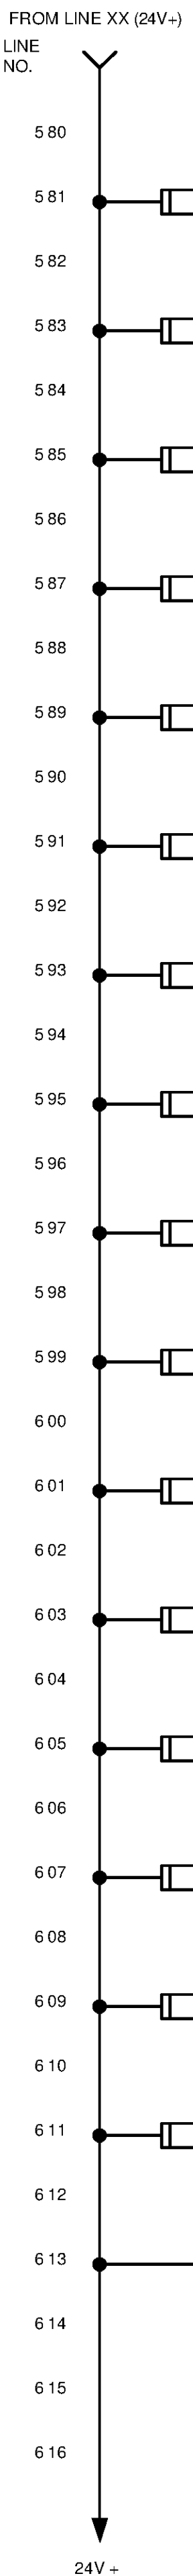


SIEMENS
DI 16x24VDC HF
SLOT: 09

① IN 0
② IN 1
③ IN 2
④ IN 3
⑤ IN 4
⑥ IN 5
⑦ IN 6
⑧ IN 7
⑪ IN 8
⑫ IN 9
⑫ IN 10
⑭ IN 11
⑮ IN 12
⑯ IN 2
⑰ IN 14
⑱ IN 15
⑲
⑳



- METERING PUMP IN-AUTO (27-MP-1A)
- METERING PUMP RUNNING (27-MP-1A)
- SPARE
- METERING PUMP ALARM (27-MP-1A)
- METERING PUMP IN-AUTO (27-MP-1B)
- METERING PUMP RUNNING (27-MP-1B)
- SPARE
- METERING PUMP ALARM (27-MP-1B)
- METERING PUMP IN-AUTO (28-MP-1A)
- METERING PUMP RUNNING (28-MP-1A)
- SPARE
- METERING PUMP ALARM (28-MP-1A)
- METERING PUMP IN-AUTO (28-MP-1B)
- METERING PUMP RUNNING (28-MP-1B)
- SPARE
- METERING PUMP ALARM (28-MP-1B)

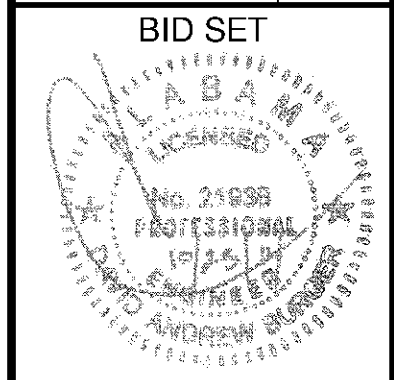

MARK	DATE	DESCRIPTION	BY

HUNTSVILLE UTILITIES
SOUTHEAST WATER TREATMENT PLANT
**CONTROL PANEL
WTP-RCP-5**

Project No.: 200-11740-10003
Designed By: CSW
Drawn By: TAC
Checked By: DAB

I-8017

TETRA TECH
www.tetra-tech.com
101 QUALITY CIRCLE, SUITE 140
HUNTSVILLE, ALABAMA 35896
PHONE: (256) 424-4077 FAX: (256) 424-4097