



Constantine Engineering, Inc.
4000 Faber Place Drive, Suite 330
North Charleston, SC 29405
Phone: (843) 628-3352

**RE: City of Lake City, SC
Lake Swamp WWTP Upgrade
CEI Project No. 100392.02**

ADDENDUM NO. 3 – June 10, 2021

TO: ALL HOLDERS OF RECORD OF CONTRACT DOCUMENTS

Acknowledge receipt of this addendum by inserting its number and date in the Bid Form. Failure to do so may subject bidder to disqualification. This addendum forms a part of the Contract Documents. It modifies them as follows:

Plans

1. Sheet C00.20, C00.30, C00.40:
 - a. Move Aeration Basin Nos. 3 and 4 10-feet to the northwest. Adjust piping and effluent channel accordingly. Fill must remain against the outside wall of Aeration Basin Nos. 1 and 2 during construction of the new aeration basin.”
2. Sheet X03.10:
 - b. Revise Note 1 as follows: **“1. The Owner will remove all liquid and solid waste, and the RBC covers and media discs prior to construction.”**
3. Sheet X04.10:
 - a. Revise Note 1 as follows: **“1. The Owner will drain the aeration basin once the new aeration basin is in operation.”**
 - b. Revise Note 2 as follows: **“2. Contractor will be responsible for washing down the bottom of the tank for inspection of the fine bubble diffusers.”**
4. Sheet X05.10:
 - a. Revise Note 1 as follows: **“1. The Owner will remove all liquid and solid waste prior to construction.”**
 - b. Delete Note 2.

- c. Delete the 8"DRN shown on the Top Plan and Section A. There is no drain line for this basin.
- 5. Sheet X07.10:
 - a. Replace in its entirety with the attached.
- 6. Sheet X11.10:
 - b. Revise Note 1 as follows: **"1. The Owner will remove all liquid and solid waste from Digester Nos. 3 and 4 prior to construction."**
 - c. Delete Note 2.
- 7. Sheet S0.1 – Concrete Notes:
 - a. Delete Note 9 in its entirety.
- 8. Sheet M06.10:
 - a. Detail 1: Standpipe material to be ductile iron. PVC pipe underdrain to be Class PS 46 as defined in ASTM D 1734, or ASTM D 3034, SR 35. Provide 1/2" diameter perforations at 6" OC. Two rows at 120-degrees apart.
- 9. Sheet M06.11:
 - b. Plan: Revise aluminum handrail and aluminum grating at the effluent channel between the new and existing aeration basin. Install as shown on sheet S6.2.
- 10. Sheet M09.10:
 - c. Revise Note 1 as follows: **"1. The Owner will remove liquid and solid waste with the RAS pumps. Contractor will be responsible for washing down the bottom of the tank and clarifier equipment."**
 - d. Delete Note 2.
- 11. Sheet M09.11:
 - a. Revise Note 1 as follows: **"1. The Owner will remove all liquid and solid waste prior to construction. Contractor will be responsible for washing down the bottom of the tank and clarifier equipment, and pumping out any rainwater (there is no clarifier drain)."**
 - b. Delete Note 2.

12. Sheet E00.32 – Existing Distribution Panel #2:

- a. Change the motor hp of RAS Pump #3 and #4 from 15hp to **25hp**.

SPECIFICATIONS

1. Section C-111 – Advertisement for Bids

- a. Add the following to the end of paragraph 6:

“A second pre-bid conference will be held at 10:00 am local time on July 8, 2021 in the training room of the Lake City Fire Department located at 230 North Acline Street. Masks are required. Attendance at the pre-bid conference is mandatory for Bidders who did not attend the first pre-bid meeting on May 12.”

2. Section C-200 – Instructions for Bidders

- a. Add the following to Article 14:

“14.04 Bid Alternates

A. Bidders shall include a separate price for each alternate described in the Bidding Documents and as provided for in the Bid Form. The price for each alternate will be the amount added to or deleted from the base Bid if Owner selects the alternate.”

- b. Add the following to the end of Article 19.02:

“The method for calculating the lowest bid will be the summation of the Rural Utilities Service Bid Price and the State Revolving Fund Bid Price.”

3. Section C-410– Bid Form (Rural Utilities Service)

- a. Replace in its entirety with the attached.

4. Section C-410– Bid Form (State Revolving Fund)

- a. Replace in its entirety with the attached.

5. Section C-451 – Qualifications Statement

- a. Item 12 – Safety Program: Change the OSHA reference to **“OSHA No. 300”**.

6. Section 01001– General Requirements

- a. Delete the last sentence of paragraph 5.01.A.
- b. Add the following to paragraph 5.01.

“B. Engineer’s Field Office

- 1. **Contractor shall provide, maintain, and subsequently remove as its property, field office(s) as specified below, for the exclusive use of Engineer and its representatives. Room may be in connection with Contractor’s office space.**
- 2. **Engineer’s field office, equipped as specified below, shall be available for Engineer’s use upon start of work at project site, and shall remain on the site until substantial completion.**
- 3. **Contractor shall maintain field office in good repair and acceptable appearance.**
- 4. **Provide sanitary facilities in compliance with state and local health authorities.**
- 5. **Field office(s) shall be trailer type mobile structure(s) with the following minimum features and equipment, new or like new in appearance and function:**
 - a. **Minimum Interior Height: 7 feet.**
 - b. **Minimum Interior Width: 10 feet.**
 - c. **Minimum Interior Length: 12 feet.**
 - d. **Desks: One (1), 30 inches by 60 inches.**
 - e. **Swivel or straight chairs: Two (2).”**
 - f. **Internet service.**

7. Section 01010– Summary of Work

- a. Revise paragraph 1.02.D.1.a, 1.02.D.1.b, and 1.02.D.1.c as follows:

- “a. Existing Rotating Biological Contractors: Demolition of the structure in its entirety.**
- b. Existing Aeration Basin Nos. 1 and 2: Replacement of 20-diffuser assemblies. Modify effluent channel to receive channel from new aeration basins.**
- c. Existing Aeration Basin No. 3: Demolition of the structure in its entirety.”**

- b. Revise paragraph 1.02.D.2.b as follows:

- “b. Existing Clarifier Nos. 1, 2, and 3: Washdown of equipment, water jet cleaning of suction headers, and sandblasting and**

painting of all carbon steel clarifier equipment. Clarifier drive replacement for Clarifier Nos. 1 and 2.”

8. Section 01111– Permits, Rights-of-Way and Geotechnical Report

- a. Revise paragraph 3.5.A as follows:

“The geotechnical report is attached.”

9. Section 02200– Earthwork

- a. Revise paragraph 1.03.A as follows:

“A. Contractor shall schedule and coordinate all testing with the Owner’s selected geotechnical testing firm.”

10. Section 03300– Cast-In-Place-Concrete

- a. Delete paragraph 1.04.B.

11. Section 09900 – Painting

- a. Delete paragraph 3.03.L and 3.03.M

12. Section 10539 – Aluminum Man Door Canopy

- a. Revise paragraph 2.1.A.1 as follows:

“...in accordance with the 2018 International Building Code.”

13. Section 11375 – Fine Bubble Membrane Diffusers

- a. Delete “(Schedule 5)” from paragraph 2.3.A.

- b. Delete “(bottom)” from paragraph 2.3.B.

14. Section 13329 – Temporary Sludge Dewatering and Disposal

- a. Delete this section in its entirety.

15. Section 15200 – Valves and Accessories

- a. Delete paragraph 2.2 in its entirety.

END OF ADDENDUM NO. 3

Attachments: Bid Form (Rural Utilities Service)
Bid Form (State Revolving Fund)
Drawing X07.10

SECTION C-410

BID FORM (RURAL UTILITIES SERVICE)

ARTICLE 1 – BID RECIPIENT

1.01 This Bid is submitted to:

City of Lake City

202 Kelley St.

Lake City, SC 29560

1.02 The undersigned Bidder proposes and agrees, if this Bid is accepted, to enter into an Agreement with Owner in the form included in the Bidding Documents to perform all Work funded by the USDA Rural Utilities Service as specified or indicated in the Bidding Documents for the prices and within the times indicated in this Bid and in accordance with the other terms and conditions of the Bidding Documents for Lake Swamp WWTP Upgrade. The USDA scope of work is identified in Section 01010 – Summary of Work.

ARTICLE 2 – BIDDER’S ACKNOWLEDGEMENTS

2.01 Bidder accepts all of the terms and conditions of the Instructions to Bidders, including without limitation those dealing with the disposition of Bid security. This Bid will remain subject to acceptance for 90 days after the Bid opening, or for such longer period of time that Bidder may agree to in writing upon request of Owner.

ARTICLE 3 – BIDDER’S REPRESENTATIONS

3.01 In submitting this Bid, Bidder represents that:

A. Bidder has examined and carefully studied the Bidding Documents, and any data and reference items identified in the Bidding Documents, and hereby acknowledges receipt of the following Addenda:

<u>Addendum No.</u>	<u>Addendum, Date</u>
_____	_____
_____	_____
_____	_____
_____	_____

B. Bidder has visited the Site, conducted a thorough, alert visual examination of the Site and adjacent areas, and become familiar with and satisfied itself as to the general, local, and Site conditions that may affect cost, progress, and performance of the Work.

C. Bidder is familiar with and has satisfied itself as to all Laws and Regulations that may affect cost, progress, and performance of the Work.

D. Bidder has carefully studied all: (1) reports of explorations and tests of subsurface conditions at or adjacent to the Site that have been identified in the Supplementary Conditions, especially with respect to Technical Data in such reports and drawings.

- E. Bidder has considered the information known to Bidder itself; information commonly known to contractors doing business in the locality of the Site; information and observations obtained from visits to the Site; the Bidding Documents; and any Site-related reports and drawings identified in the Bidding Documents, with respect to the effect of such information, observations, and documents on (1) the cost, progress, and performance of the Work; (2) the means, methods, techniques, sequences, and procedures of construction to be employed by Bidder; and (3) Bidder's safety precautions and programs.
- F. Bidder agrees, based on the information and observations referred to in the preceding paragraph, that no further examinations, investigations, explorations, tests, studies, or data are necessary for the determination of this Bid for performance of the Work at the price bid and within the times required, and in accordance with the other terms and conditions of the Bidding Documents.
- G. Bidder is aware of the general nature of work to be performed by Owner and others at the Site that relates to the Work as indicated in the Bidding Documents.
- H. Bidder has given Engineer written notice of all conflicts, errors, ambiguities, or discrepancies that Bidder has discovered in the Bidding Documents, and confirms that the written resolution thereof by Engineer is acceptable to Bidder.
- I. The Bidding Documents are generally sufficient to indicate and convey understanding of all terms and conditions for the performance and furnishing of the Work.
- J. The submission of this Bid constitutes an incontrovertible representation by Bidder that Bidder has complied with every requirement of this Article, and that without exception the Bid and all prices in the Bid are premised upon performing and furnishing the Work required by the Bidding Documents.

ARTICLE 4 – BIDDER'S CERTIFICATION

4.01 Bidder certifies that:

- A. This Bid is genuine and not made in the interest of or on behalf of any undisclosed individual or entity and is not submitted in conformity with any collusive agreement or rules of any group, association, organization, or corporation;
- B. Bidder has not directly or indirectly induced or solicited any other Bidder to submit a false or sham Bid;
- C. Bidder has not solicited or induced any individual or entity to refrain from bidding; and
- D. Bidder has not engaged in corrupt, fraudulent, collusive, or coercive practices in competing for the Contract. For the purposes of this Paragraph 4.01.D:
 - 1. "corrupt practice" means the offering, giving, receiving, or soliciting of any thing of value likely to influence the action of a public official in the bidding process;
 - 2. "fraudulent practice" means an intentional misrepresentation of facts made (a) to influence the bidding process to the detriment of Owner, (b) to establish bid prices at artificial non-competitive levels, or (c) to deprive Owner of the benefits of free and open competition;
 - 3. "collusive practice" means a scheme or arrangement between two or more Bidders, with or without the knowledge of Owner, a purpose of which is to establish bid prices at artificial, non-competitive levels; and

4. "coercive practice" means harming or threatening to harm, directly or indirectly, persons or their property to influence their participation in the bidding process or affect the execution of the Contract.

ARTICLE 5 – BASIS OF BID

See section 01010-Summary of Work for RUS scope of work. Bidder will complete the Work in accordance with the Contract Documents for the following price(s):

Item No.	Description	Unit	Est. Qty.	Unit Price	Total
1	LUMP SUM WORK-Furnishing all products, materials and equipment and performing all labor necessary to complete the Lake Swamp WWTP Upgrade Project including all Work Shown on the Drawings and/or specified, exclusive of unit price and contingency items below.	LS	1		
2	20-Diffuser Membrane Assemblies for Replacement in Existing Aeration Basins Nos. 1 & 2	EA	1		
3	Owner Contingency	LS	1	\$250,000.00	\$250,000.00

Total of Unit Price Bids = Total Bid Price \$ _____
 _____ Dollars _____ Cents
 (Both figures and words)

ALTERNATE BID ITEMS

Alternate Bid Item No. 1 – Replacement of Existing Blowers and Discharge Piping (DEDUCT)

For all work associated with deducting replacement of the existing Blower Nos. 1, 2, 3, and 4, associated discharge air piping, and new HVAC work in the Blower Building. All other electrical improvements in the building are to remain in the project. New MCC and feeder wiring to blower shall be sized for the existing blowers sizes shown on E00.30. The following lump sum amount:

Dollars \$ _____

The Owner may elect to award the project based on any combination of the base bid and alternate bid items at their discretion.

ARTICLE 6 – TIME OF COMPLETION

- 6.01 Bidder agrees that the Work will be substantially complete and will be completed and ready for final payment in accordance with Paragraph 15.06 of the General Conditions on or before the dates or within the number of calendar days indicated in the Agreement.
- 6.02 Bidder accepts the provisions of the Agreement as to liquidated damages.

ARTICLE 7 – ATTACHMENTS TO THIS BID

- 7.01 The following documents are submitted with and made a condition of this Bid:
- A. Required Bid security;
 - B. Evidence of authority to do business in the state of the Project; or a written covenant to obtain such license within the time for acceptance of Bids;
 - C. Contractor's License No.: [REDACTED] Evidence of Bidder's ability to obtain a State Contractor's License and a covenant by Bidder to obtain said license within the time for acceptance of Bids;
 - D. USDA Form RD 400-6.
 - E. USDA Form AD-1048.
 - F. RD Instructions 1940-Q.
- 7.02 Major Equipment Items
- A. The project will be awarded based on the base bid equipment listed below. The bidder must base his lump sum base bid on the listed equipment/suppliers in the Base Bid column of the schedule. Deductions for equipment substitutions will not be considered in determining the basis of award. The bidder may indicate substitute equipment/supplier items by writing in the substitute equipment/supplier item and the amount of deduction for that substitute name write-in.
 - B. Substitute equipment/supplier will be deemed as equal if the substitute is the same or better than the product named and described in the specifications in function, performance, reliability, quality and general configuration. Determination of the equality of a substitute shall be determined by the Engineer after the bid, based on submittal data received with the Contractor's bid documents. Should the write-in substitute be determined "not equal", then the bidder shall supply the equipment listed in the Base Bid column. The Owner may determine any substitute "not equal" as the Owner determines to suit his sole best interests at any time.
 - C. Evaluation data to determine if a substitute equipment manufacturer/ supplier is an acceptable substitute must be submitted by the bidder with the bid. Information submitted after the bid will not be considered. Information submitted directly by equipment manufacturers/suppliers will not be evaluated. Minimum evaluation data shall include submittal information in conformance with Section 01001 of the contract documents. Data and drawing submittal shall be prepared specifically for this project. Incomplete submittals that do not conform with Section 01001 will not be considered. Sales catalog cuts or marked up drawings from previous projects will not be reviewed. The Bidder shall reimburse the Owner for any engineering costs associated with the review of any substitutes in accordance with the terms of the Engineer's Agreement with the Owner. The Owner is no way obligated to review substitute equipment submittals.

- D. No substitute equipment/supplier will be considered unless, in the opinion of the Owner or Engineer, it conforms to the contract drawings and specifications in all respects, except for the make and manufacture and minor details. Design and preparation of these plans and specifications are based on the equipment/supplier noted in the Base Bid column of the schedule. The bidder shall be responsible for any and all changes necessary to accommodate the substitute equipment/supplier items. The Owner shall be reimbursed for any and all associated redesign and/or construction drawings in accordance with the terms of the Engineer's Agreement with the Owner. The bidder shall also include any and all costs associated with additional construction costs (mechanical, structural, electrical, architectural, engineering, construction observation, etc.) as the result of a substitute item. The bid shall also include any paid up licenses necessary for the use of the equipment as required.

EQUIPMENT/SUPPLIER SCHEDULE

SPEC SECTION	DESCRIPTION	EQUIPMENT MANUFACTURERS/SUPPLIERS		AMOUNT OF DEDUCTION FOR SUBSTITUTION
		Base Bid	Substitute	
11289	Electric Actuators	Rotork Controls, Inc.		
11291	Metal Slide Gates	Whipps, Inc. Waterman Rodney Hunt Hydrogate		
11312	Self-Priming Wastewater Pumps	Gorman Rupp Co.	Wemco	
11372	Positive Displacement Blowers	Gardner Denver		
11375	Fine Bubble Membrane Diffusers	Evoqua Water Technologies		
11379	Septage Receiving Station	JWC Environmental Huber	Lakeside	
11380	Submersible Mixers	ABS Flygt	Wilo	
16160	Variable Frequency Drives	Allen Bradley	ABB	
16260	Standby Electrical Power System	Caterpillar Cummins	Kohler	

ARTICLE 8 – DEFINED TERMS

8.01 The terms used in this Bid with initial capital letters have the meanings stated in the Instructions to Bidders, the General Conditions, and the Supplementary Conditions.

ARTICLE 9 – BID SUBMITTAL

BIDDER: *[Indicate correct name of bidding entity]*

By: _____
[Signature]

[Printed name]
(If Bidder is a corporation, a limited liability company, a partnership, or a joint venture, attach evidence of authority to sign.)

Attest: _____
[Signature]

[Printed name]

Title: _____

Submittal Date: _____

Address for giving notices:

Telephone Number: _____

Fax Number: _____

Contact Name and e-mail address: _____

Bidder's License No.: _____
(where applicable)

SECTION C-410

BID FORM (STATE REVOLVING FUND)

ARTICLE 1 – BID RECIPIENT

1.01 This Bid is submitted to:

City of Lake City

202 Kelley St.

Lake City, SC 29560

1.02 The undersigned Bidder proposes and agrees, if this Bid is accepted, to enter into an Agreement with Owner in the form included in the Bidding Documents to perform all Work funded by the State Revolving Fund as specified or indicated in the Bidding Documents for the prices and within the times indicated in this Bid and in accordance with the other terms and conditions of the Bidding Documents for Lake Swamp WWTP Upgrade. The SRF scope of work is identified in Section 01010 – Summary of Work.

ARTICLE 2 – BIDDER’S ACKNOWLEDGEMENTS

2.01 Bidder accepts all of the terms and conditions of the Instructions to Bidders, including without limitation those dealing with the disposition of Bid security. This Bid will remain subject to acceptance for 90 days after the Bid opening, or for such longer period of time that Bidder may agree to in writing upon request of Owner.

ARTICLE 3 – BIDDER’S REPRESENTATIONS

3.01 In submitting this Bid, Bidder represents that:

A. Bidder has examined and carefully studied the Bidding Documents, and any data and reference items identified in the Bidding Documents, and hereby acknowledges receipt of the following Addenda:

<u>Addendum No.</u>	<u>Addendum, Date</u>
_____	_____
_____	_____
_____	_____
_____	_____

B. Bidder has visited the Site, conducted a thorough, alert visual examination of the Site and adjacent areas, and become familiar with and satisfied itself as to the general, local, and Site conditions that may affect cost, progress, and performance of the Work.

C. Bidder is familiar with and has satisfied itself as to all Laws and Regulations that may affect cost, progress, and performance of the Work.

D. Bidder has carefully studied all: (1) reports of explorations and tests of subsurface conditions at or adjacent to the Site that have been identified in the Supplementary Conditions, especially with respect to Technical Data in such reports and drawings.

- E. Bidder has considered the information known to Bidder itself; information commonly known to contractors doing business in the locality of the Site; information and observations obtained from visits to the Site; the Bidding Documents; and any Site-related reports and drawings identified in the Bidding Documents, with respect to the effect of such information, observations, and documents on (1) the cost, progress, and performance of the Work; (2) the means, methods, techniques, sequences, and procedures of construction to be employed by Bidder; and (3) Bidder's safety precautions and programs.
- F. Bidder agrees, based on the information and observations referred to in the preceding paragraph, that no further examinations, investigations, explorations, tests, studies, or data are necessary for the determination of this Bid for performance of the Work at the price bid and within the times required, and in accordance with the other terms and conditions of the Bidding Documents.
- G. Bidder is aware of the general nature of work to be performed by Owner and others at the Site that relates to the Work as indicated in the Bidding Documents.
- H. Bidder has given Engineer written notice of all conflicts, errors, ambiguities, or discrepancies that Bidder has discovered in the Bidding Documents, and confirms that the written resolution thereof by Engineer is acceptable to Bidder.
- I. The Bidding Documents are generally sufficient to indicate and convey understanding of all terms and conditions for the performance and furnishing of the Work.
- J. The submission of this Bid constitutes an incontrovertible representation by Bidder that Bidder has complied with every requirement of this Article, and that without exception the Bid and all prices in the Bid are premised upon performing and furnishing the Work required by the Bidding Documents.

ARTICLE 4 – BIDDER'S CERTIFICATION

4.01 Bidder certifies that:

- A. This Bid is genuine and not made in the interest of or on behalf of any undisclosed individual or entity and is not submitted in conformity with any collusive agreement or rules of any group, association, organization, or corporation;
- B. Bidder has not directly or indirectly induced or solicited any other Bidder to submit a false or sham Bid;
- C. Bidder has not solicited or induced any individual or entity to refrain from bidding; and
- D. Bidder has not engaged in corrupt, fraudulent, collusive, or coercive practices in competing for the Contract. For the purposes of this Paragraph 4.01.D:
 - 1. "corrupt practice" means the offering, giving, receiving, or soliciting of any thing of value likely to influence the action of a public official in the bidding process;
 - 2. "fraudulent practice" means an intentional misrepresentation of facts made (a) to influence the bidding process to the detriment of Owner, (b) to establish bid prices at artificial non-competitive levels, or (c) to deprive Owner of the benefits of free and open competition;
 - 3. "collusive practice" means a scheme or arrangement between two or more Bidders, with or without the knowledge of Owner, a purpose of which is to establish bid prices at artificial, non-competitive levels; and

4. "coercive practice" means harming or threatening to harm, directly or indirectly, persons or their property to influence their participation in the bidding process or affect the execution of the Contract.

ARTICLE 5 – BASIS OF BID

See section 01010-Summary of Work for SRF scope or work. Bidder will complete the Work in accordance with the Contract Documents for the following price(s):

Lump Sum Bid Price	\$ _____
Owner Contingency Allowance	\$ 50,000
Total Bid	\$ _____

_____ Dollars _____ Cents
(Both figures and words)

ARTICLE 6 – TIME OF COMPLETION

- 6.01 Bidder agrees that the Work will be substantially complete and will be completed and ready for final payment in accordance with Paragraph 15.06 of the General Conditions on or before the dates or within the number of calendar days indicated in the Agreement.
- 6.02 Bidder accepts the provisions of the Agreement as to liquidated damages.

ARTICLE 7 – ATTACHMENTS TO THIS BID

- 7.01 The following documents are submitted with and made a condition of this Bid:
- A. Required Bid security;
 - B. Evidence of authority to do business in the state of the Project; or a written covenant to obtain such license within the time for acceptance of Bids;
 - C. Contractor’s License No.: _____ Evidence of Bidder’s ability to obtain a State Contractor’s License and a covenant by Bidder to obtain said license within the time for acceptance of Bids;
- 7.02 Major Equipment Items
- A. The project will be awarded based on the base bid equipment listed below. The bidder must base his lump sum base bid on the listed equipment/suppliers in the Base Bid column of the schedule. Deductions for equipment substitutions will not be considered in determining the basis of award. The bidder may indicate substitute equipment/supplier items by writing in the substitute equipment/supplier item and the amount of deduction for that substitute name write-in.
 - B. Substitute equipment/supplier will be deemed as equal if the substitute is the same or better than the product named and described in the specifications in function, performance, reliability, quality and general configuration. Determination of the equality of a substitute shall be determined by the Engineer after the bid, based on submittal data

received with the Contractor's bid documents. Should the write-in substitute be determined "not equal", then the bidder shall supply the equipment listed in the Base Bid column. The Owner may determine any substitute "not equal" as the Owner determines to suit his sole best interests at any time.

- C. Evaluation data to determine if a substitute equipment manufacturer/ supplier is an acceptable substitute must be submitted by the bidder with the bid. Information submitted after the bid will not be considered. Information submitted directly by equipment manufacturers/suppliers will not be evaluated. Minimum evaluation data shall include submittal information in conformance with Section 01001 of the contract documents. Data and drawing submittal shall be prepared specifically for this project. Incomplete submittals that do not conform with Section 01001 will not be considered. Sales catalog cuts or marked up drawings from previous projects will not be reviewed. The Bidder shall reimburse the Owner for any engineering costs associated with the review of any substitutes in accordance with the terms of the Engineer's Agreement with the Owner. The Owner is no way obligated to review substitute equipment submittals.
- D. No substitute equipment/supplier will be considered unless, in the opinion of the Owner or Engineer, it conforms to the contract drawings and specifications in all respects, except for the make and manufacture and minor details. Design and preparation of these plans and specifications are based on the equipment/supplier noted in the Base Bid column of the schedule. The bidder shall be responsible for any and all changes necessary to accommodate the substitute equipment/supplier items. The Owner shall be reimbursed for any and all associated redesign and/or construction drawings in accordance with the terms of the Engineer's Agreement with the Owner. The bidder shall also include any and all costs associated with additional construction costs (mechanical, structural, electrical, architectural, engineering, construction observation, etc.) as the result of a substitute item. The bid shall also include any paid up licenses necessary for the use of the equipment as required.

EQUIPMENT/SUPPLIER SCHEDULE				
SPEC SECTION	DESCRIPTION	EQUIPMENT MANUFACTURERS/ SUPPLIERS		AMOUNT OF DEDUCTION FOR SUBSTITUTION
		Base Bid	Substitute	
11335	Clarifier Equipment Refurbishment	Evoqua Water Technologies	Envirodyne Systems Westech	

ARTICLE 8 – DEFINED TERMS

8.01 The terms used in this Bid with initial capital letters have the meanings stated in the Instructions to Bidders, the General Conditions, and the Supplementary Conditions.

ARTICLE 9 – BID SUBMITTAL

BIDDER: *[Indicate correct name of bidding entity]*

By:
[Signature] _____

[Printed name] _____
(If Bidder is a corporation, a limited liability company, a partnership, or a joint venture, attach evidence of authority to sign.)

Attest:
[Signature] _____

[Printed name] _____

Title: _____

Submittal Date: _____

Address for giving notices:

Telephone Number: _____





Fax Number: _____

Contact Name and e-mail address: _____

Bidder's License No.: _____
(where applicable)


H:\PROJECT FILES\100392.02 LAKE CITY SC - LAKE SWAMP - WWTP - UPGRADE\300 DESIGN\MECH\355 PRELIMINARY DRAWINGS\02 PROCESS MECH\17.1 EX BLOWER BUILDING.DWG
 REUSE OF DOCUMENTS: THIS DOCUMENT AND THE IDEAS AND DESIGNS INCORPORATED HEREIN, AS AN INSTRUMENT OF PROFESSIONAL SERVICE, IS THE PROPERTY OF CONSTANTINE ENGINEERING. HOWEVER, THIS SHALL NOT PROHIBIT THE REUSE OF THIS DOCUMENT BY THE CLIENT AS PROVIDED FOR BY THE CONTRACT.
 6/8/2021 8:21 AM

1

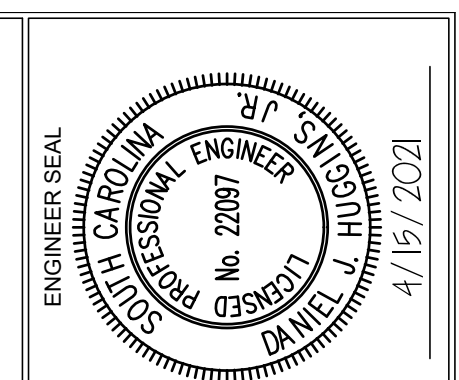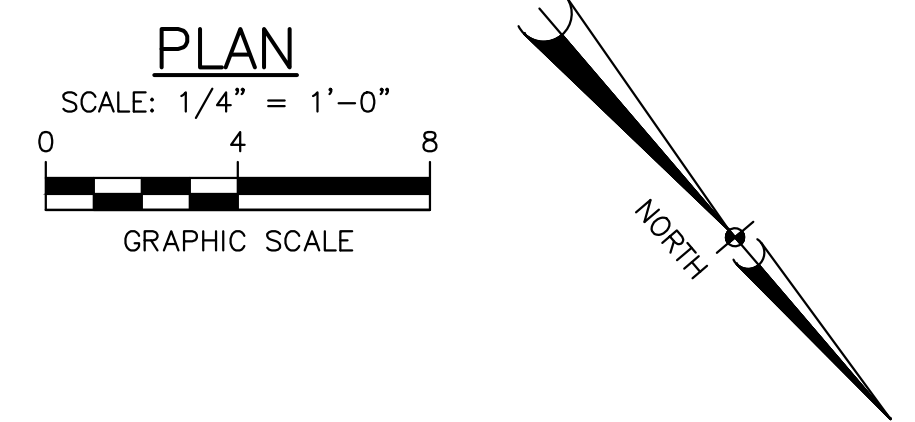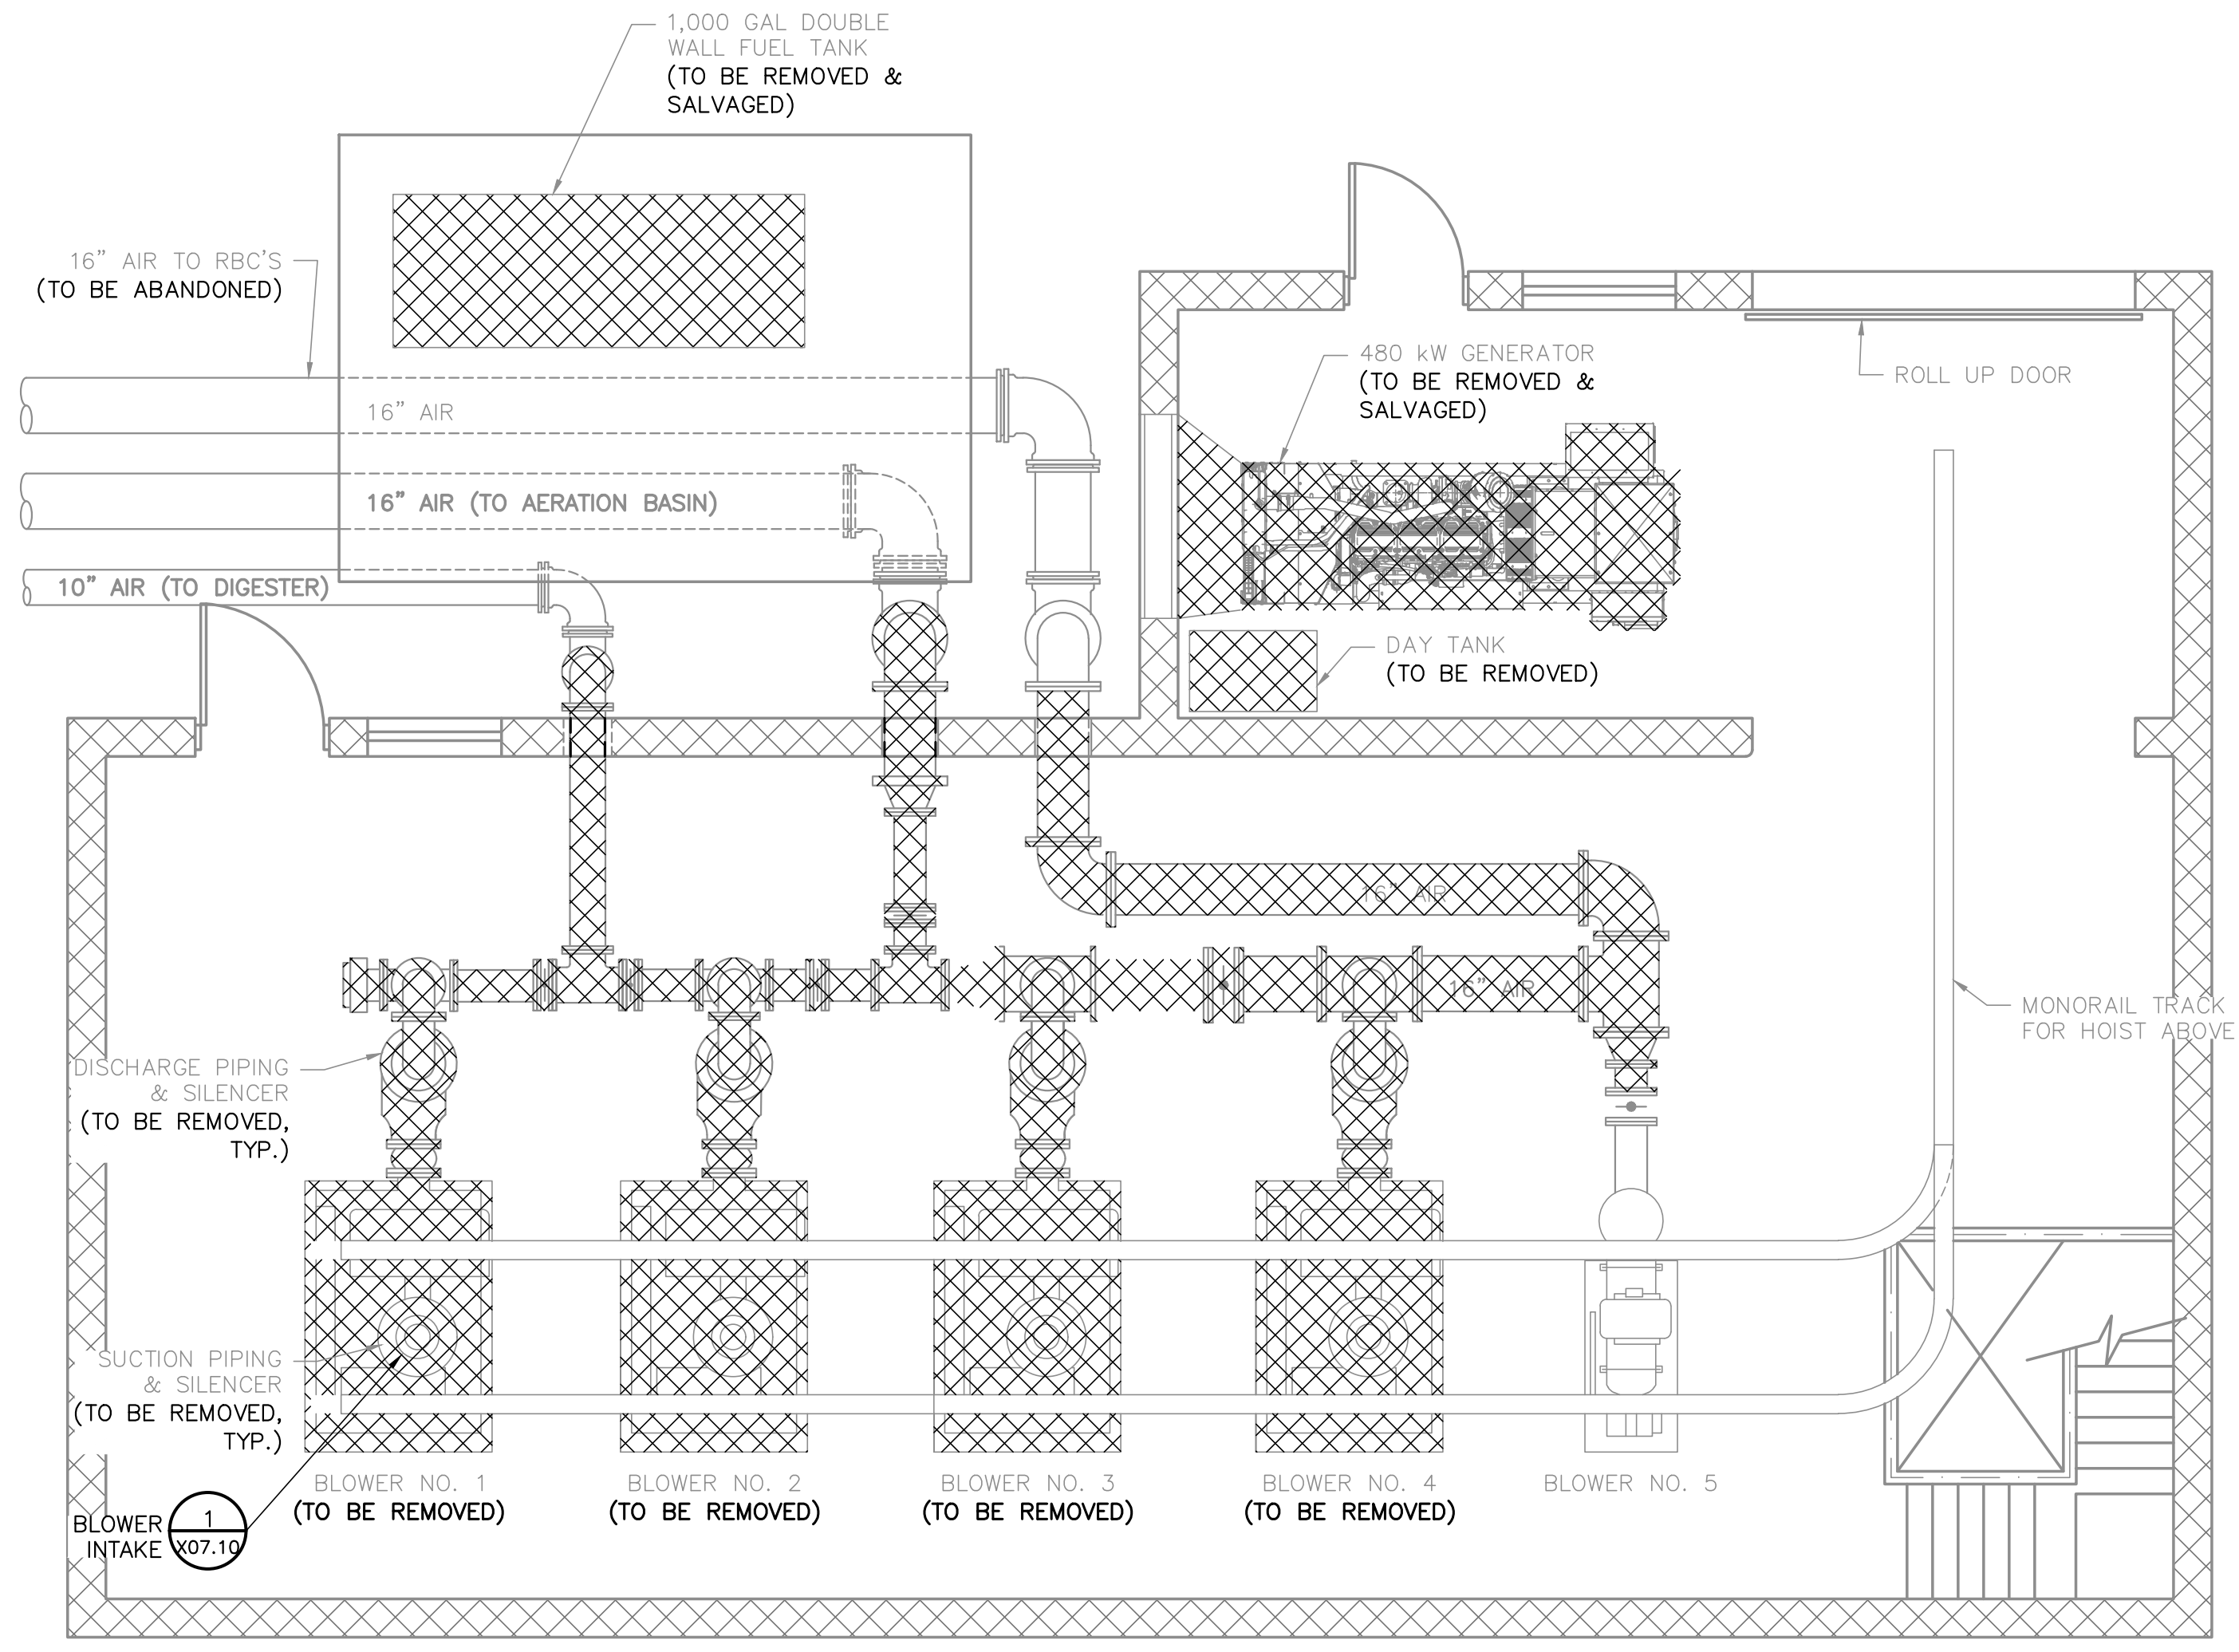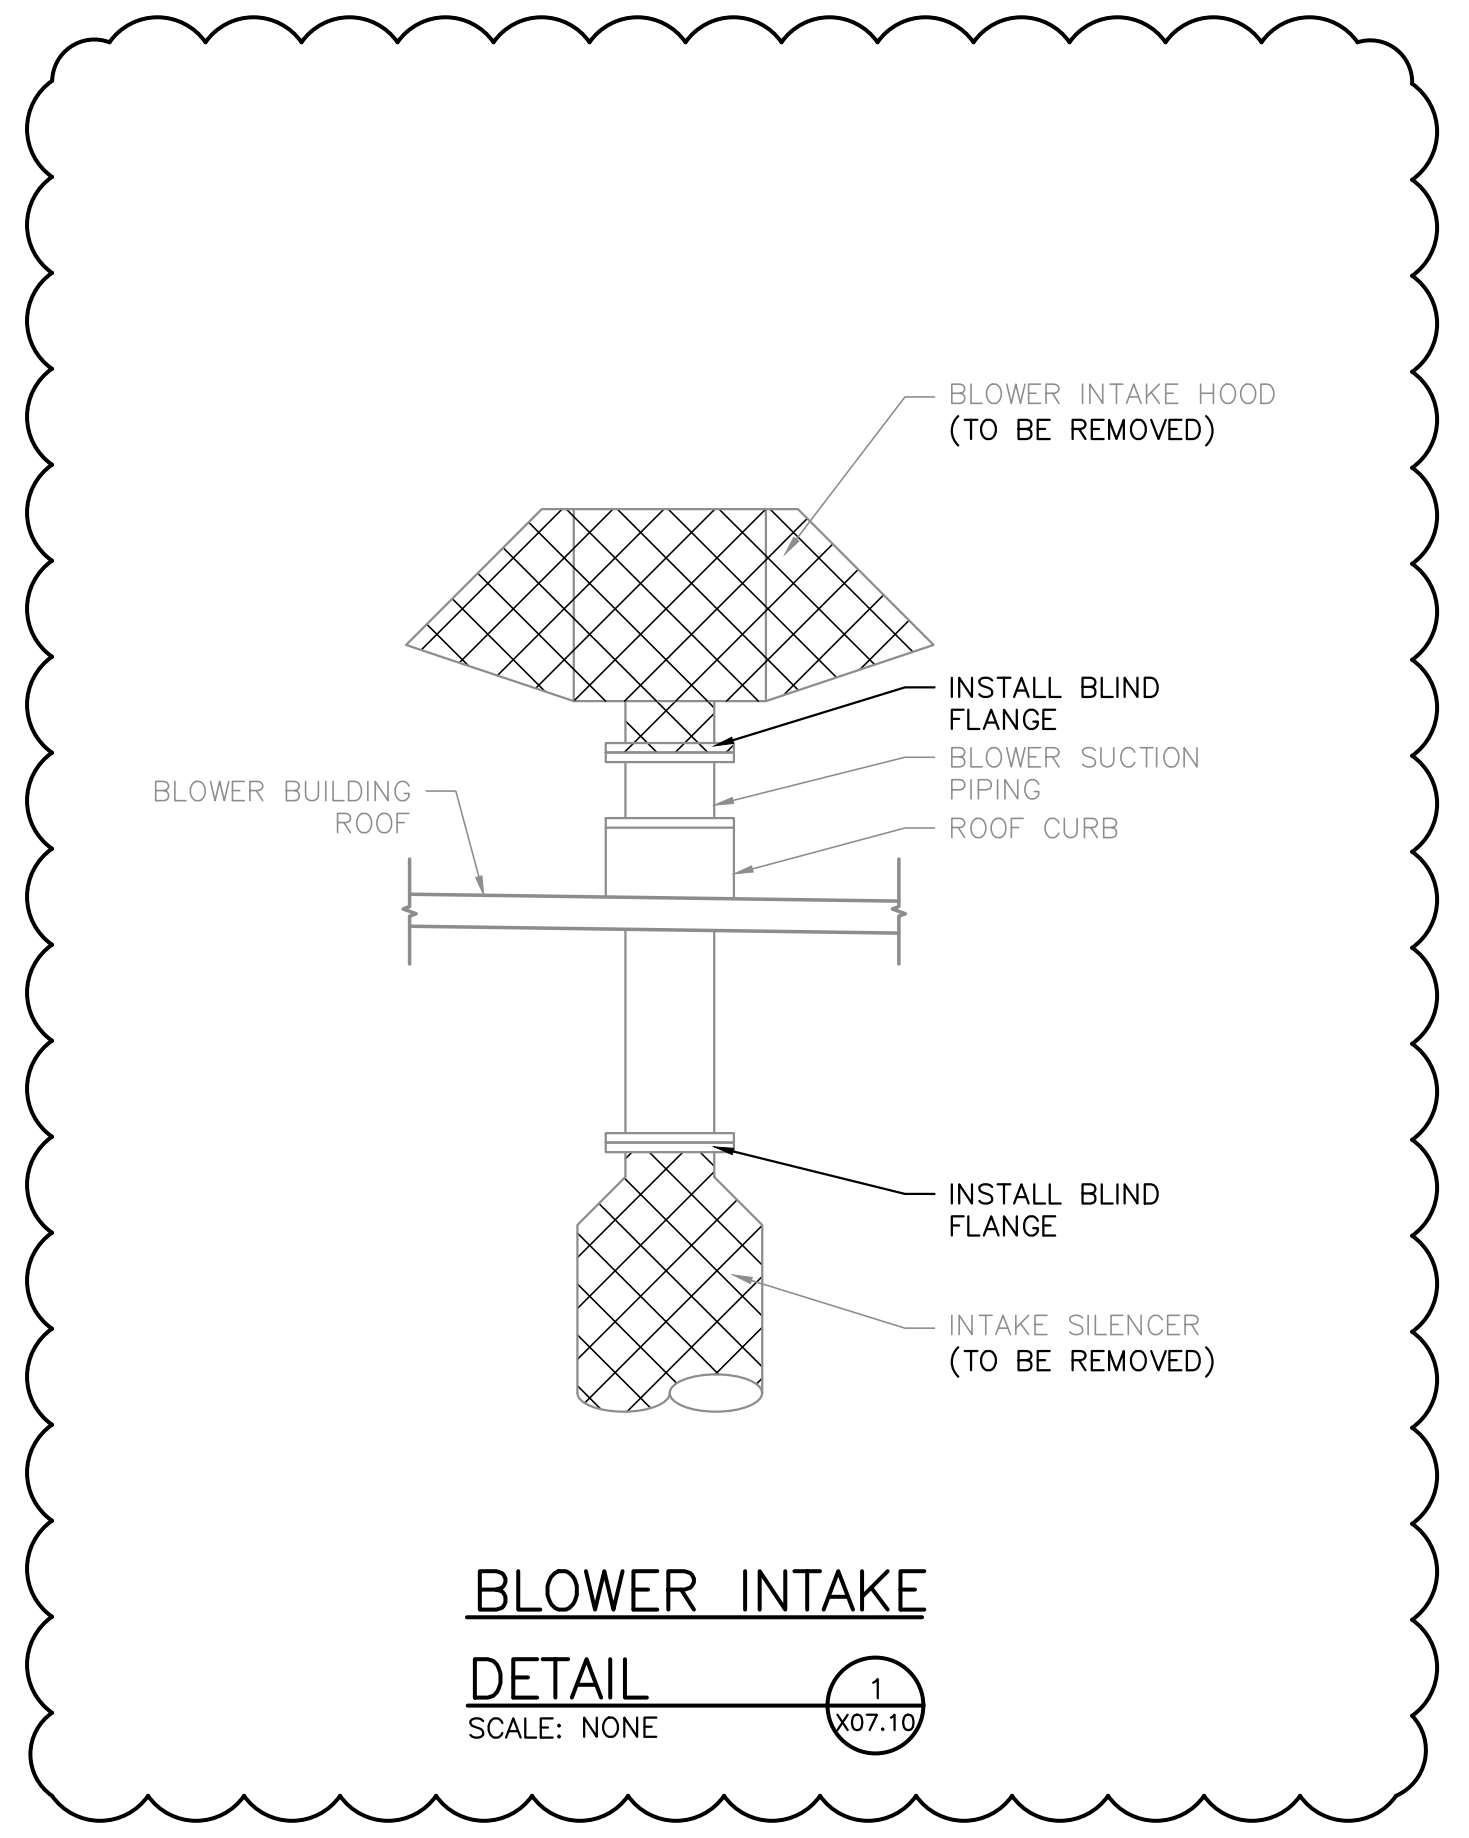

NO.	1	ADDENDUM NO. 1	DJH	MAB
DATE	6.7.21		BY	AP/D
DESIGNED BY:	DH	REVISION	CHECKED BY:	MB
			APPROVED BY:	JK

EXISTING BLOWER BUILDING
 DEMOLITION PLAN
 CITY OF LAKE CITY
 LAKE SWAMP WWTP UPGRADE

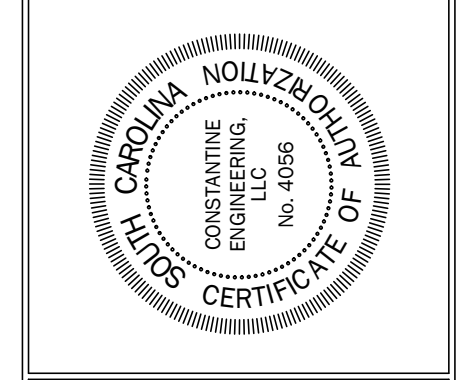

FILE	SEE LEFT
	VERIFY SCALE
	BAR IS ONE INCH ON ORIGINAL DRAWING
DATE	MARCH 2021
PROJ.	100392.02
DWG.	X07.10