

NOTES
 1. SHUTDOWN/TIE-IN PLAN REQUIRED. REFER TO SPECIFICATIONS FOR PROPER DISINFECTION OF POTABLE WATER LINE AS PART OF WORK.
 2. SEE PROFILE FOR LENGTH OF RESTRAINED JOINTS.




ABBREVIATION LEGEND
 NPW NON-POTABLE WATER

DIA DIAMETER

PIPE LEGEND

POT POTABLE WATER
 NPW NON-POTABLE WATER
 RS RAW SEWAGE PIPE

KEY PLAN

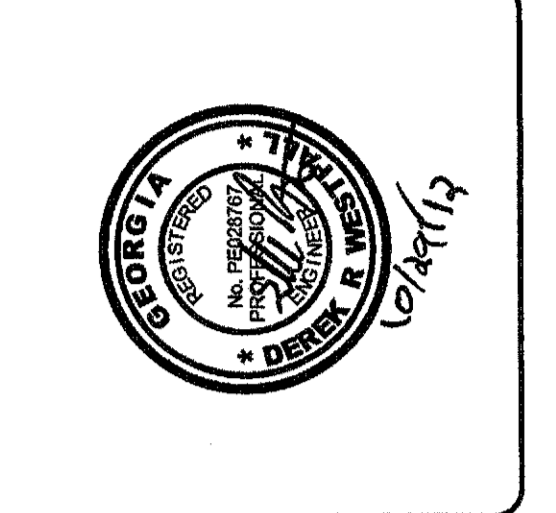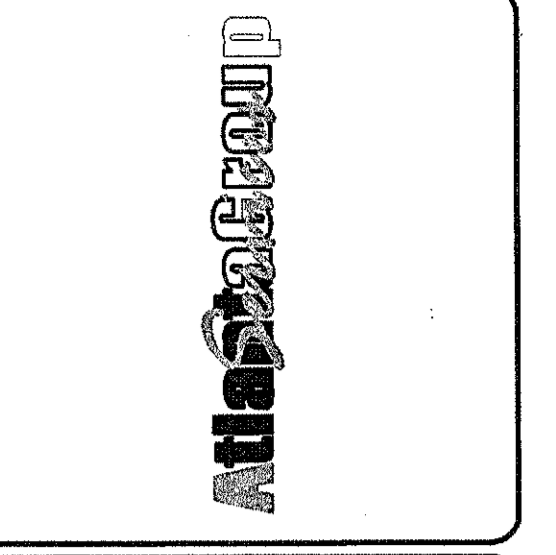
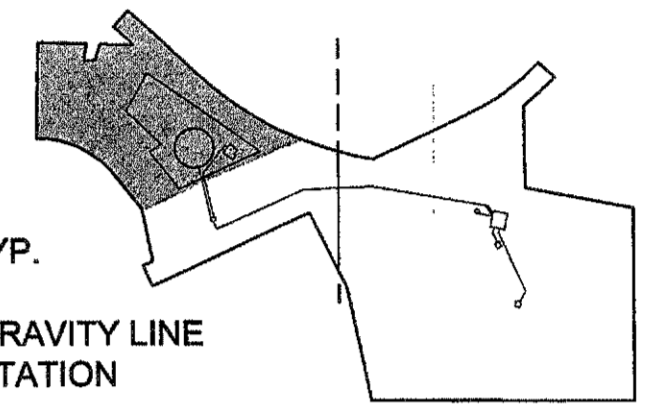


PEACHTREE CREEK SOUTH FORK
 RELIEF STORAGE AND PUMPING STATION
 DEPARTMENT OF WATERSHED MANAGEMENT
 CITY OF ATLANTA

REV	DATE	REVISION DESCRIPTION
0	10/28/12	100 PERCENT BID PACKAGE



Know what's below
 Call before you dig

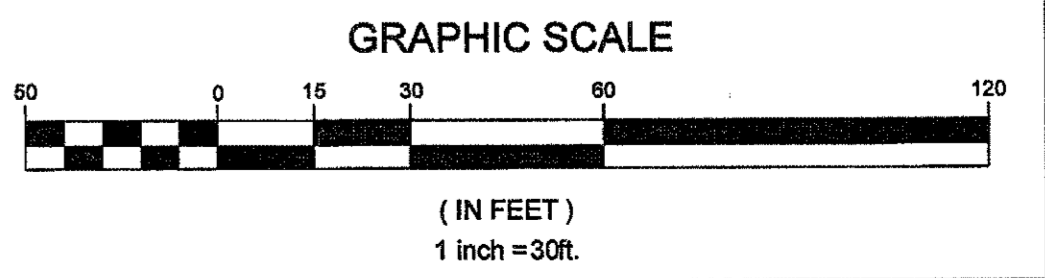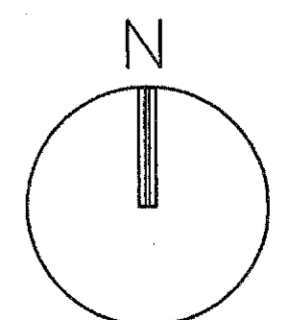

**185' DIA.
 EQUALIZATION
 TANK
 (10 MG)
 SEE SHEET
 D8-101**

N/F
 CHESHIRE BRIDGE PROPERTIES, LLC
 DB 49869/666
 TAX ID 17-0050-0002-035-7

STORM MH
 TOP 843.96
 INV N.E. 841.86 6" DIP
 INV S.W. 841.91 6" DIP

N/F
 RAYMOND MURRAH
 DB 10227/286
 TAX ID 17-0050-0002-021-7

SAN. MH
 TOP 861.62
 851.48 8" DIP
 851.31 8" DIP

SSMH-C1
 DOG HOUSE MH
 SEE CD-504
 TOP=864.76
 INV. IN(N.E.)=852.78

N/F
 LIDDELL, LLC
 DB 49113-1
 TAX ID 17-0050-0002-046-4

MATCHLINE SHEET CU-102

F
E
D
C
B
A