
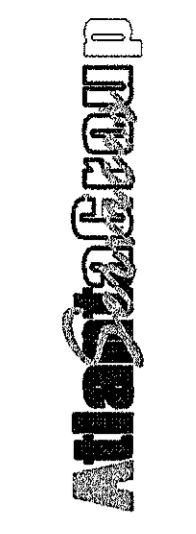


- NOTES:**
1. USE HOLLANDER HIGH TENSILE ALUMINUM ALLOY FITTINGS.
  2. USE 1 1/2" SCHEDULE 40/6061-T6 ALUMINUM PIPE.
  3. TOEBOARDS TO BE 6061-T6 ALUMINUM.
  4. USE 1/2" x 4 1/2" 316 SS EXPANSION ANCHORS (POWERS POWER-STUD™ #7623 OR EQUAL) WITH MIN. 2 1/2" EMBEDMENT (288 REQ.).
  5. ALL ALUMINUM IN DIRECT CONTACT WITH CONCRETE SHALL BE COATED WITH A MINIMUM 8.0 MIL-DRY THICKNESS SERIES 46-465 H.B. TNEMECOL OR EQUAL.

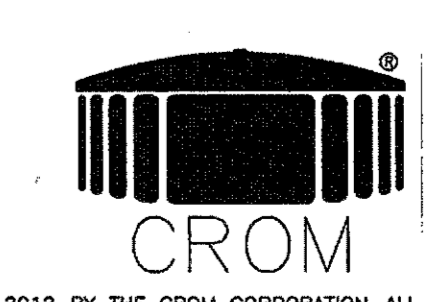

PEACHTREE CREEK SOUTH FORK  
RELIEF STORAGE AND PUMPING STATION

CITY OF ATLANTA  
DEPARTMENT OF WATERSHED MANAGEMENT

REV	DATE	REVISION DESCRIPTION
0	10/28/12	100 PERCENT BID PACKAGE

THIS LINE IS ONE INCH LONG WHEN PLOTTED FULL SCALE  
THIS DRAWING MUST BE USED IN CONJUNCTION WITH THE APPLICABLE OR GOVERNING TECHNICAL SPECIFICATIONS AND OTHER CONTRACT DOCUMENTS.

PROJECT NO: FC-6260  
DATE: OCTOBER 2012

RESP PROF: CROM	DESIGNER: CROM	CHECKER: DSF
-----------------	----------------	--------------

SHEET TITLE  
STRUCTURAL  
08 - EQUALIZATION TANK  
DETAILS

SHEET NO. 58-506	REV. 0
------------------	--------