


- ① INSTALL SEALANT ALL AROUND (TYP)
- ② 1/4" INTERIOR ALUMINUM SPLIT PLATE
- ③ 1/4" EXTERIOR ALUMINUM SPLIT PLATE
- ④ 3/8" S.S. ADH. ANCHOR W/MIN. 2" EMBEDMENT (TYP)
- ⑤ 3/8" S.S. MACHINE BOLTS (TYP)
- ⑥ L3"x5"x1/4" S.S. ALL AROUND M.O. AND ANCHORED TO CMU OR CONC. WITH 3/8" S.S. ADH. BOLTS @ 24" O.C. (TYP) MIN. 2" EMBEDMENT
- ⑦ PIPE OR DUCT- SEE P-DWGS OR M-DWGS LOCATE OPENING IN SPLIT PLATE TO PROPERLY ALIGN WITH PIPE
- ⑧ EDGE OF OPENING BEYOND
- ⑨ 2" x 5" x 1/4" THICK S.S. BACK-UP PLATE WELDED TO ONE SIDE OF SPLIT PLATE
- ⑩ CMU OR CONC. WALL
- ⑪ REINFORCED CMU U-BLOCK OR CONC. SEE S-DWGS
- ⑫ PLATE OPENING 1/4" LARGER RADIUS THAN PIPE/DUCT. INSTALL SEALANT ALL AROUND (TYP)
- ⑬ PRESSURE TREATED WOOD BLOCKING

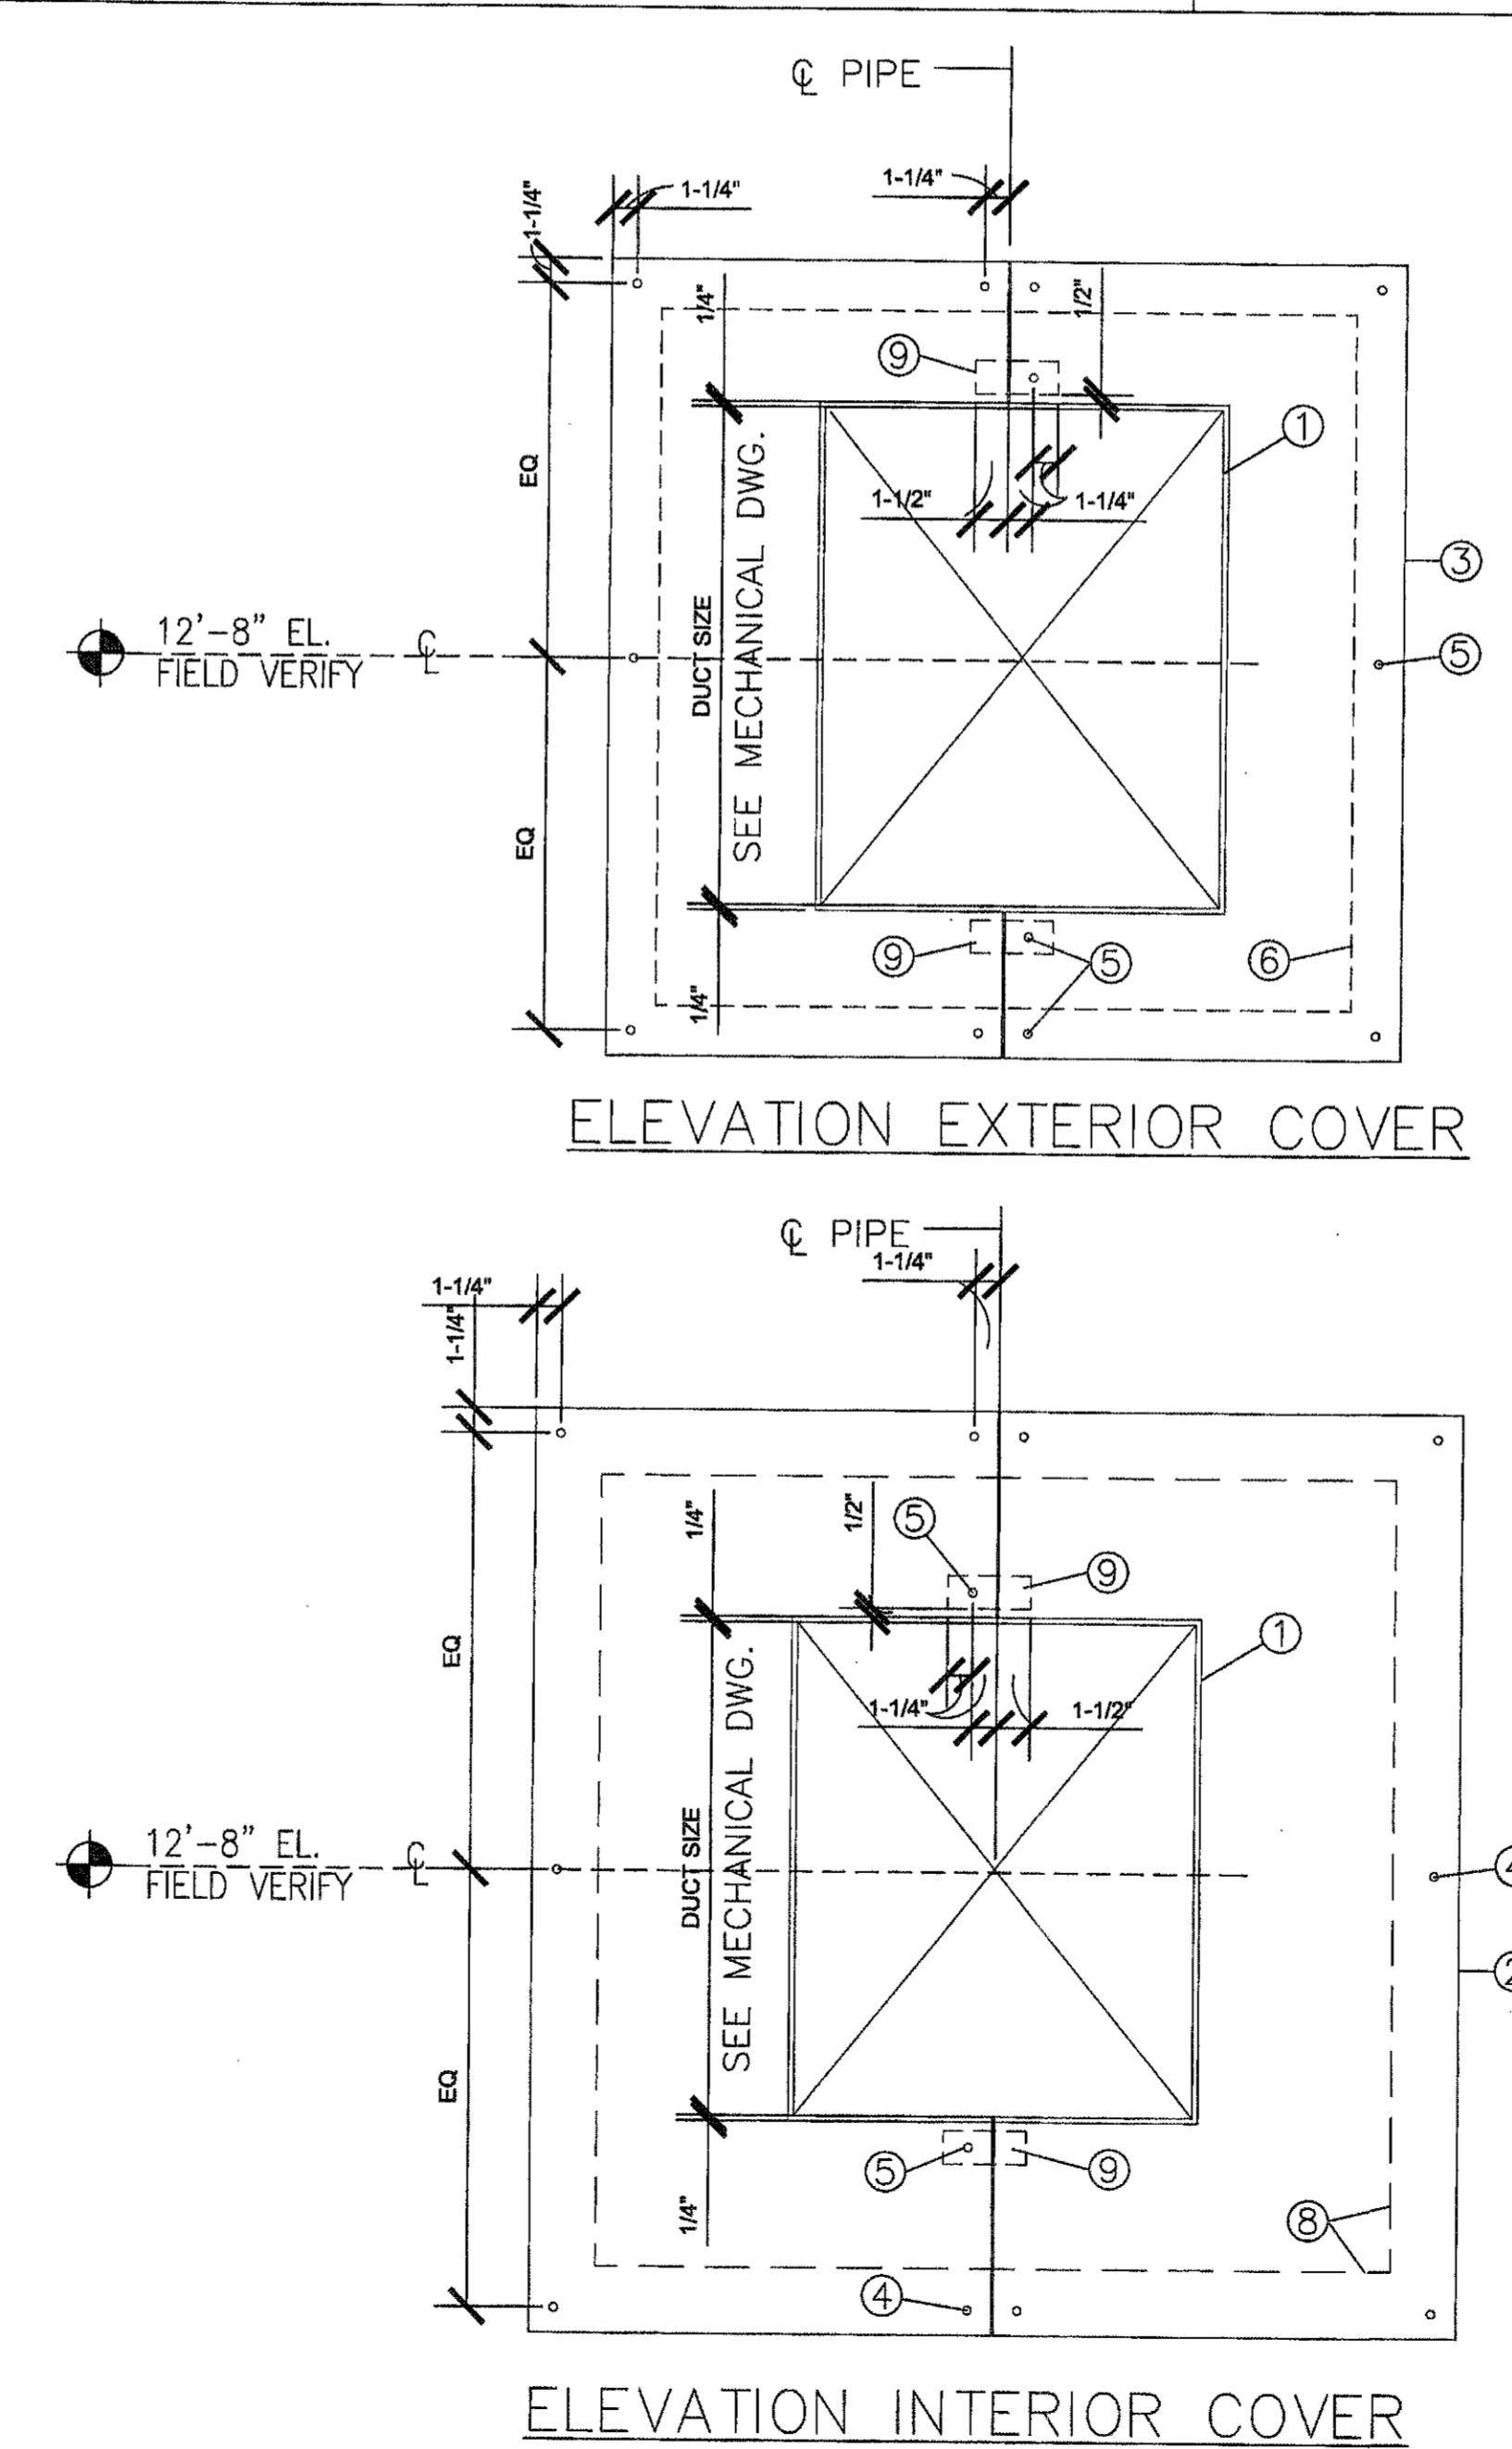

**tabcorp**

STATE OF GEORGIA  
REGISTERED PROFESSIONAL ENGINEER  
LOUISIANA  
REGISTERED PROFESSIONAL ENGINEER

PEACHTREE CREEK SOUTH FORK  
RELIEF STORAGE AND PUMPING STATION

CITY OF ATLANTA  
DEPARTMENT of WATERSHED MANAGEMENT

REV	DATE	REVISION DESCRIPTION

THIS LINE LONG WHEN PLOTTED FULL SCALE

THIS DRAWING MUST BE USED IN CONJUNCTION WITH THE APPLICABLE OR GOVERNING TECHNICAL SPECIFICATIONS AND OTHER CONTRACT DOCUMENTS.

PROJECT NO: FC-6260  
DATE: OCTOBER 2012  
RESP PROF: SJ  
DESIGNER: LC  
CHECKER: LC

SHEET TITLE  
ARCHITECTURAL  
07 - JET MIX PUMP STATION  
DETAILS

SHEET NO. A7-904 REV. 0

**J.W. ROBINSON & ASSOCIATES**  
ARCHITECTS • INTERIOR DESIGNERS • URBAN PLANNERS  
1020 RALPH DAVID ABERNATHY BLVD., S.W., ATLANTA, GEORGIA 30310  
PHONE: (404) 753-4129 FAX: (404) 753-4435