


1 2 3 4 5 6 7 8




F
E
D
C
B
A

NOTES:
 1. ALL INTERNAL PIPING, NOZZLES, SUPPORTS AND ANCILLARY COMPONENTS EXCLUDING THE WALL PIPE SHALL BE PROVIDED BY THE JET MIX SYSTEM EQUIPMENT SUPPLIER. SEE SPECIFICATION 11221.

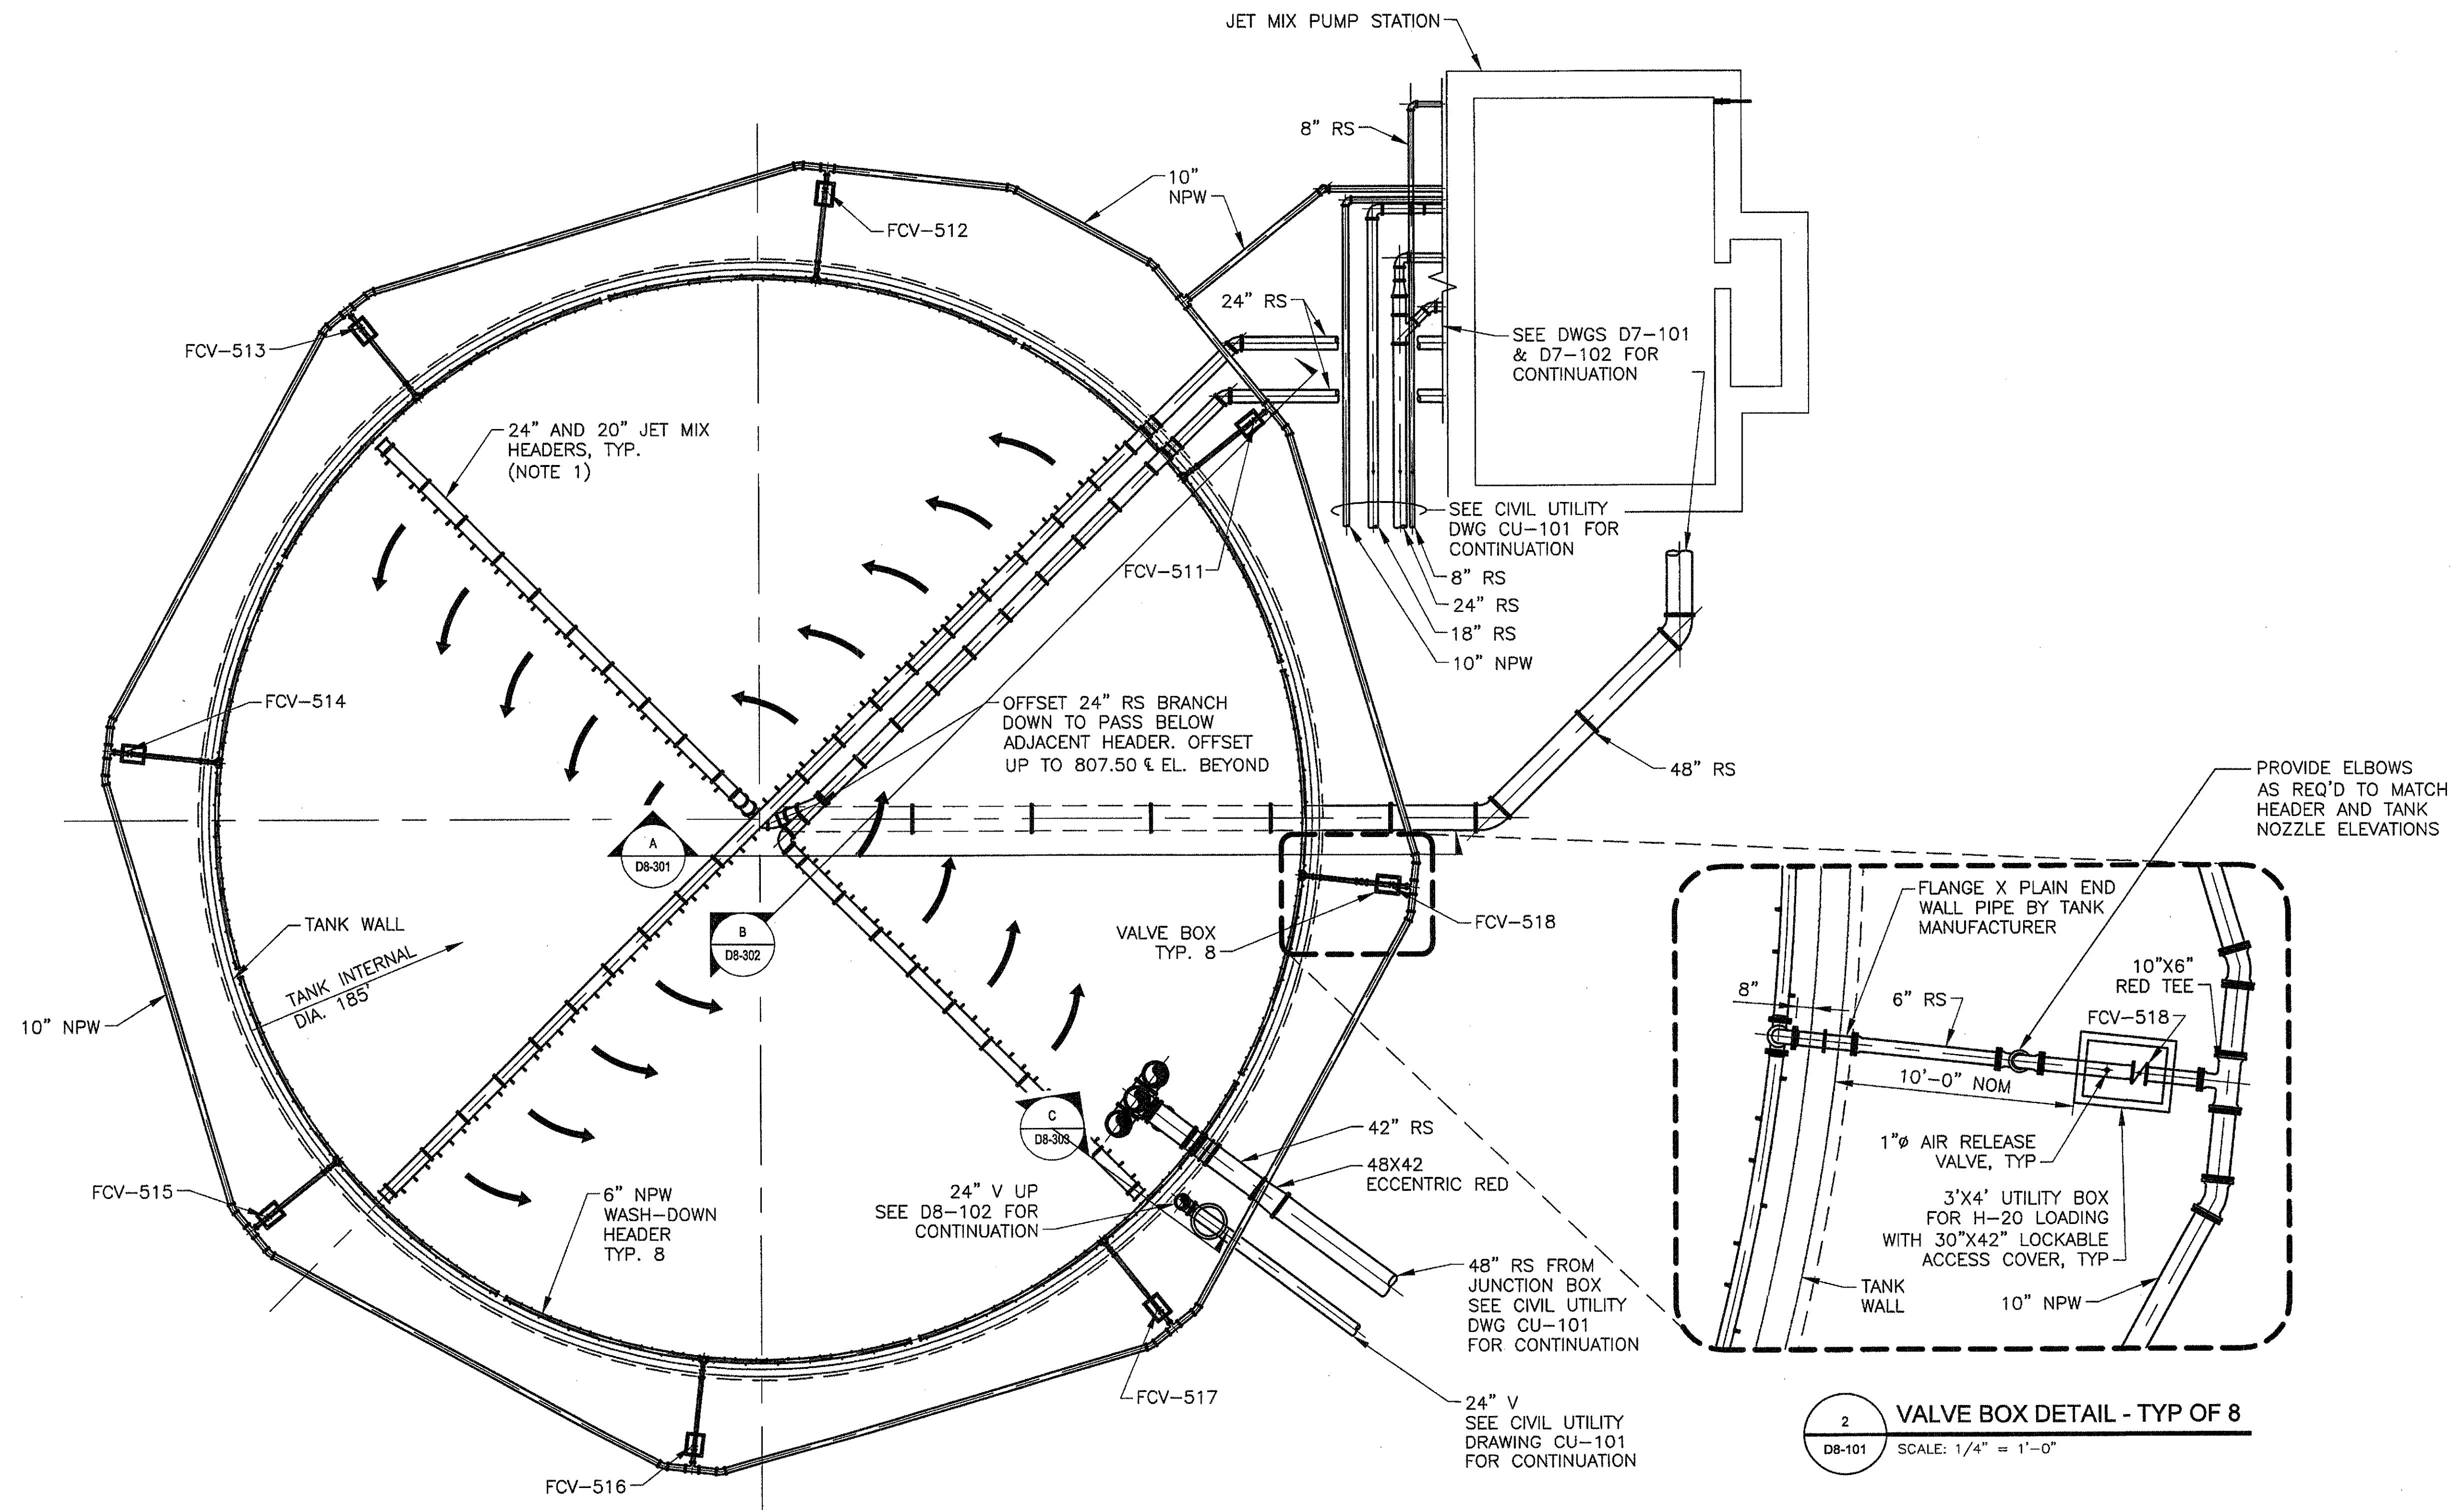

1 BASE PLAN
 D8-101 SCALE: 1/16" = 1'-0"

2 VALVE BOX DETAIL - TYP OF 8
 D8-101 SCALE: 1/4" = 1'-0"

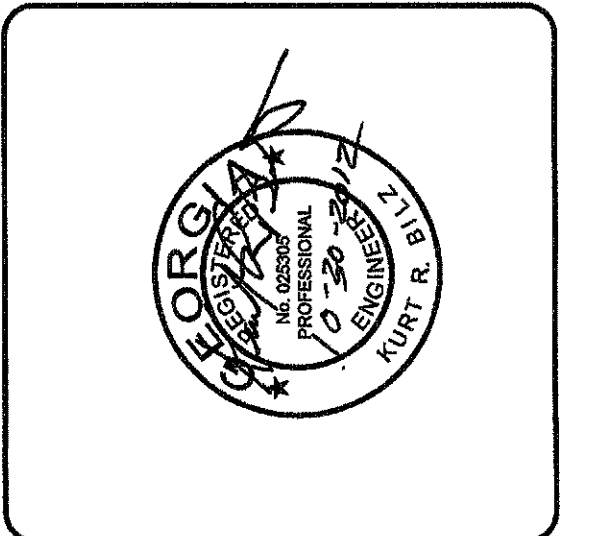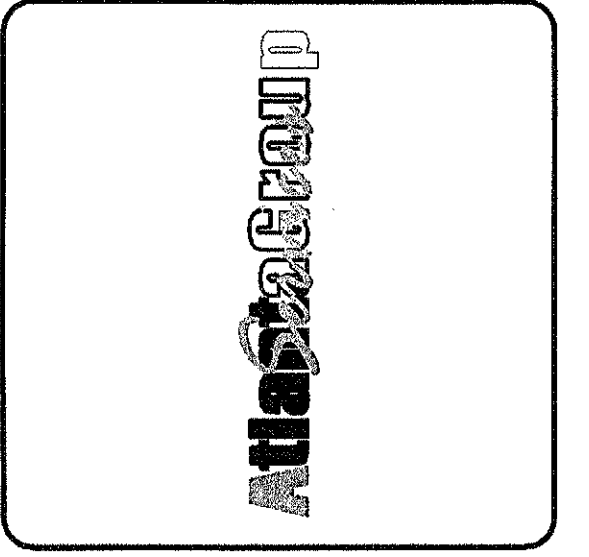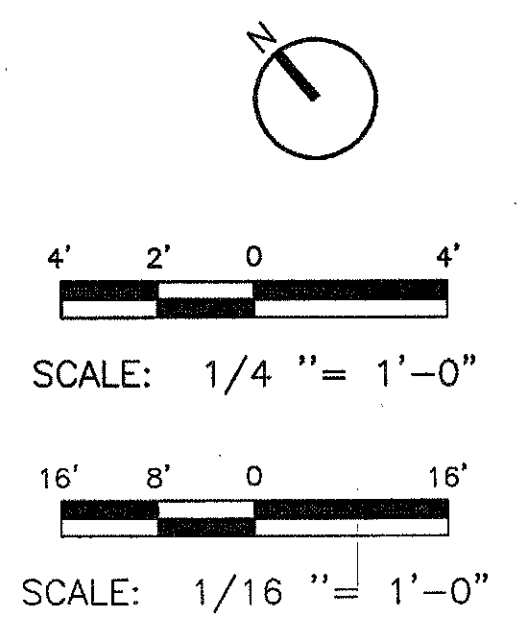

PEACHTREE CREEK SOUTH FORK
 RELIEF STORAGE AND PUMPING STATION
 CITY OF ATLANTA
 DEPARTMENT of WATERSHED MANAGEMENT

REV	DATE	REVISION DESCRIPTION
0	10/28/12	100 PERCENT BID PACKAGE

THIS LINE IS ONE INCH LONG WHEN PLOTTED FULL SCALE
 THIS DRAWING MUST BE USED IN CONJUNCTION WITH THE APPLICABLE OR GOVERNING TECHNICAL SPECIFICATIONS AND OTHER CONTRACT DOCUMENTS.
 PROJECT NO: FC-6260
 DATE: OCTOBER 2012
 RESP PROF: KB DESIGNER: PS CHECKER: VK
 SHEET TITLE
 PROCESS
 08 - EQUALIZATION STORAGE TANK
 BASE PLAN
 SHEET NO. D8-101 REV. 0