

MOUNTING: SURFACE
LOCATION: JET MIXING ELECTRICAL ROOM

PANEL "PPH-201"

SERVICE: 480V/277 3Ø 4W
AIC (MIN): 65,000A
MAINS: 225A MLO

CKT	POLE	BRKR	KVA	LOAD DESCRIPTION	KVA			LOAD DESCRIPTION	KVA	BRKR	POLE	CKT
					A	B	C					
1			2.7		5.40				2.7			2
3	3	20	2.7	AHU-701		5.40		AHU-702	2.7	20	3	4
5			2.7				5.40		2.7			6
7					0.00							8
9	3	20		SPARE		0.00		SPARE		20	3	10
11							0.00					12
13					0.00							14
15	3	20		SPARE		0.00		SPARE		20	3	16
17							0.00					18
19					0.00							20
21	3	20		SPARE		0.00		SPARE		20	3	22
23							0.00					24
25	1	20	2.9	PUMP ROOM LIGHTING	2.9			SPARE		20	1	26
27	1	20	0.8	ELEC. ROOM LIGHTING		0.8		SPARE		20	1	28
29	1	20	1.3	MAINTENANCE AREA LIGHTING			1.3	SPARE		20	1	30
31	1	20	0.4	STAIR LIGHTING	0.4			SPARE		20	1	32
33	1	20	0.5	EXTERIOR LIGHTING		0.5		SPARE		20	1	34
35	1	20	1.1	EQ. TANK LIGHTING			1.1	SPARE		20	1	36
37	1	20	0.6	SITE LIGHTING	1.6				1.0			38
39	1	20		SPARE			1.0	SPD	1.0		3	40
41	1	20		SPARE			1.0		1.0			42
COMMENTS:					TOTAL KVA	10.3	7.7	8.8				
① PROVIDE LOCK-ON DEVICE												
② BREAKER SIZE AND THROUGH CURRENT SHALL BE COORDINATED WITH MANUFACTURER												
③												
④												
⑤												
					CONNECTED :	KVA	AMP					
					EST. DEMAND :	26.2	31.6					

MOUNTING: SURFACE
LOCATION: JET MIXING ELECTRICAL ROOM

PANEL "PPL-201"

SERVICE: 120V/208 3Ø 4W
AIC (MIN): 65,000A
MAINS: 150A MCB

CKT	POLE	BRKR	KVA	LOAD DESCRIPTION	KVA			LOAD DESCRIPTION	KVA	BRKR	POLE	CKT
					A	B	C					
1	1	20	1.2	PIPE GALLERY RECEPTACLES	2.20			TELE. BKBRD. RECEPTACLE	1.0	20	1	2
3	1	20	0.6	BATH EXHAUST FAN		1.40		MAINTENANCE AREA RECEPTACLES	0.8	20	1	4
5	1	20	0.8	ELEC. RM./BATH RECEPTACLE			1.80	FACP	1.0	20	1	6
7	1	20	1.5	EWI-701	2.50			GMP-2	1.0	20	1	8
9	1	20	1.0	CCTV EQUIPMENT		2.00		LIGHTING CONTROL PANEL LC-201	1.0	20	1	10
11	1	20	1.9	SANITARY LIFT STATION			3.32	TANK VALVE CONV. RECEPTACLES	1.4	20	1	12
13	1	20	0.4	DOOR OPERATOR	1.40			PLANT SEC. CP	1.0	20	1	14
15	1	20	0.4	DOOR OPERATOR		1.40		LOSS OF VENTILATION	1.0	20	1	16
17	1	20	0.4	DOOR OPERATOR			0.40	SPARE		20	1	18
19	1	20	0.4	DOOR OPERATOR	0.40			SPARE		20	1	20
21	1	20	0.4	DOOR OPERATOR		1.40		SAN. LIFT STA. CONV. RECEPTACLE	1.0	20	1	22
23	1	20	0.4	DOOR OPERATOR			0.40	SPARE		20	1	24
25	1	20		SPARE	0.00			SPARE		20	1	26
27	1	20		SPARE		0.00		SPARE		20	1	28
29	1	20		SPARE			0.00	SPARE		20	1	30
31	1	20		SPARE	0.20			SPARE		20	1	32
33	1	20		SPARE		0.20		ROLL UP DOOR	0.2	20	3	34
35	1	20		SPARE			0.20	SPARE	0.2			36
37	1	20		SPACE	0.00			SPACE				38
39	1	20		SPACE		0.00		SPACE			3	40
41	1	20		SPACE			0.00	SPACE				42
COMMENTS:					TOTAL KVA	6.70	6.40	6.12				
① PROVIDE LOCK-ON DEVICE												
② BREAKER SIZE AND THROUGH CURRENT SHALL BE COORDINATED WITH MANUFACTURER												
③ PROVIDE SPD AND SIZE BREAKER PER MANUFACTURER REQUIREMENT												
④												
⑤												
					CONNECTED :	KVA	AMP					
					EST. DEMAND :	19.2	53.4					
					EST. DEMAND :	13.4	37.2					

MOUNTING: SURFACE
SEPARATE ISOLATED GROUND BUS
LOCATION: JET MIXING ELECTRICAL ROOM

PANEL "IPL-201"

SERVICE: 120V/208 3Ø 4W
AIC (MIN): 65,000A
MAINS: 150A MCB

CKT	POLE	BRKR	KVA	LOAD DESCRIPTION	KVA			LOAD DESCRIPTION	KVA	BRKR	POLE	CKT
					A	B	C					
1	1	20	0.5	FIT-531	0.60			LIT-501	0.1	20	1	2
3	1	20	0.5	FIT-532		0.60		LSHH-501	0.1	20	1	4
5	1	20	0.5	FIT-533			1.00	FIT-510	0.5	20	1	6
7	1	20	1.0	OCGMP-510	3.00			PLC-201	2.0	20	1	8
9	1	20	0.4	FIBER OPTIC REPEATER		1.40		RTU PANEL	1.0	20	1	10
11	1	20	0.1	FSL-516A		0.60		EQ TANK HIGH LEVEL INTERLOCKS	0.5	20	1	12
13	1	20	0.1	FSL-516B	0.10			SPARE		20	1	14
15	1	20	0.1	FSL-515A		0.10		SPARE		20	1	16
17	1	20	0.1	FSL-515B			0.10	SPARE		20	1	18
19	1	20		SPARE	0.00			SPARE		20	1	20
21	1	20		SPARE		0.00		SPARE		20	1	22
23	1	20		SPARE			0.00	SPARE		20	1	24
25	1	20		SPARE	0.00			SPARE		20	1	26
27	1	20		SPARE		0.00		SPACE		20	1	28
29	1	20		SPARE			0.00	SPACE		20	1	30
31	1	20		SPARE	0.00			SPACE		20	1	32
33	1	20		SPARE		0.00		SPACE		20	1	34
35	1	20		SPARE			0.00	SPACE		20	1	36
37	1	20		SPACE	1.00				1.0			38
39	1	20		SPACE			1.00	SPD	1.0		3	40
41	1	20		SPACE			1.00		1.0			42
COMMENTS:					TOTAL KVA	4.70	3.10	2.70				
① BREAKER SIZE AND THROUGH CURRENT SHALL BE COORDINATED WITH MANUFACTURER												
② PROVIDE SPD AND SIZE BREAKER PER MANUFACTURER REQUIREMENT												
③												
④												
⑤												
					CONNECTED :	KVA	AMP					
					EST. DEMAND :	10.5	29.2					
					EST. DEMAND :	9.6	26.7					

MOUNTING: SURFACE
LOCATION: JET MIXING ELECTRICAL ROOM


PANEL "VPL-201"

SERVICE: 120V/208 3Ø 4W
AIC (MIN): 65,000A
MAINS: 150A MCB


CKT	POLE	BRKR	KVA	LOAD DESCRIPTION	KVA			LOAD DESCRIPTION	KVA	BRKR	POLE	CKT
					A	B	C					
1			1.3		2.60			FCV-515	1.3	20	3	2
3	3	20	1.3	FCV-511		2.60		FCV-515	1.3	20	3	4
5			1.3				2.60	FCV-516	1.3	20	3	6
7			1.3		2.60			FCV-516	1.3	20	3	8
9	3	20	1.3	FCV-512		2.60		FCV-516	1.3	20	3	10
11			1.3				2.60	FCV-517	1.3	20	3	12
13			1.3		2.60			FCV-517	1.3	20	3	14
15	3	20	1.3	FCV-513		2.60		FCV-517	1.3	20	3	16
17			1.3				2.60	FCV-518	1.3	20	3	18
19			1.3		2.60			FCV-518	1.3	20	3	20
21	3	20	1.3	FCV-514		2.60		FCV-518	1.3	20	3	22
23			1.3				2.60	FCV-519	1.3	20	3	24
25			1.3		1.30			SPARE		20	3	26
27	3	20	1.3	FCV-519		1.30		SPARE		20	3	28
29			1.3				1.30	SPARE		20	3	30
31	3	20		SPACE	0.00			SPACE		20	3	32
33	3	20		SPACE		0.00		SPACE		20	3	34
35	3	20		SPACE			0.00	SPACE		20	3	36
37	3	20		SPACE	0.00			SPACE		20	3	38
39	3	20		SPACE		0.00		SPACE		20	3	40
41	3	20		SPACE			0.00	SPACE		20	3	42
COMMENTS:					TOTAL KVA	11.70	11.70	11.70				
① BREAKER SIZE AND THROUGH CURRENT SHALL BE COORDINATED WITH MANUFACTURER												
② PROVIDE SPD AND SIZE BREAKER PER MANUFACTURER REQUIREMENT												
③												
④												
⑤												
					CONNECTED :	KVA	AMP					
					EST. DEMAND :	35.1	97.5					
					EST. DEMAND :	22.6	62.7					

PANEL SCHEDULE NOTES
(FOR ALL PANEL SCHEDULES)

1. ALL PROTECTIVE DEVICES IN THE POWER SYSTEM SHALL HAVE ELECTRICAL SELECTIVE COORDINATION PER NEC. WHERE NECESSARY PROVIDE FRAME / TRIP RATING MODIFICATION, ADDITIONAL ISOLATION TRANSFORMERS, ADDITION OF ELECTRONIC TRIPPING ELEMENTS, INCREASE IN CABLE AND CONDUCTOR SIZE BETWEEN ELECTRICAL SYSTEM COMPONENTS (IE SWITCHBOARDS, PANELBOARDS, SWITCHES, TRANSFER SWITCHES, ETC.) IN ORDER TO ACHIEVE SELECTIVE COORDINATION AS REQUIRED PER THE NEC. ALL SUCH CHANGES SHALL BE BORNE BY CONTRACTOR AT NO ADDITIONAL COST TO THE OWNER. USE ELECTRONIC TRIP DEVICES IN THIS APPLICATION. FURNISH MANUFACTURER DOCUMENTATION INDICATING CODE COMPLIANT COORDINATION. REFER TO SPECIFICATION.

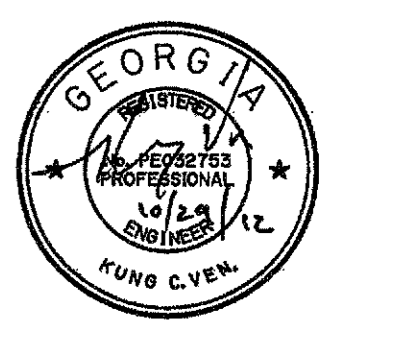

GEORGIA
CITY OF ATLANTA



REGISTERED PROFESSIONAL ENGINEER
K. VEN
KING C. VEN.

PEACHTREE CREEK SOUTH FORK
RELIEF STORAGE AND PUMPING STATION

DEPARTMENT OF WATERSHED MANAGEMENT

0	10/28/12	100 PERCENT BID PACKAGE	REV
			DATE
			REVISION DESCRIPTION

THIS LINE IS ONE INCH LONG WHEN PLOTTED FULL SCALE

THIS DRAWING MUST BE USED IN CONJUNCTION WITH THE APPLICABLE OR GOVERNING TECHNICAL SPECIFICATIONS AND OTHER CONTRACT DOCUMENTS.

PROJECT NO: FC-6260
DATE: OCTOBER 2012

RESP. PROF: KCV DESIGNER: AWP CHECKER: BFR

SHEET TITLE: ELECTRICAL
07 - JET MIXING PUMP STATION
PANEL SCHEDULES

SHEET NO. E7-601 REV. 0